

SEELEY COUNTY WATER DISTRICT

1898 West Main Street (P.O. Box 161) Seeley, CA 92273
Telephone: 760.352.6612 Facsimile: 760.352.0589



Board President: Patrick Harris

Board Members: Jason Grima, Keith Baird, Esteban Jaramillo, Leslie Hill

February 12, 2018

RESOLUTION NO. 021218-01

A RESOLUTION OF THE SEELEY COUNTY WATER DISTRICT ADOPTING A MUNICIPAL SERVICES REVIEW AND SERVICE AREA PLAN FOR THE SEELEY COUNTY WATER DISTRICT

WHEREAS, Section 56430 of the of the Cortese-Knox Local Government Reorganization Act of 2000 requires that Local Agency Formation Commissions (LAFCo's) conduct municipal service reviews also known as Service Area Plans; and

WHEREAS, the Imperial County LAFCo has required that the Seeley County Water District (SCWD) prepare a Service Area Plan for their review in conformance with Section 56430 of the Cortese-Knox Local Government Reorganization Act of 2000; and

WHEREAS, The Holt Group, Inc., at the direction of the SCWD, prepared an updated Service Area Plan in 2017 which was completed and submitted by SCWD management as a Draft to LAFCO on August 29th, 2017; and

WHEREAS, the Imperial County LAFCO held a Public Hearing and approved the Seeley County Water District Service Area Plan on January 25, 2018; and

WHEREAS, the project is exempt from the California Environmental Quality Act per Section 15306, Class 6 which consists of basic data collection, research, experimental management, and resource evaluation activities which do not result in a serious or major disturbance to an environmental resource; and

WHEREAS, the Service Area Plan was presented to the Seeley County Water District Board at a regular public meeting for consideration and adoption.

NOW, THEREFORE, BE IT FURTHER RESOLVED, that the Seeley County Water District Board of Directors hereby **ADOPTS** the Seeley County Water District Service Area Plan dated January 2018 as the Final Service Area Plan document and incorporated hereto by reference.


AYES: Directors Keith Baird, Esteban Jaramillo and Patrick Harris

NOES: _____

ABSENT: Directors Leslie Hill and Director Grima

ABSTAIN: _____

PASSED AND ADOPTED at a regular meeting of the Board of Directors of the Seeley County Water District held on the 12th day of February 2018.



Patrick Harris Board President

ATTEST:

I, MIRIAM ROSALES, Secretary of the Board of the Seeley County Water District, County of Imperial, State of California, DO HEREBY CERTIFY that the foregoing resolution was duly passed, approved and adopted by the Board of Directors of the Seeley County Water District at its regularly scheduled meeting held on the 12th day of February 2018.



By: Miriam Rosales, Secretary of the Board

SEELEY COUNTY WATER DISTRICT

SERVICE AREA PLAN

Prepared By:



Seeley County Water District
1898 Main Street
Seeley, CA. 92273

Submitted to:

IMPERIAL COUNTY
LOCAL AGENCY FORMATION COMMISSION
801 Main Street
El Centro, CA 92243



1601 N. Imperial Avenue
El Centro, CA. 92243

Final August 2017

TABLE OF CONTENTS

| | Page |
|--|-------------|
| 1.0 EXECUTIVE SUMMARY | 1 |
| 1.1 Population Projections..... | 1 |
| 1.2 Public Facility Analysis..... | 2 |
| 1.2.1 Service Provided by The Seeley County Water District | 2 |
| 1.2.2 Service Provided by Imperial County | 6 |
| 1.2.3 Service Provided by Others..... | 7 |
| 2.0 INTRODUCTION | 9 |
| 2.1 History of the Municipal Service Review/Service Area Plan..... | 9 |
| 2.2 Purpose of the Service Area Plan | 10 |
| 2.2.1 Requirements of a Service Area Plan..... | 10 |
| 2.2.2 Imperial County Local Agency Formation Commission | 10 |
| 2.2.3 Current Status of the SCWD Service Area Plan | 11 |
| 2.3 Background on Seeley and the Seeley County Water District | 11 |
| 2.4 Public Facilities and Service Provided | 17 |
| 2.5 General Outlook on Population Growth | 18 |
| 2.6 Organization of the Service Area Plan and Contents | 18 |
| 3.0 GROWTH AND PHASING PROJECTIONS | 20 |
| 3.1 Existing Land Use | 20 |
| 3.1.1 General Plan Land Use Policy | 20 |
| 3.1.2 Zoning | 20 |
| 3.2 Planned Land Uses..... | 23 |
| 3.2.1 Development Process..... | 23 |
| 3.3 Projected Population Increase | 25 |
| 4.0 BUILDOUT PHASING PROJECTIONS | 30 |
| 5.0 PUBLIC FACILITIES AND SERVICES | 32 |
| 5.1 Services Provided by the Seeley County Water District | 33 |
| 5.1.1 Administrative Facilities..... | 34 |
| 5.1.2 Wastewater Treatment Plant and Sewer Collection Facilities | 38 |
| 5.1.3 Water Treatment Plant & Distribution Facilities | 49 |
| 5.1.4 Park and Recreational Facilities..... | 60 |
| 5.2 Service Provided by Imperial County | 65 |
| 5.2.1 Fire Facilities | 66 |

| | |
|---|------------|
| 5.2.2 Law Enforcement Facilities | 70 |
| 5.2.3 Library Facilities | 74 |
| 5.2.4 Transportation Facilities | 77 |
| 5.2.5 Stormwater and Drainage Facilities | 86 |
| 5.3 Service Provided by Others | 90 |
| 5.3.1 Solid Waste Services and Facilities | 93 |
| 5.3.2 Lighting Facilities | 96 |
| 5.3.3 School Facilities | 96 |
| 6.0 FINANCING PLAN | 100 |
| 6.1 Introduction | 100 |
| 6.2 Existing Revenue Sources | 100 |
| 6.3 Potential Revenue Sources | 103 |
| 6.4 Facility Financing | 108 |
| 6.4.1 Administrative Facilities | 108 |
| 6.4.2 Wastewater Facilities | 108 |
| 6.4.3 Water Facilities | 109 |
| 6.4.4 Park & Lighting Facilities | 111 |
| 6.4.5 Drainage Facilities | 112 |

Exhibits

| Exhibits | Page |
|---|------|
| Exhibit 2-A Regional Location Map | 12 |
| Exhibit 2-B Seeley County Water District Boundary | 14 |
| Exhibit 2-C Sphere of Influence and District Boundary | 16 |
| Exhibit 3-A Seeley Urban Area Map | 21 |
| Exhibit 3-B Zoning Map | 22 |
| Exhibit 3-C Planned Development within Seeley County Water District's SOI | 24 |
| Exhibit 5-A Layout of the SCWD Service Building | 35 |
| Exhibit 5-B Existing Wastewater Treatment Plant Design & Flow | 41 |
| Exhibit 5-C Existing Wastewater Collection and Sewer Facility Schematic Map | 43 |
| Exhibit 5-D Existing Water Distribution System | 53 |
| Exhibit 5-E Proposed Water Treatment Improvements | 56 |
| Exhibit 5-F Park and Recreational Facilities Map | 61 |
| Exhibit 5-G Fire Station Location and Service Area | 67 |
| Exhibit 5-H Law Enforcement Facilities Location Map | 72 |
| Exhibit 5-I Street Classification Map | 79 |
| Exhibit 5-J Street Lighting System | 94 |
| Exhibit 5-K School Facilities Map | 97 |

Figures

| Figure | | Page |
|---------------|---|-------------|
| Figure 2-A | Population Growth within SCWD from 1990-2017 | 17 |
| Figure 3-A | Historic Population Growth within SCWD | 27 |
| Figure 3-B | Population Projections within SCWD Service Area | 29 |

Tables

| Tables | | Page |
|---------------|---|-------------|
| Table 1-A | SCWD Population Projections | 1 |
| Table 3-A | Specific Plan & Development Phasing | 26 |
| Table 3-B | Population Growth Comparison | 28 |
| Table 4-A | Available Undeveloped Land within SCWD | 30 |
| Table 4-B | Potential Developable Units per Residential Zone | 31 |
| Table 5-A | Wastewater Pipeline General Design Criteria | 39 |
| Table 5-B | SCWD Wastewater Collection Pipelines | 42 |
| Table 5-C | Capacity Demand Based on Historic Growth Projections | 45 |
| Table 5-D | Capacity Demand Based on Natural Growth Rate and Approved Projects .. | 46 |
| Table 5-E | Capacity Demand For Natural Growth Rate and Projected Development . | 46 |
| Table 5-F | Projected Near-Term Wastewater Facility Improvement Needs | 47 |
| Table 5-G | Water Flow Standards | 50 |
| Table 5-H | Water Capacity Demand Based on Historic Growth Projections | 57 |
| Table 5-I | Buildout Demand for Water Treatment Plant | 57 |
| Table 5-J | Projected Near-Term to Mid-Term Water Facility Improvement | 58 |
| Table 5-K | SCWD Existing Parks | 60 |
| Table 5-L | Roadway Performance Standard | 77 |
| Table 5-M | Imperial County Standards Per Street Classification | 78 |
| Table 5-N | Recommended Drainage Improvements | 88 |
| Table 6-A | SCWD Adopted Impact Fee's | 101 |
| Table 6-B | Water Rates | 102 |
| Table 6-C | Sewer Rates | 102 |

Appendices

Appendices

| | |
|------------|--|
| Appendix A | County of Imperial Development Impact Fee's and Ordinance 1418 |
| Appendix B | Pavement Management Analysis Report |
| Appendix C | Seeley Area Drainage Master Plan |
| Appendix D | SCWD Approved Budget and Financial Statement |

Blank Page

1.0 **EXECUTIVE SUMMARY**

This Executive Summary provides a brief summary of the population projections to provide a context for the analysis and findings presented for each individual public facility in terms of the performance standard, existing facilities, existing facility demand versus anticipated future demand and its adequacy, mitigation, funding sources, annual budget and cost per capita.

1.1 **POPULATION PROJECTIONS**

This Service Area Plan uses population projections based on existing serviced residential connections tied to the average household size and anticipated development, as provided in the Growth Projections section of this document with an application of a modest 2.08% growth rate. The Seeley service population is estimated to be 2,140 based on the number of actual residential service connections multiplied by 3.53 persons per household as established on the 2010 Census data for household characteristics. This existing population is estimated to increase to 3,111 by the year 2035 due to natural growth that assumes a modest 2.08% annual growth rate. This number does not take planned development into account. If the approved and planned development comes into fruition, the population can increase up to 9,889 by the year 2035 (based on a construction start date of 2019 and a build rate of 120 new dwelling units per year). The following table, **SCWD Population Projections**, projects the future population of the District through Year 2035 in five-year increments under both the assumption that planned development does or does not come through.

Table 1-A
SCWD Population Projections

| Year | Population Projections At 2.08% Growth Rate ¹ | Population Projections with Planned Development and 2.08% |
|------|--|---|
| 2017 | 2,140 | 2,140 |
| 2020 | 2,278 | 2,702 |
| 2025 | 2,528 | 5,069 |
| 2030 | 2,804 | 7,464 |
| 2035 | 3,111 | 9,889 |

¹Calculated by actual residential service connections and multiplying by 3.53 person per household for base population.

1.2 PUBLIC FACILITY ANALYSIS

This section provides an overview of findings for both facilities serviced by the Seeley County Water District and other public agencies. The following facilities and services were reviewed: Administrative Facilities, Wastewater Treatment Plant and Wastewater Collection System, Water Treatment Plant and Water Distribution System, Parks and Recreation Facilities, and other services provided by Imperial County and other agencies including Fire Facilities, Law Enforcement Facilities, Library Facilities, Transportation Facilities, Drainage Facilities and School Facilities.

1.2.1 Services Provided by the Seeley County Water District

The proceeding tables summarize the findings for services provided by the Seeley County Water District but may also include coordination with other agencies who extend similar services. The findings are based on information obtained from existing reports such as Preliminary Engineering Reports (PER's), infrastructure studies, Specific Plans, adopted budgets, and discussions with District Staff. Also incorporated is reference to the Imperial County 2011 Draft Municipal Service Review.

1.2.1.1 Administrative Facilities

| Administrative Facilities Summary of Findings | |
|---|--|
| Performance Standard | None Applied |
| Existing Facilities | 1,059 square feet reserved for offices & administrative functions. |
| Existing Demand | 393 square feet of office space per 1,000 in population |
| Adequacy | The current administrative offices for District Staff are adequate. |
| Future Demand | No additional facilities warranted through 2035. Facility Expansion Necessary at Full Build-Out. |
| Mitigation | Recommended Mitigation: <ul style="list-style-type: none"> A-1 Establish an Administrative Budget A-2 Consider Adopting an Administrative Developer Fee A-3 Initiate Administration & Operations Building Plans |
| Funding Sources | Current: SCWD Water Fund and Wastewater Fund Future: SCWD Water Fund and Wastewater Fund and Developer Fees |
| Annual Budget | Not Separately Budgeted at This Time. |
| Cost Per Capita | Not Applicable |

Administrative Facilities were generally found to be adequate to meet the projected service demand to the SCWD during the Planning Period. No Capital Improvements are necessary at this time, however, mitigation measures are proposed for administrative facilities that are discussed in more detail under the respective section.

1.2.1.2 Wastewater Facilities

| Wastewater Treatment and Sewer Capacity Summary of Findings | |
|---|--|
| Performance Standard | Must meet or exceed peak demand and meet effluent discharge requirement of the RWQCB. |
| Existing Facilities | Treatment Capacity: 0.25 MGD |
| Existing Demand | Average Annual Demand up to 0.11 MGD (2017) Peak Flow Demand 0.38 GPD (2017) |
| Adequacy | Demand at 45% of Capacity at 0.11 MGD (2017) In Compliance with RWQCB. |
| Future Demand | Based on Natural Growth Rate 2020: 0.139 MGD 2025: 0.164 MGD 2035: 0.224 MGD |
| Mitigation | Recommended Mitigation: WW-1 Adequate Reserves WW-2 Solicit Funding Resources WW-3 Evaluate Impact Fees WW-4 Develop Wastewater Master Plan WW-5 Impose Fair Share Costs on Developers WW-6 Develop Sewer System Management Plan |
| Funding Sources | Current: Wastewater Fund and Grant Resources. Future: Wastewater Fund and Grant Resources. |
| Annual Budget | Approximately \$455,651 (17/18 Adopted Budget) |
| Cost Per Capita | \$212.92 |

Wastewater Facilities are found to be generally adequate in meeting the near term and mid-term (2035) demands of the SCWD but would require capital investment via facility expansion to address the projected future demand that may

be generated by the planned development Sunbeam Lake Estates, Phase I. These additional demands and a full discussion of the mitigation measures proposed for wastewater facilities are more detailed in the respective section.

1.2.1.3 Water Facilities

| Water Treatment and Distribution System Findings | |
|--|--|
| Performance Standard | Meet minimum flow, pressure, and storage requirements, and minimum quality standards established by the California Department of Public Health (CDPH). |
| Existing Facilities | Treatment Capacity: 1.08 MGD Storage Capacity: 1 MG |
| Existing Demand | Average Daily Demand 0.214 MGD (2016) Peak Demand 0.39 MG |
| Adequacy | Demand Adequate at 20% of Capacity (2017) In Compliance with CDPH Standards. |
| Future Demand | Based on Natural Growth Rate 2020: 0.37 MGD 2025: 0.63 MGD 2035: 1.15 MGD |
| Mitigation | Recommended Mitigation: <ul style="list-style-type: none"> W-1 Adequate Reserves W-2 Solicit Funding Resources W-3 Evaluate Impact Fees W-4 Develop Water Master Plan W-5 Impose Fair Share Costs on Developers |
| Funding Sources | Current: Water Fund and Grant Resources Future: Water Fund and Grant Resources. |
| Annual Budget | Approximately \$350,628 (17/18 Adopted Budget) |
| Cost Per Capita | \$163.84 |

Water Facilities were found to be generally adequate to meet the near term demands of the SCWD but would require mitigation to address future demand during the Planning Period by 2030. Mitigation measures are proposed for water

facilities and are more detailed in the respective section. However, capital investment via facility expansion to address the projected future demand that may be generated by the planned development Sunbeam Lake Estates, Phase I would be necessary. This demand is addressed in more detail under the respective section.

1.2.1.4 Park and Recreation Facilities

| Parks and Recreation Facilities Summary of Findings | |
|---|---|
| Performance Standard | 5 acres per 1,000 in population |
| Existing Facilities | 3.58 Acres of parkland owned by SCWD 66.55 Acres of parkland owned by Imperial County 70.13 Total Acres of Parkland |
| Existing Demand | 10 acres (based on population of 2,140) |
| Adequacy | Surplus: 32 acres per 1,000 in population |
| Future Demand | None (Existing Acreage Supported through 2035) |
| Mitigation | Recommended Mitigation: PR-1 Seek Financial Resources for Operation/Services PR-2 Seek Grant Resources for Capital Improvements |
| Funding Sources | SCWD Current: Grant Resources. SCWD Future: Grant Resources. |
| Annual Budget | Not Separately Budgeted at This Time. |
| Cost Per Capita | Not Applicable |

Park Facilities were found to be adequate in dedication to meet the near term and long term demands of the SCWD but would require mitigation to address park facilities and program needs. SCWD is restricted from using enterprise funds for park facilities thus funding challenges throughout the planning Period for the proper development, repair and maintenance of park facilities may exist. Currently both parks are operated and maintained by Imperial County, but the Robert Bates Memorial Park (leased out to the Imperial County) has seen little investment. Mitigation measures for financial resource examination are proposed for park facilities and are more detailed in the respective section.

1.2.2 Services Provided by Imperial County

This sub-section provides an overview of findings for the following facilities and services administered, financed, and implemented by Imperial County, in whole or in part: Fire Facilities, Law Enforcement, Library Facilities, and Transportation Facilities. The findings for each of these sections and the discussion in Section 5.2 – Services Provided by Imperial County are based on the Draft 2011 Municipal Service Review prepared for the County of Imperial by Hofman Planning and Engineering.¹

1.2.2.1 Fire Facilities Findings

The most recently drafted Service Area Plan (2011) for Imperial County identified the existing fire facilities as adequate in size. However, the existing Seeley Fire Station did not meet all the current building code requirements. Service, however appears to be adequate according to the Fire Chief of the County of Imperial, which stated that as of the date of this SAP, the existing staffing levels are sufficient based on the current demands and average response times.

1.2.2.2 Law Enforcement Findings

The service demand is currently deficient eight (8) law enforcement officers as of the date of this Service Area Plan. The calculated demand is for 56 officers (based on 1.43 officers per 1,000 in population) for County-wide services. According to the Sheriff's office, it is currently operating with 48 officers dedicated to patrol. Although this is beyond the service responsibilities of the SCWD, this is an area that may require representation if crime rates or response time become an issue in the Seeley Community given that the nearest station is seven miles away from Seeley.

1.2.2.3 Library Facilities Findings

The current library service levels for the Seeley population are currently substandard given the current population of 2,140 and the limited hours of the local library station. The library station operates only two hours and thirty minutes (2.5 hours) a month, not open on weekends, and open no later than 6:45 p.m. thus somewhat restricting accessibility to the community.

1.2.2.4 Transportation Facilities Findings

Per the Imperial County Circulation Element, updated in 2008, all roadways within the SCWD Sphere of Influence are operating at a Level of Service C or better, with the exception of Dogwood Road between Seeley Road to Jasper Road which had a Level of Service D. Additionally, several roadway segments within the Seeley

¹ Although the Imperial County Municipal Service Review has been under review by Imperial County since January 2011, as of June 2017, Imperial County has not commented on the document. As such, the Municipal Service Review has not been and adopted by Imperial County or approved by LAFCO.

community were found to be deficient and in need of significant repair. The findings are more detailed under the respective section of this Service Area Plan.

Facilities for pedestrians are also found to be non-existent or substandard. Recommended Mitigation involves a closer relationship with the Imperial County Public Works Department and pursuit of funding opportunities through the California Department of Transportation and the Federal Highway Administration.

1.2.2.5 Stormwater and Drainage Facilities Findings

Engineered drainage structures within the Seeley community are virtually non-existent. Minimal curb and gutter exists along County roadways in the community. Stormwater facilities that do exist are limited to recent developments that have included design and construction of on-site retention basins only to accommodate their demand. Runoff discharges naturally flow (overland) towards the New River, but there are no constructed or engineered drainage outlets into the New River. These conditions result in significant flooding throughout the community. These findings are more detailed under the respective section of this Service Area Plan.

1.2.3 Services Provided by Others

This sub-section discusses findings for services not provided by the Seeley County Water District or the County of Imperial. The findings are based on information provided by the Imperial Irrigation District for drainage facilities and the Seeley Elementary School District for education services. Other data for utility services are sourced as referenced.

Solid Waste Service Findings

There is no agency representing Seeley customers under solid waste services. Individual homeowners are under contract with three solid waste facilities: Lucky Tire Inc., CR&R, and Republic Services. This may pose an opportunity for the SCWD to establish a Solid Waste Enterprise and negotiate lower rates for residents and other community benefits such as community clean-up days, scholarship contributions and other community donations as benefitted by other jurisdictions and districts.

Lighting Facilities Findings

Although the street lights are within the County Right-of-Way and thus owned by the County of Imperial, it appears that the SCWD has been responsible for the operation of these facilities. The existing lighting facilities are adequate to serve the community as long as they remain in service. As development occurs, developers will be required to expand lighting facilities into all new development and maintained through Community Facility Districts or Lighting and Maintenance Districts and not be borne to the SCWD. The SCWD had an operating budget of

\$4,200 for existing Street Lights (FY 17/18). Enterprise Funds are restricted from paying for the power service demands, thus mitigation measures to offset these costs are recommended.

School Facilities Findings

The existing Seeley Union School District facilities are adequate to meet the educational needs of the current population. The Seeley Union School District, however, will not be able to meet the expected demand from the projected population growth associated with the planned Sunbeam Lake Estates. It is most likely that the developer will be subject to mitigation in addition to the adopted impact fees.

2.0 **INTRODUCTION**

The Seeley County Water District (SCWD) last updated its Service Area Plan in 2003. Since then the City has experienced moderate growth and interest in new development is increasing. This 2017 Service Area Plan is being updated to provide the SCWD and Seeley Community with a general outlook of anticipated growth and the ability of the SCWD to provide adequate services. This document is designed to provide the District and general public with an overview and introduction of policies regulating this document and an introduction to the SCWD and the community it serves. An executive summary of service findings is presented in order to facilitate review, followed by a detailed discussion of growth projections and phasing of development, existing public service conditions, (including essential services provided by others) and a financing plan for those services under the responsibility of the SCWD.

2.1 **HISTORY OF THE MUNICIPAL SERVICE REVIEW/SERVICE AREA PLAN**

In 1997, Assembly Bill (AB) 1484 established the Commission of Local Governance for the 21st Century. The role of the Commission of Local Governance was to evaluate local government organization and operational issues and develop a statewide vision and determine how the State should grow. The Commission in their final report identified four critical findings, as follows:

- *The future will be shaped by continued phenomenal growth;*
- *California does not have a plan for growth;*
- *Local Government budgets are perennially under siege;*
- *The public is not engaged.*

Within this framework, the Local Governance Commission concluded that Local Agency Formation Commission's (LAFCOs) powers should be expanded and be a participant in regional growth and planning forums. Further, the Local Governance Commission recommended that State law be amended to require that spheres of influence be regularly updated and that LAFCOs initiate periodic regional municipal service reviews, also known as service area plans, to ensure the efficient provision of governmental services. A sphere of influence is defined by law as a "plan for the probable physical boundaries and service area of a local agency, as determined by the commission" (GC 56076).

As a result of the Local Governance Commission's recommendations, on September 26, 2000, Governor Gray Davis signed into law AB 2838, titled the Cortese-Knox-Hertzberg Local Government Reorganization Act. The Cortese-Knox-Hertzberg Act requires each LAFCO to review and update as necessary the spheres of influence for all applicable agencies within each County. In Imperial County, service area plans are recommended to be updated every five years in order to be in compliance (Governor's Office of Planning and Research, LAFCO Municipal Service Review Guidelines, p.10 2003.)

2.2 PURPOSE OF THE SERVICE AREA PLAN

Service area plans are intended to assess current service demand and future service needs within an agency's sphere of influence, and demonstrate that future public facilities, for the provision of services have been identified in accordance with the Cortese-Knox-Hertzberg Act. Service area plans provide each LAFCO with a tool to comprehensively study existing and future public service conditions and to evaluate organizational options for accommodating growth, preventing urban sprawl, preserving open save and prime agricultural lands, and efficiently extending government services. The SCWD 2017 Service Area Plan intends to provide the Imperial County Local Agency Formation Commission with a detailed description and analysis of how facilities will be provided in the proposed sphere of influence.

2.2.1 Requirements of a Service Area Plan

The requirements of the contents of a service area plan are determined by the State's Government Code. Once a service area plan is prepared, it must be reviewed by the local Commission. LAFCO review of public services is in response to the identified need for an orderly and efficient public service structure which will support California's anticipated growth. Per Government Code Section 56430, LAFCO shall prepare a written statement of its determinations with respect to each of the following:

1. *Growth and population projections for the affected area;*
2. *Present and planned capacity of public facilities and adequacy of public services, including infrastructure needs or deficiencies.*
3. *Financial ability of agencies to provide services.*
4. *Status of, and opportunities for, shared facilities.*
5. *Accountability for community service needs, including governmental structure and operational efficiencies.*
6. *Any other matter related to effective or efficient service delivery, as required by commission policy.*

2.2.2 Imperial County Local Agency Formation Commission

The Imperial County Local Agency formation Commission (IC LAFCO) is charged with the review and approval of the SCWD Service Area Plan. The Imperial County LAFCO is comprised of two County Supervisors appointed by the Board of Supervisors, two City Council members appointed by the City Selection Committee and one public member approved by LAFCO, for a total of five members. LAFCO has the authority to review, approve or deny boundary changes, city annexations, consolidations, special district formations, incorporations for cities and special districts, and to establish local spheres of influence.

The Imperial County LAFCO responded to the new mandates of AB 2838 by adopting State Municipal Service Review Guidelines from the Governor's Office of

Planning and Research (OPR) as the Imperial County LAFCO's new Service Area Plan Guidelines. Imperial County LAFCO requires a service area plan be approved prior to approval of a sphere of influence amendment and/or annexation. Imperial County LAFCO must be able to ascertain that there will be sufficient public facilities within the requested sphere of influence or annexation.

2.2.3 Current Status of the SCWD Service Area Plan


The existing SCWD Public Utility District Service Area Plan (SAP) was prepared in 2003 by Nolte Associates, Inc and was approved by the Imperial County LAFCO on July 10, 2003. The 2003 SAP only discusses potable water facilities and services, and wastewater collection facilities and services. A comprehensive discussion of all services is necessary to demonstrate that there will be sufficient public facilities to provide public services within the sphere of influence. The 2003 SAP does not include a discussion of other services provided by SCWD such as administrative facilities, park facilities, and street lights. Facilities and services provided by other agencies such as fire protection, law enforcement, library, circulation (roads), street drainage and education are also excluded from the 2003 SAP. Inclusion of these facilities and services is critical for the orderly growth and development of the community and to ensure any potential service deficiencies are addressed by the corresponding agency.

2.3 BACKGROUND ON SEELEY AND THE SEELEY COUNTY WATER DISTRICT

The Townsite of Seeley is a small community situated west of the City of El Centro approximately 7.5 miles from El Centro. Seeley is an unincorporated community within Imperial County and partially serviced by the County of Imperial and other public agencies, including a school district and public utility districts. The SCWD was formed in 1960 under the Public Utility Act of 1921 for the specific purpose of providing wastewater and water services to the Seeley community. A district is different from a city in that it delivers a limited number of public services to a geographically limited area and does not have police authority.

Geographic Location of the Townsite of Seeley

Seeley is located approximately 10 miles northwest from the U.S./Mexico border and Calexico Port of Entry. (Refer to **Exhibit 2-A – Regional Location Map**). Seeley's developed area covers an approximate 2.37 square miles and is accessed from the

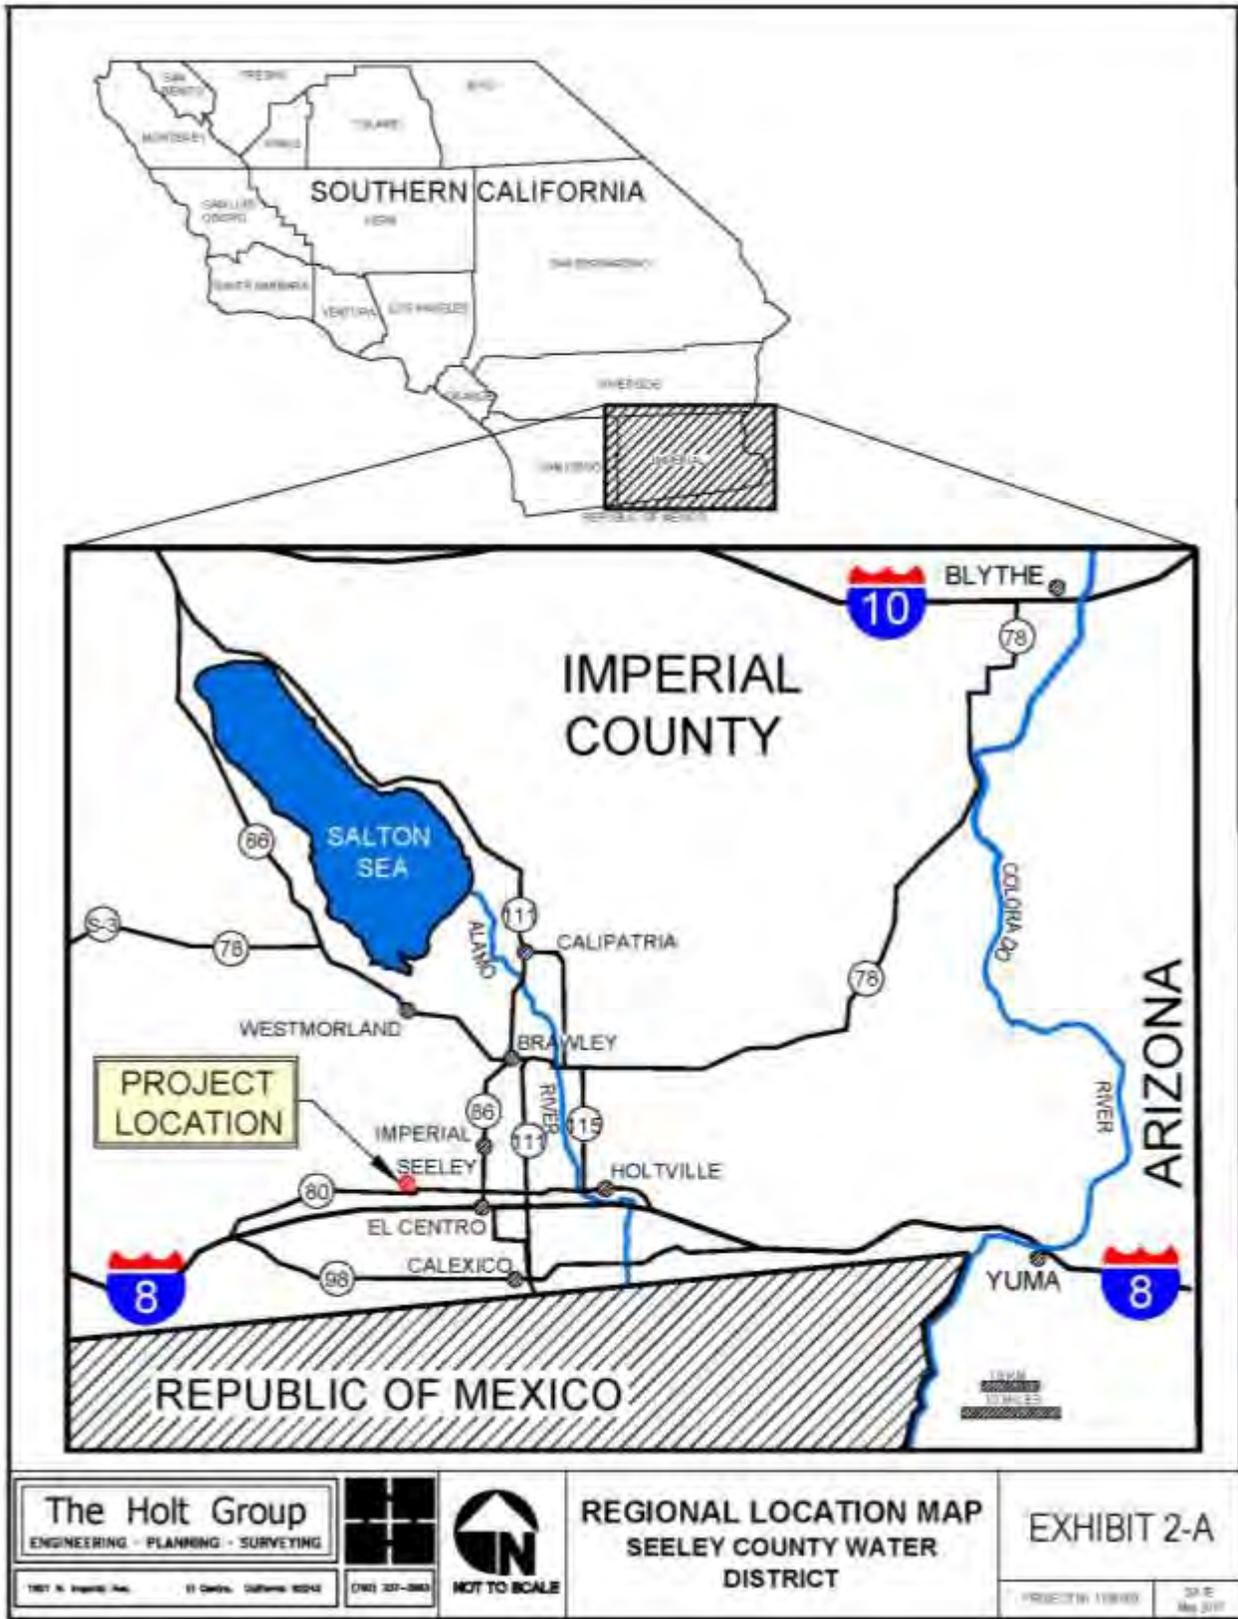

east from Evan Hewes Highway and from the south by Interstate 8 which traverses the community at a west/east orientation. Interstate 8 connects to San Diego located approximately 106 miles to the west of Seeley.

Seeley County Water District

The Seeley County Water District office is located at 1898 Main Street, Seeley, CA 92273 and serves a population of 2,140 and a constituency of 718 persons (Imperial County Elections Office, May 15, 2017)². The Seeley County Water District provides limited public services to the Seeley community consisting of water, wastewater and limited parks and recreation services. The Seeley County Water District consists of a five-member Board of Directors elected by the public. A General Manager reports directly to the Board of Directors and is charged with overseeing the District's operation and employees. The District also has a legal counsel that reports to the Board of Directors. The District currently operates with eight (8) employees and is operating under a \$950,000 budget for the 2017/2018 fiscal year.


Official District Boundary

The legal Seeley County Water District Boundary is uniquely shaped and may be generally described as bound by El Centro Street to the north, extending south to Sunbeam Lake Road, Seeley Drain to the east, and reaching New River Boulevard to the west. (Refer to **Exhibit 2-B – Seeley County Water District Boundary**). The Seeley County Water District boundary was last modified on January 22, 2004 as the LAFCO approved boundary (LAFCO Seeley Service Area Plan, Exhibit 19). No changes to the Service Area boundaries are proposed under this 2017 Service Area Plan Update.

Annexing Land Into The District Boundary

In order for land to be annexed into SCWD's Service Area Boundary, a LAFCO Annexation Application shall be submitted and all applicable LAFCO fees shall be paid. After the Application is deemed complete by LAFCO then analyzes the proposed annexation in light of the commission's State mandated evaluation criteria and responsibilities and its own adopted policies. LAFCO makes a decision on the annexation with or without conditions of approval. According to LAFCO policies, the boundaries of the District may be altered and unincorporated, contiguous or noncontiguous territory of at least 10 privately owned acres lying within three miles of the closest District boundary and may be annexed to the District (Public Utilities Code Sections 17301, 17362).

² Number of Registered Voters within the Seeley County Water District per Imperial County Elections Office May 15, 2017.

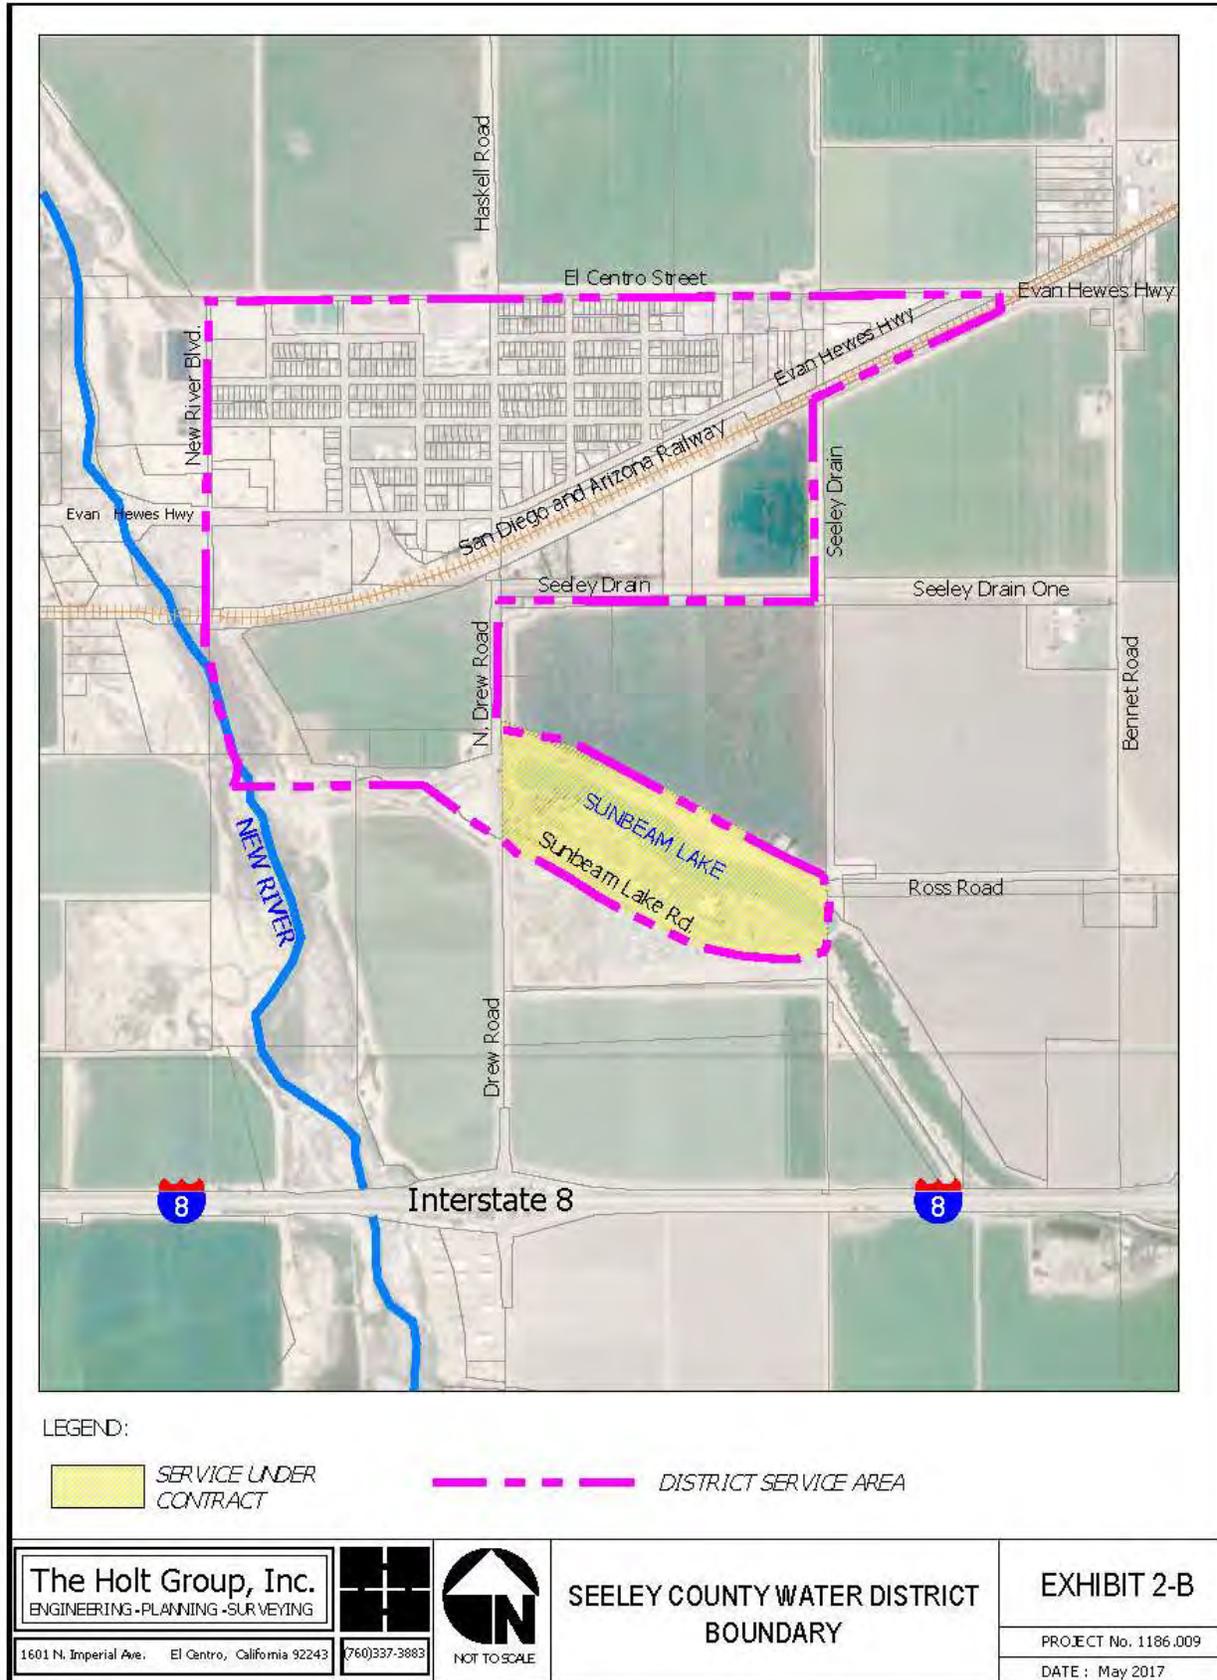

Seeley County Water District Sphere of Influence

The Sphere of Influence for SCWD is a much broader area intended to accommodate future growth. The approved sphere of Influence boundaries are described as El Centro Street to the north, New River to the west, Interstate 8 to the south and Bennet Road to the east (Refer to **Exhibit 2-C – SCWD Sphere of Influence/District Boundary**). Growth within the Sphere of Influence is planned for and taken into account under the Service Area Plan. The delineation of this Sphere of Influence is important to Seeley community leaders because it defines the primary area within which urban development is to be encouraged and limits up to which areas services should be extended to.


Population and Demographics

Although Seeley is a sparsely populated unincorporated community in Imperial County, it has experienced steady growth that averages 2.08 percent between 1990 and 2010. Seeley has a current population estimate of 2,140 (based on residential service connections reported to the State in 2016). The population was calculated based on 606 serviced dwelling units multiplied by 3.53 average number of persons per household according to last US Census taken in 2010.

Seeley is part of the El Centro Metropolitan Statistical Area which has a much larger population base, estimated at 64,489 persons (MSA, American Community Survey, 2015) and is influenced by regional growth. El Centro is located 7.5 miles east of Seeley. Seeley's ideal location to El Centro and approximately one mile north of Interstate 8 connecting to San Diego, make it an ideal community for individuals seeking a quiet rural lifestyle within close proximity to urban employment centers.

Over the last two decades Seeley has experienced significant growth and development. From 1990 to 2000, the Seeley population increased from 1,228 persons to 1,624 persons, or by 32% percent, per the US Census Bureau. From 2000 to 2010, the population increased from 1,624 to 1,739 per the 2000 and 2010 Census. Thus, from 1990-2017, the SCWD Service Area grew by over 60% percent to its current 2,140 population. Over the last decade, over 260 residential building permits were issued for residential construction in the Seeley area, according to Imperial County Building Department records.

Another significant factor contributing to the steady population growth may be attributed to population demographics. Over 88 percent of the Seeley population identifies as Latino (Source: ACS, 2015). Culturally, Latinos tend to share households with extended family members. Seeley's average household size of 3.53 persons per household is slightly higher than to the County's 3.34 persons per household and substantially larger than the State's average at 2.90 persons per household for the same time period (US Census 2010).

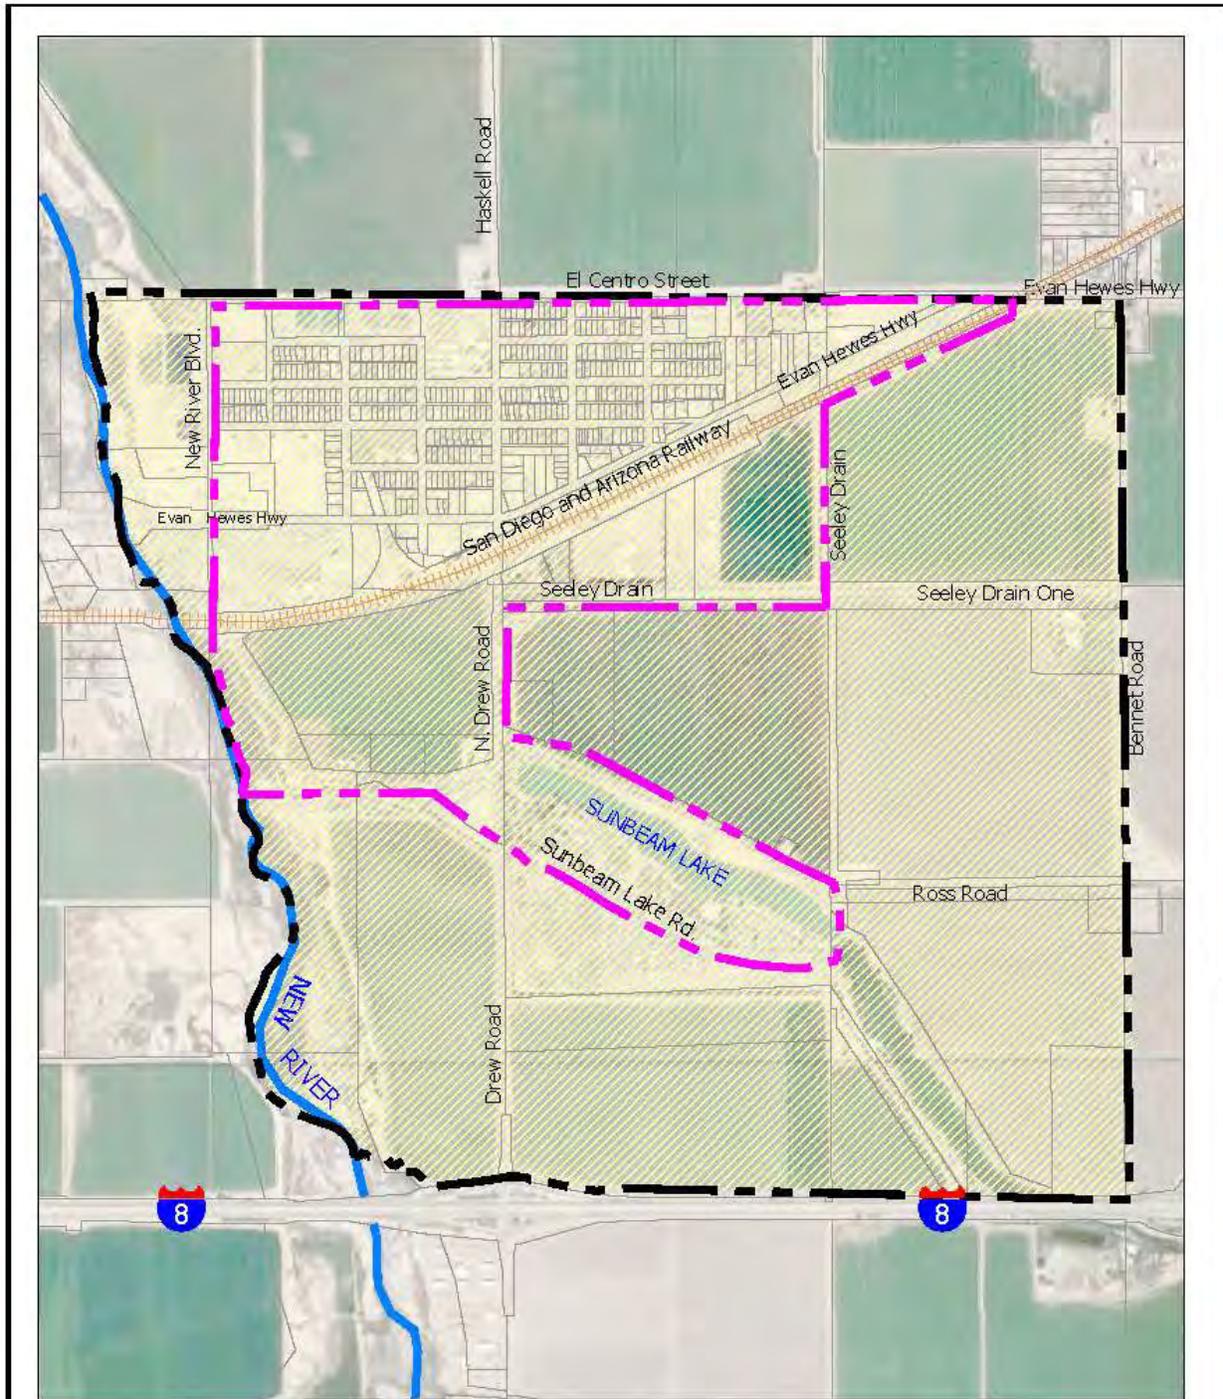

LEGEND:

 DISTRICT BOUNDARY

 SPHERE OF INFLUENCE

The Holt Group, Inc.
ENGINEERING - PLANNING - SURVEYING



SEELEY COUNTY WATER DISTRICT
SOI/DISTRICT BOUNDARY

EXHIBIT 2-C

1601 N. Imperial Ave. El Centro, California 92243

(760)337-3883


NOT TO SCALE

PROJECT No. 1186.009

DATE : May 2017

These population statistics are important in determining what the service needs of the population are and how to project service demand when the same growth factors are applied. **Figure 2-A- Seeley Population Growth** provides the historic population from 1990 to present.

Figure 2-A

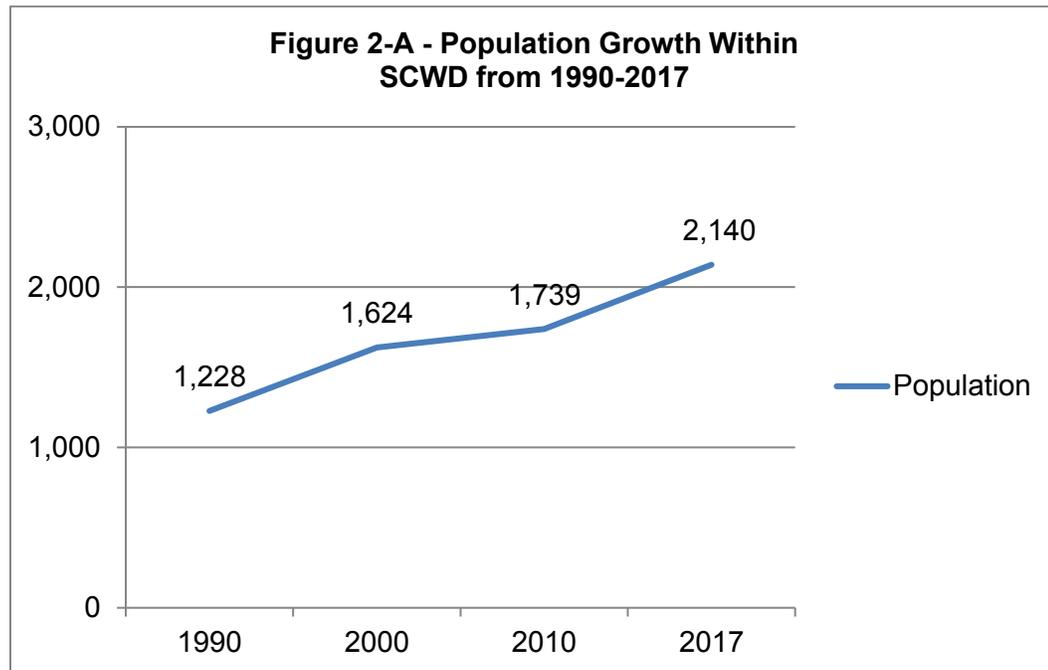

Source: US Census Bureau for Population 1990, 2000, 2010
Year 2017 estimates based Service Connection Data and 3.53 persons per household in June 2017.

2.4 PUBLIC FACILITIES AND SERVICES PROVIDED

The Seeley County Water District provides a limited amount of services including wastewater collection and treatment services, potable water treatment and distribution services, limited park and recreation services and the corresponding administrative services to residents within the District’s service area. Given that Seeley is located within an unincorporated area of Imperial County, all other public services including law enforcement, fire protection, and roadway maintenance are provided by Imperial County. Additional public service purveyors currently providing services within the SCWD service area include the Seeley Union School District, Central Union School District, and the Imperial Irrigation District. The Seeley County Water District works closely with the respective entities to ensure that all public services are adequately provided for new development.

2.5 GENERAL OUTLOOK ON POPULATION GROWTH

As previously noted, the Seeley County Water District service area has experienced significant residential growth over the last couple of decades. There is an equally vibrant population outlook associated with new development planned within SCWD Sphere of Influence. SCWD's service area, and thus potential growth areas, are comprised of relatively large tracts of vacant, low-priced land that is attractive to residential developers. Seeley is also bordered by Interstate 8 which is a Highway that has an Annual Average Daily Traffic of 15,800 vehicles at Drew Road (Source: Caltrans 2015 Traffic Counts). Highway access makes Seeley an attractive location for residential, commercial, and industrial development. As an example, there is currently interest in developing two major residential sites and to expand the Sunbeam Lake RV Resort to Sunbeam Lake Estates and build 403 single family residences along the lake and multi-family development to the southeast (Source: LAFCO 2005 District Annexation Application). These developments are expected to significantly contribute to the future growth and demand of SCWD services. At the time of the preparation of the Service Area Plan it was estimated that SCWD could have a population base of over 5,000 residents by the year 2035 if all planned development comes into fruition. These figures and projections highlight the importance of SCWD planning services to adequately serve the projected population. Population trends and projections are further discussed under **Section 3 Growth and Phasing Projections** of this Service Area Plan.

2.6 ORGANIZATION OF THE SERVICE AREA PLAN AND CONTENTS

The intent of the Service Area Plan is to demonstrate the District's ability to provide adequate services within the sphere of influence boundaries in the event of new development with the District Boundaries or new annexation into the District Boundaries. An approximate 20-year planning period is used to forecast growth and the estimated facility and service demands are based on population projections in five-year increments until 2035.

This Service Area Plan discusses the services currently provided by the Seeley Water County District, estimates the current and future demand for such facilities and services, and describes how necessary facilities and services will be or may be developed or improved on to meet population demands. Additionally, this Service Area Plan discusses services purveyed by Imperial County and their adequacy based on demand in a matter that satisfies the Guidelines adopted by Imperial County's LAFCO. These issues are organized into the following six sections, as briefly discussed in the introduction and elaborated below.

Section 1.0 – Executive Summary: Provides a brief summary of the Service Area Plan for the Seeley Water County District and highlights critical information regarding performance standards, existing facilities, demand, mitigation, funding sources, annual budget and cost per capita.

Section 2.0 – Introduction: Provides a brief description of the Seeley townsite and the Seeley Water County District as well as the general characteristics of the Service Area Plan.

Section 3.0 – Growth and Projections: Provides a discussion on existing and planned land uses in the District and the District’s Sphere of Influence and describes potential impacts associated with population growth and projected service demand.

Section 4.0 – Buildout Phasing Projections: Provides a discussion on buildout phasing projections within the 20-year planning period.

Section 5.0 – Public Services: Provides a thorough description of current and planned facilities and services, and its current and projected adequacy. An analysis and assessment of public services provided by the District, Imperial County, and any other service purveyor will be addressed. The following facilities and services are reviewed: Administrative Facilities, Wastewater Treatment and Collection Sewer Facilities, Water Treatment and Distribution Facilities, Parks and Recreation Facilities, Fire Facilities, Law Enforcement Facilities, Library Facilities, Transportation Facilities, Stormwater Facilities and School Facilities as well as other utility purveyors in summary.

Section 6.0 – Mitigation & Financing Plan: Identifies and discusses existing and potential sources of revenue and financing mechanisms for public facilities and services available to the District. In addition, this section would identify cost saving opportunities for the District.

3.0 GROWTH AND PHASING PROJECTIONS

It is the intent of the Seeley County Water District to plan for growth via the orderly development of areas within the SCWD Sphere of Influence. Growth is influenced by location, land use restrictions, existing conditions, and availability of services. Orderly development is accomplished through planned improvements, phasing of service expansions and phasing of development projects. This Section of the Service Area Plan identifies the existing and planned land uses in the Seeley community, the intricate development process, and the anticipated population growth which are all critical factors on how the SCWD will service the community.

3.1 EXISTING LAND USE

Although the District's service area has shown modest growth in the last decade, it is small in comparison to nearby Cities. For example, the City of El Centro and its sphere of influence area is about 16,000 acres of land (El Centro Service Area Plan, 2016). The City of Imperial and its sphere of influence area is 7,507 acres (Imperial Service Area Plan, 2015). Whereas, the SCWD and its sphere of influence area is only approximately 1,520 acres.


It is important to underscore Seeley's uniqueness as a townsite. The townsite of Seeley is located within an unincorporated area of Imperial County; therefore, it is not a City and does not dictate land use and zoning policies. Rather, the Seeley County Water District works closely with Imperial County to ensure orderly planned development. Existing land uses within the District include residential, commercial and light industrial. There are also over 196 acres of Government/Special Public land use tied to the Sunbeam Lake recreational area. There is also an operational railroad which bisects the town in a west/east orientation.

3.1.1 General Plan Land Use Policy


The Seeley community and service area land uses are regulated by Imperial County. Imperial County adopted Seeley's Urban Area Map which provides a more in depth view of the Seeley County Water District's land use designation and was last revised in 2007. Designated land uses include a variety of land use designations including: low density residential, medium density residential, high density residential, general commercial, government/special public, and light industrial (Refer to **Exhibit 3-A – Seeley Urban Area Map**).

3.1.2 Zoning

Zoning within the Seeley County Water District is regulated by Imperial County. The District area has been assigned several zoning designations. The District is best characterized by the preponderance of zoning designations for residential development at various densities which include, R1 (low density residential),

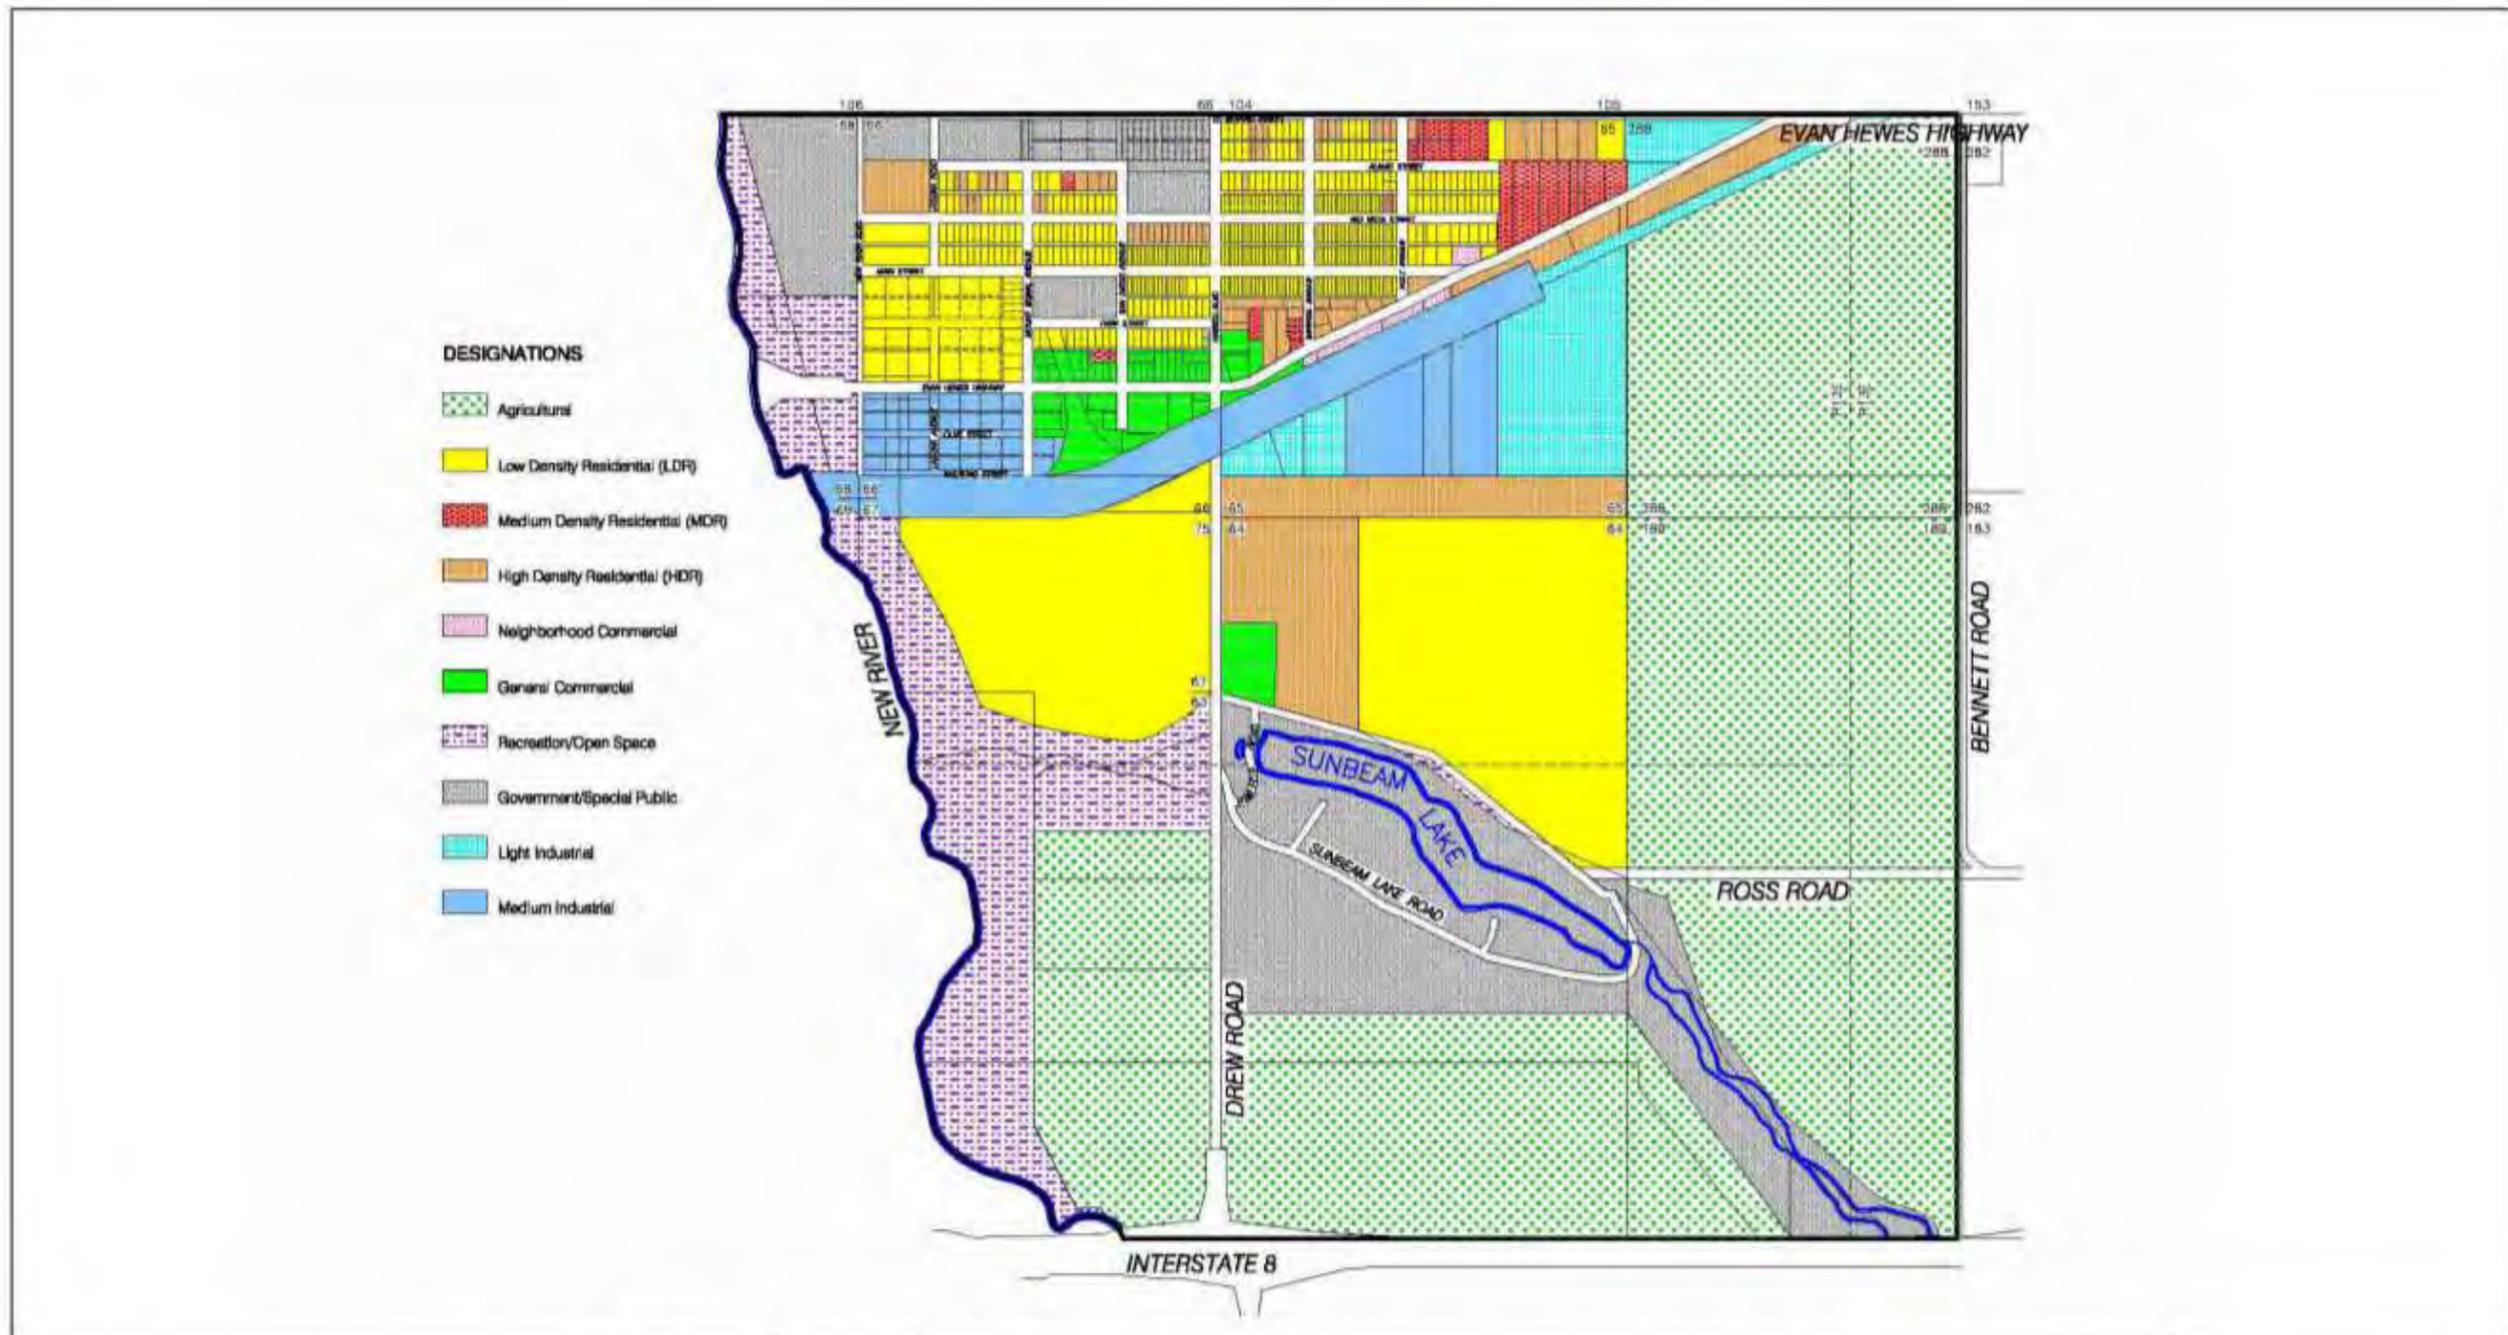

| | | | | | | |
|---|---------------------|------------------|--|--|----------------------------|--------------------|
| <p>The Holt Group, Inc. ENGINEERING PLANNING SURVEYING</p> | | NOT TO SCALE | <p>SEELEY URBAN AREA MAP IMPERIAL COUNTY LAND USE ELEMENT Adopted October 25, 1994</p> | <p>EXHIBIT 3-A</p> | | |
| <p>1601 NORTH IMPERIAL AVENUE EL CENTRO, CALIFORNIA 92243</p> | <p>760-337-3883</p> | | | <table style="width: 100%; border: none;"> <tr> <td style="border: none; padding: 2px;">PROJECT NO THG 1196.009</td> <td style="border: none; padding: 2px;">DATE April 2017</td> </tr> </table> | PROJECT NO THG 1196.009 | DATE April 2017 |
| PROJECT NO THG 1196.009 | DATE April 2017 | | | | | |

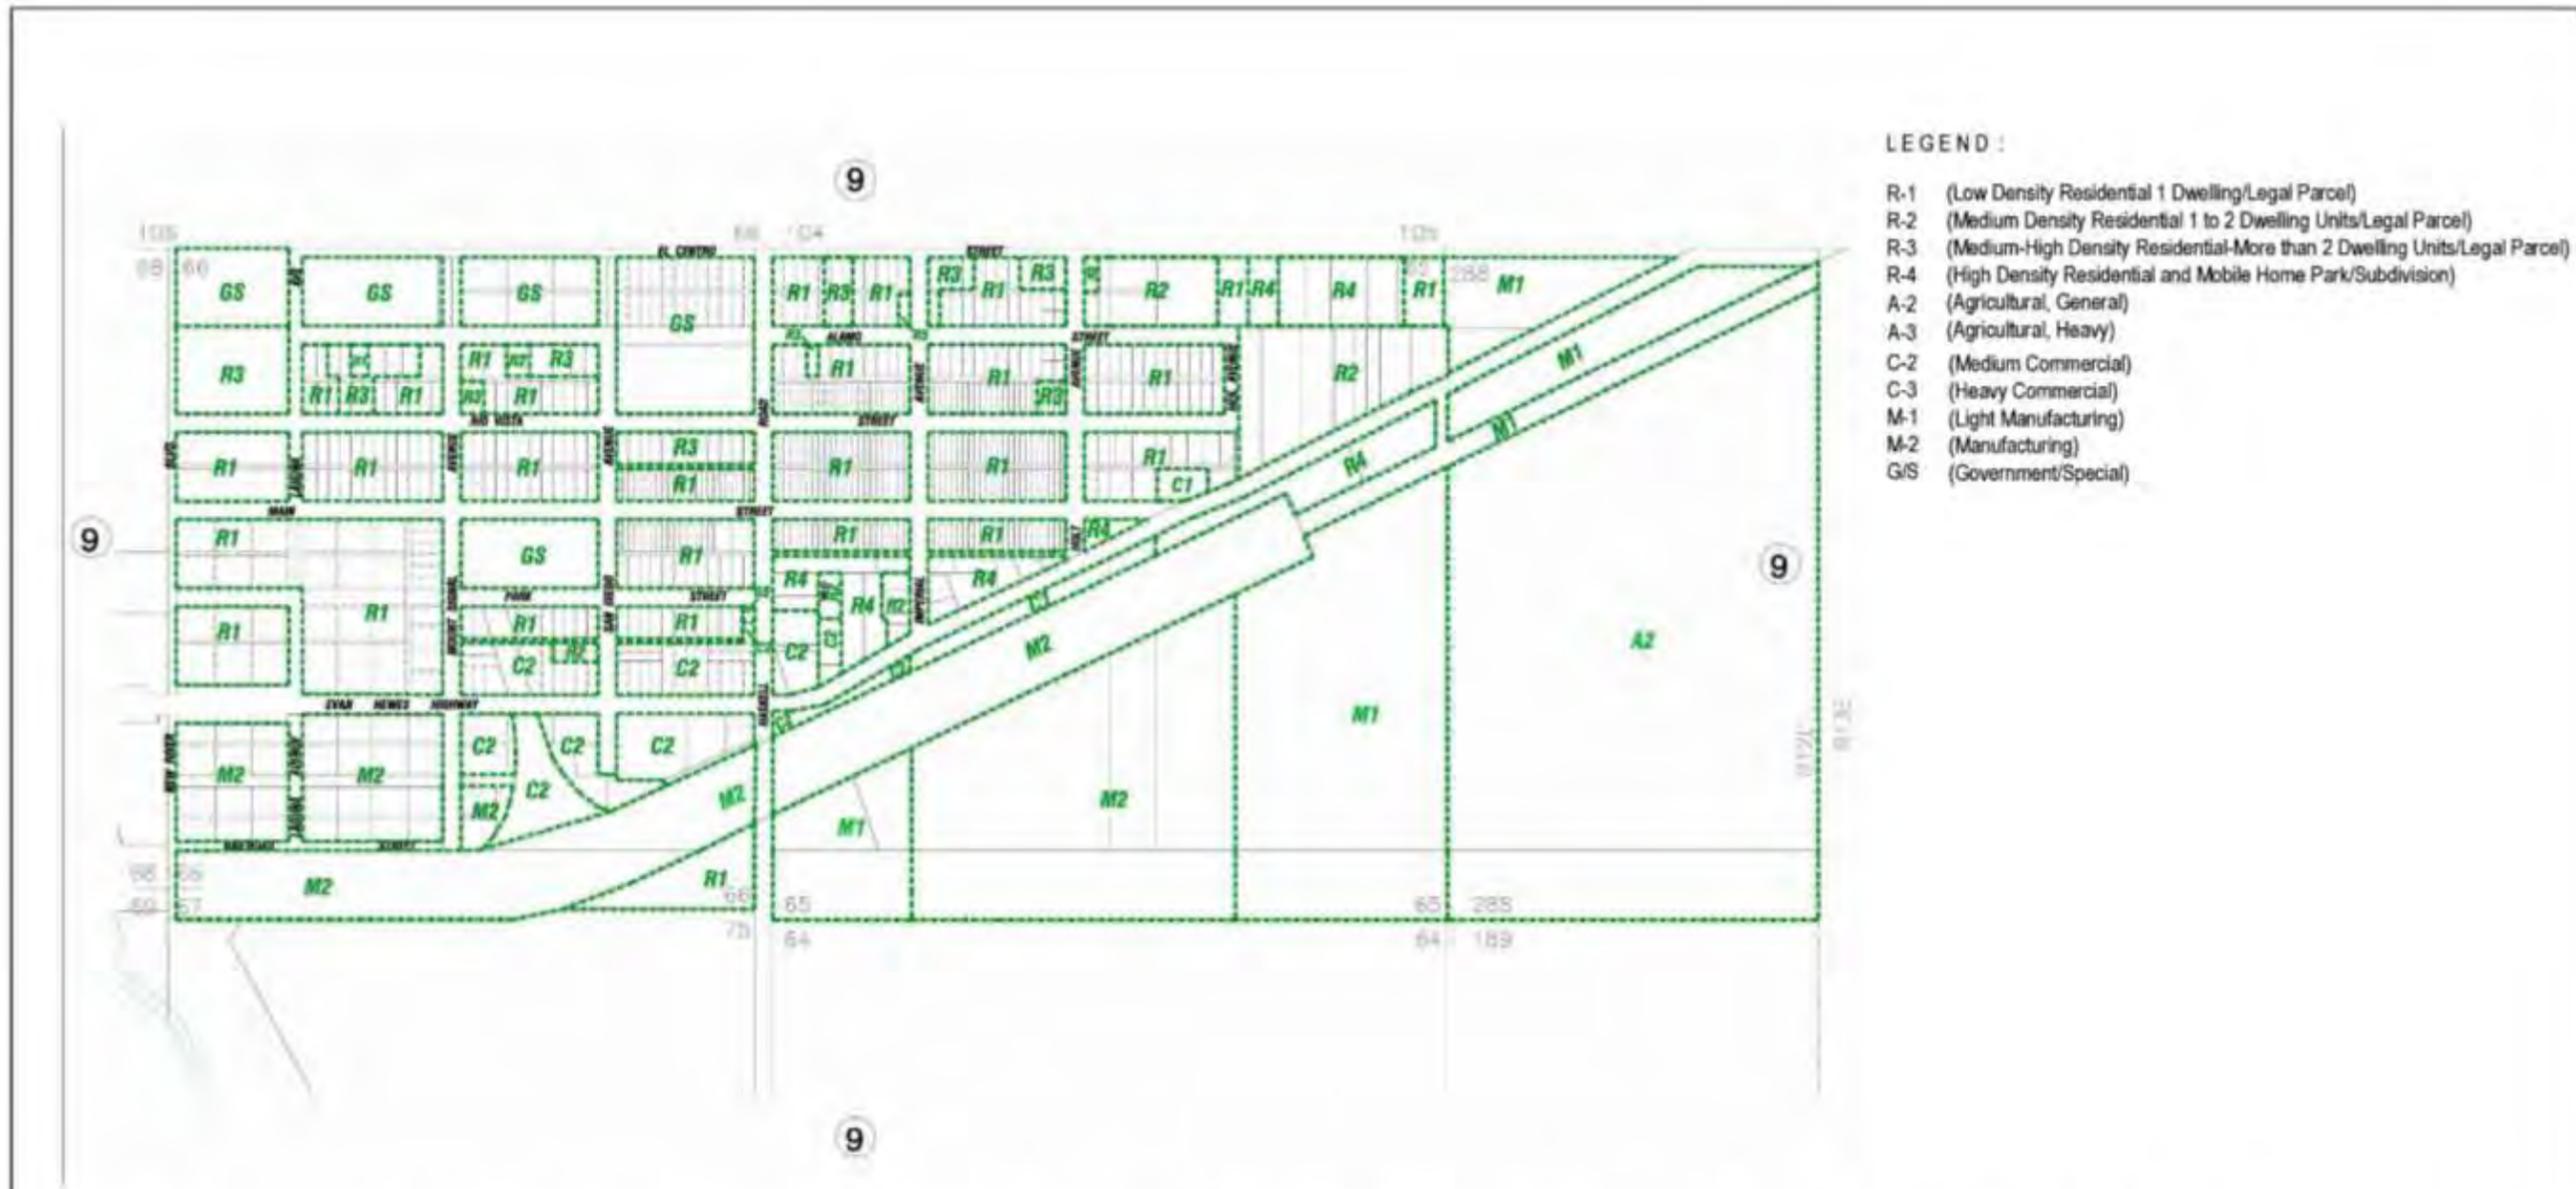

| | | | | | | |
|---|--|---|---|--|----------------------------|------------------|
| <p>The Holt Group, Inc. ENGINEERING PLANNING SURVEYING</p> |  |  NOT TO SCALE | <p>TOWNSITE OF SEELEY ZONING MAP IMPERIAL COUNTY Adopted May 26, 1998</p> | <p>EXHIBIT 3-B</p> | | |
| <p>1801 NORTH IMPERIAL AVENUE EL CENTRO, CALIFORNIA 92243</p> | <p>760-337-3883</p> | | | <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 50%; padding: 2px;">PROJECT NO THG 1186.009</td> <td style="width: 50%; padding: 2px;">DATE May 2017</td> </tr> </table> | PROJECT NO THG 1186.009 | DATE May 2017 |
| PROJECT NO THG 1186.009 | DATE May 2017 | | | | | |

R2 (medium density residential), R3 (medium to high density residential), and R4 (high density residential and mobile home parks). Generally, the land that abuts the railroad is zoned High Density Residential and Medium to High Industrial. Along Evan Hewes Highway various blocks are designated for General Commercial and Neighborhood Commercial. There are also several areas designated as recreational open space, providing a buffer along the New River (Refer to **Exhibit 3-B Zoning Map**).

3.2 PLANNED LAND USES


Within the established County Water District Sphere of Influence, there is ample opportunity for land development. Over 100 acres are vacant and undeveloped in addition to the approximate 119 acres already currently planned for development. The existing sphere of influence boundaries are El Centro Street to the north, Interstate 8 to the south, the New River to the west, and Bennet Road to the east as illustrated under **Exhibit 3-C – Seeley County Water District Sphere of Influence**.

As previously noted, land use within the Seeley County Water District is governed by Imperial County's Zoning Ordinance which is guided by the goals and policies established under Imperial County's General Plan. It is important to underscore that the Seeley County Water District does not have land use authority and works closely with Imperial County regarding new development proposals and service considerations to insure planned land uses are consistent with one another.

A project known as the Sunbeam Lake Estates was recently approved by the County of Imperial and LAFCO for development within SCWD's Sphere of Influence. The project can move forward for construction once improvement bonds are accepted by the County of Imperial. Sunbeam Lake Estates will result in the construction of 403 single family homes and approximately 312 multi-family apartment units (calculated based on maximum density allowed by County Code and the total acreages shown on Tentative Map #958). A total of 16.95 acres of commercial land is also designated for development. Refer to **Exhibit 3-C – Planned Development Within Seeley County Water District's Service Area** which delineates the Sunbeam Lake Specific Plan Area.

3.2.1 Development Process

The process of development varies depending on the location of the proposed commercial, industrial or residential development proposed. When a developer wants to develop land within the District Limits, land use restrictions are already in place and discretionary approval of the project is not necessarily required by the Imperial County Board of Supervisors as long as all development standards are met for the respective land uses. The SCWD reviews any offsite water and sewer facility extensions and proposed connection to services. The SCWD also collects impact fees (capacity fees) for water and sewer services. The District provides services to all development within the District limits.

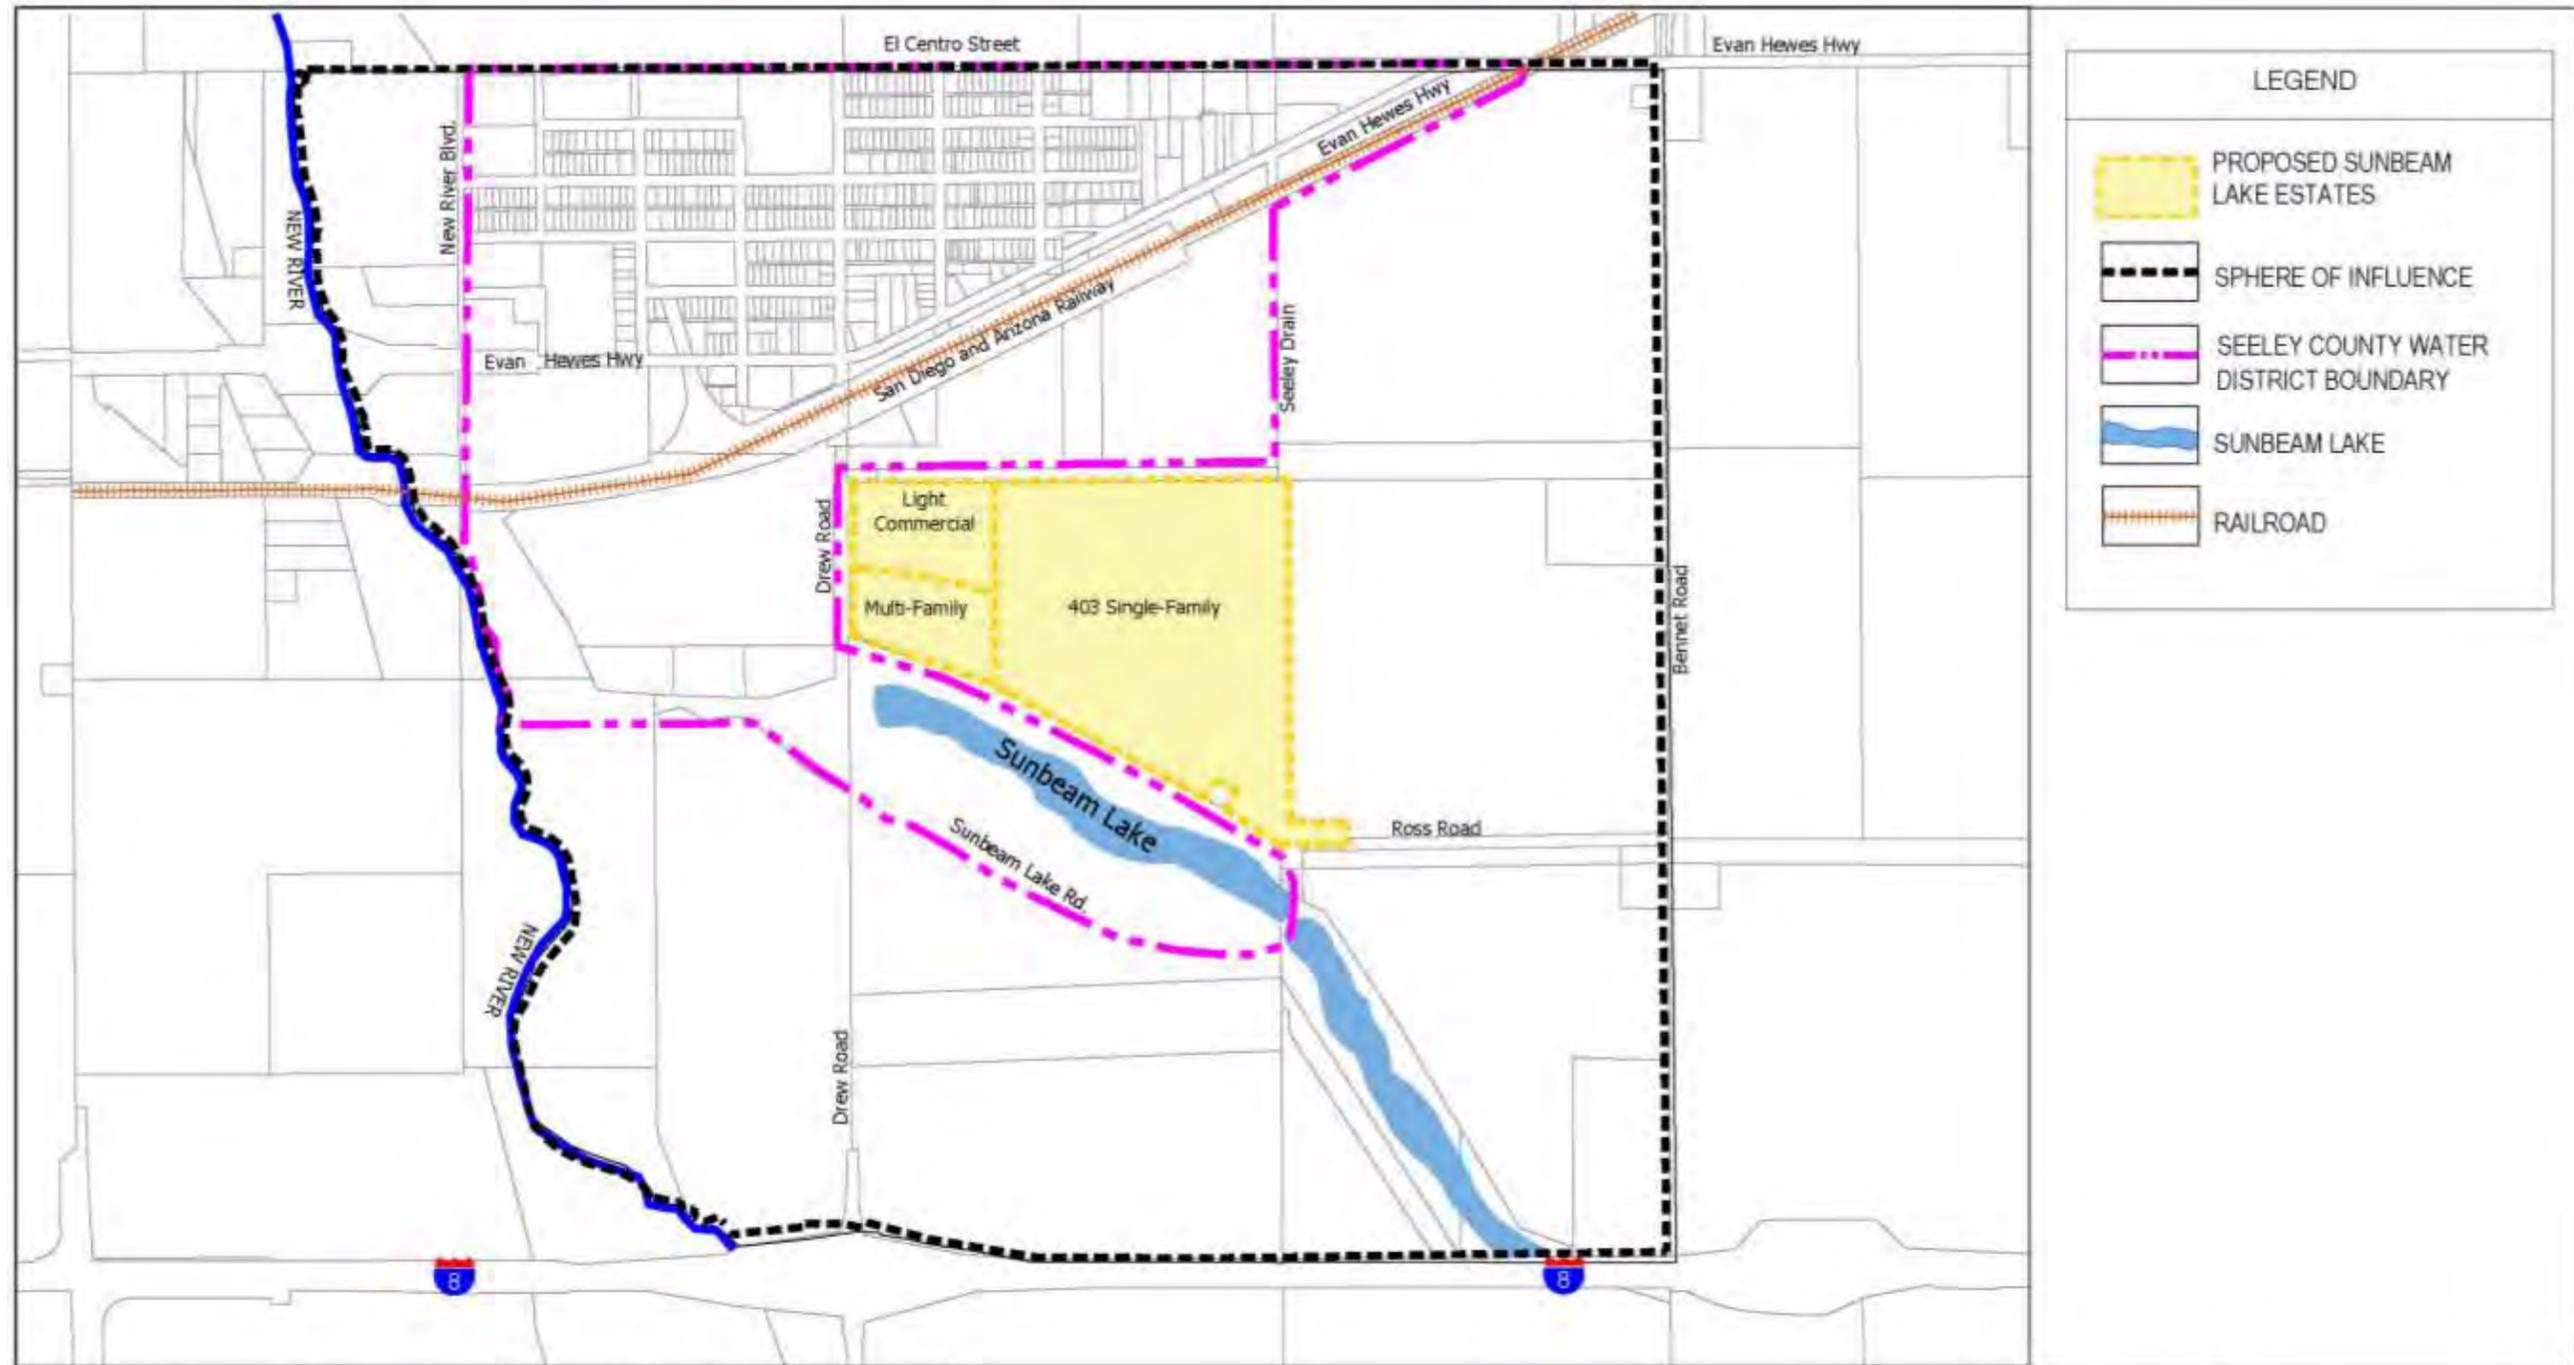

| | | | | | | |
|---|---------------------|------------------|--|---|----------------------------|-------------------|
| <p>The Holt Group, Inc. • ENGINEERING • PLANNING • SURVEYING</p> | | NOT TO SCALE | <p>PLANNED DEVELOPMENT WITHIN SEELEY COUNTY SERVICE AREA</p> | <p>EXHIBIT 3-C</p> | | |
| <p>1801 NORTH IMPERIAL AVENUE EL CENTRO, CALIFORNIA 92243</p> | <p>760-337-3883</p> | | | <table border="1"> <tr> <td>PROJECT NO THG 1185.009</td> <td>DATE June 2017</td> </tr> </table> | PROJECT NO THG 1185.009 | DATE June 2017 |
| PROJECT NO THG 1185.009 | DATE June 2017 | | | | | |

The District, however, has discretionary authority in providing services to development projects outside its boundaries. As part of its discretionary authority, the District can require certain conditions of approval such as annexation into SCWD.

All building permits requested, within and outside of the District boundaries are processed by the Imperial County Building Department. When an applicant requests a building permit, they are required to complete an application as well as a site plan. The Imperial County Building Department is responsible for ensuring that all requests are completed in compliance with the International Building Code and applicable County codes.

Imperial County further imposes Development Impact Fees (DIF) for all development within the District and the District's Sphere of Influence. Development Impact Fees vary by land and a detailed table is available under **Appendix A**. DIF are used to offset regional impacts to roadways, law enforcement facilities, and similar municipal service facilities caused by the development. A more detailed discussion is under the Financing Section of this Service Area Plan.

All developers within Seeley's Sphere of Influence must work closely with the District and the Imperial County. Additional permits may be needed through the Imperial Irrigation District who owns or holds drainage and power easements throughout the Imperial Valley. In summary, when developing in Seeley and its Sphere of Influence, developers will need to work with multiple agencies.

3.3 PROJECTED POPULATION INCREASE

Population projections are difficult to ascertain because they are influenced by outside factors including the real estate market, employment opportunities, and fluidity of migration. Although projections are difficult to predict, they are necessary and critical for District planning to ensure that infrastructure is adequate and that levels of service are acceptable.

Anticipated Projects Within the SCWD Sphere of Influence

Population projections can be completed based on the number of anticipated projects and their proposed densities. As of the date of this Service Area Plan, one Specific Plan had been submitted to LAFCO and to Imperial County for development but has not secured any building permits. As previously noted, the project is comprised of 403 single family units. Multifamily and commercial development is proposed but will be developed as market demands increase. Based on current absorption rates throughout the County, it is estimated that 50 new homes will be built and occupied per year starting in 2019. Once all single-family homes are constructed, multi-family homes will follow at a rate of approximately 80 dwelling units per year. Direct impacts from Sunbeam Lake Estates is accounted for under this Service Area Plan projections. Table 3-A below provides a

summary of the proposed development. It should be noted that the developer of Sunbeam Lake Estates initially intends to build the single-family residential component of the project and no specific numbers were provided for multi-family development. For the purposes of this Service Area Plan to anticipate the needs of future population, the maximum density allowed by the County of Imperial was used to estimate the number of apartment units that can be built and the potential population resulting from those units.

Table 3-A
Specific Plan & Development Phasing

| Subdivision | Proposed Land Uses | Equivalent Dwelling Units | Potential Population | Year |
|----------------------|--------------------|---------------------------|----------------------|------|
| Sunbeam Lake Estates | Single Family | 403 | 1,423 | 2025 |
| | Multi-Family | 312 | 1,102 | 2030 |
| | Commercial | 15 | 53 | 2050 |

Imperial County TTM #958 Planning Department Records

Non-residential uses are converted to equivalent dwelling units (EDUs) to ensure an equitable and comprehensive analysis. Due to the low amount of non-residential usage within the SCWD, statistical average would be skewed if actual data were to be applied. Instead, a survey of local service providers was conducted to determine an average demand corresponding to 1.5 EDU's for every 1,000 square feet of non-residential space. A total of 16.95 acres of land is dedicated for commercial development which result in a total building area of 295,336 square feet based on 40% lot coverage. Due to the low population and traffic, commercial development is expected to occur at a rate of approximately 5,000 square feet every five years with full buildout occurring well beyond the scope of this Service Area Plan. Table 3-A above projects the corresponding conversion into equivalent dwelling units (1.5 EDU's per every 1,000 SF of nonresidential space).


Current Population and Projection for the Next 20 Years

The population projections that follow are based on historic population growth rates and anticipated projects. For the Seeley population projections, a growth rate of 2.08 percent has been determined as adequate based on historic growth. According to Imperial County's Municipal Service Review (2011), the average annual growth rate over the last

40-year period for the countywide population is 2.28 percent.³ This growth rate is comparable to the historic growth calculated for the Seeley community of 2.08 percent between 1990 and 2010 and will be applied to the entire twenty (20) year planning period analyzed under this Service Area Plan. Planned development as noted in prior discussions may significantly alter these population growth projections and are therefore discussed as probable scenarios affecting service demand.

From 2000 to 2010, the number of housing units rose 27.7 percent in Imperial County.⁴ The Seeley County Water District Service Area had a base population of 2014 as of 2017 as calculated by dwelling unit service connections and an average household size of 3.53 (ACS). **Figure 3-A – Historic Population Growth Within Seeley County Water District** (from 1990-2017) documents a steady growth to 2,140 residents by 2017, representing a 3.29 percent growth between 2010 and 2017 seven-year period.

Figure 3-A
Historic Population Growth within SCWD

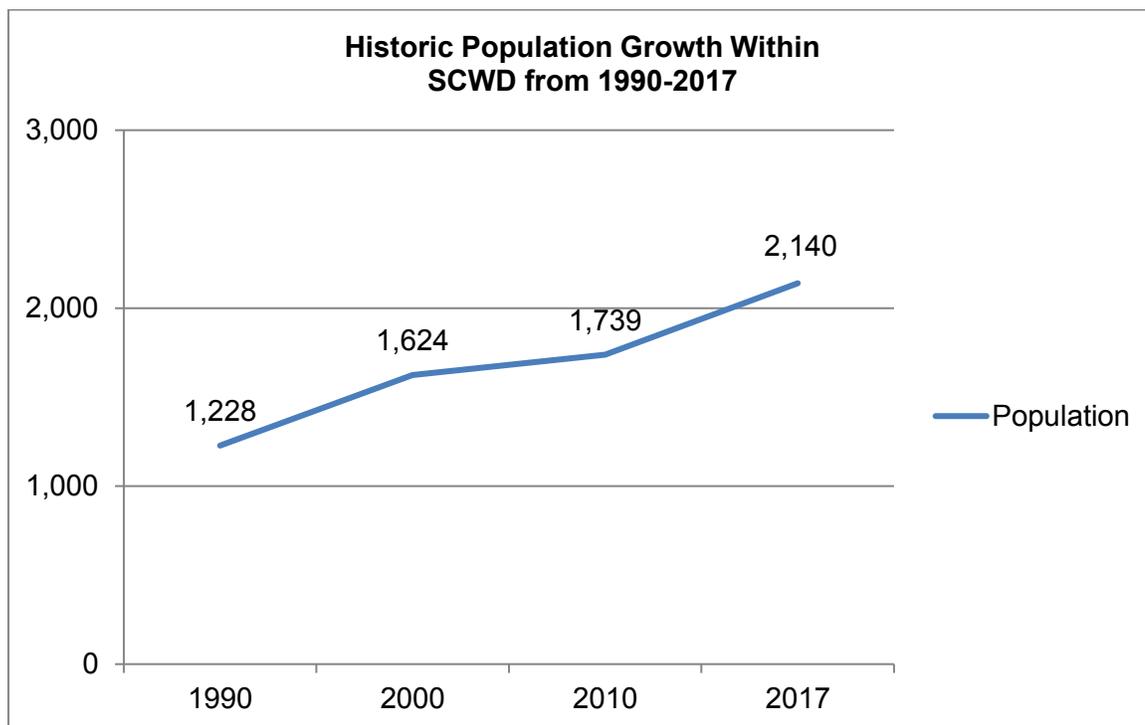

Source: US Census Bureau for Population 1990, 2000, 2010
Year 2017 estimates based Service Connection Data and 3.53 persons per household in June 2017.

³ Imperial County Municipal Service Review, 2011 p. 6.

⁴ Semuels, Alana. *Los Angeles Times* March 9, 2011. <http://latimesblogs.latimes.com/money_co/2011/03/census-california-housing.html> .

The Seeley County Water District’s population grew in equal or higher percentages than most other rural areas in Imperial County when compared with small communities under 10,000 residents. Seeley surpassed all the incorporated communities except for the City of Imperial. This is significant as it identifies the Seeley Community as a competitive and attractive development community for investors. Please refer to Table 3-B for Population Growth Comparisons.

**Table 3-B
Population Growth Comparison**


| Jurisdiction | 2010 | 2017 | Numeric Change | Percentage Change | Average Annual Growth Rate |
|--|--------------|--------------|----------------|-------------------|----------------------------|
| Imperial | 14,758 | 18,658 | 3,900 | 26.43% | 3.78% |
| SCWD | 1,739 | 2,140 | 401 | 23.06% | 3.29% |
| Brawley | 24,953 | 26,928 | 1,975 | 7.91% | 1.13% |
| El Centro | 42,598 | 45,628 | 3,030 | 7.11% | 1.02% |
| Calexico | 38,572 | 40,921 | 2,349 | 6.09% | 0.87% |
| Holtville | 5,939 | 6,255 | 316 | 5.32% | 0.76% |
| Westmorland | 2,225 | 2,302 | 77 | 3.46% | 0.49% |
| Calipatria ¹ | 7,705 | 7,555 | -150 | -1.95% | -0.28% |
| Balance of Unincorporated Areas in Imperial County | 36,039 | 37,947 | 1,908 | 5.29% | .76% |

Source: 2000 U.S. Census and State of California, Department of Finance 2017

¹Includes an institutionalized (prison) population of approximately 3,536 persons as of May 2017.

The future anticipated population growth within the existing District boundaries and service area is expected to be modest. **Figure 3-B – Population Projections for the Seeley County Water District Service Area** depicts a gradual population growth of 2.08 percent that would reasonably place the Seeley County Water District service population at 3,380 at the 20 year mark. If there are changes in the real estate market and the region development demand increases, the District will likely be directly impacted by new growth and expansion outside of the current District boundary within the Sphere of Influence. If and when the planned and approved development (Sunbeam Lake Estates) is developed and incorporated into the population projections, the District population spikes to by the 20 year mark.

Figure 3-B
Population Projections within SCWD Service Area

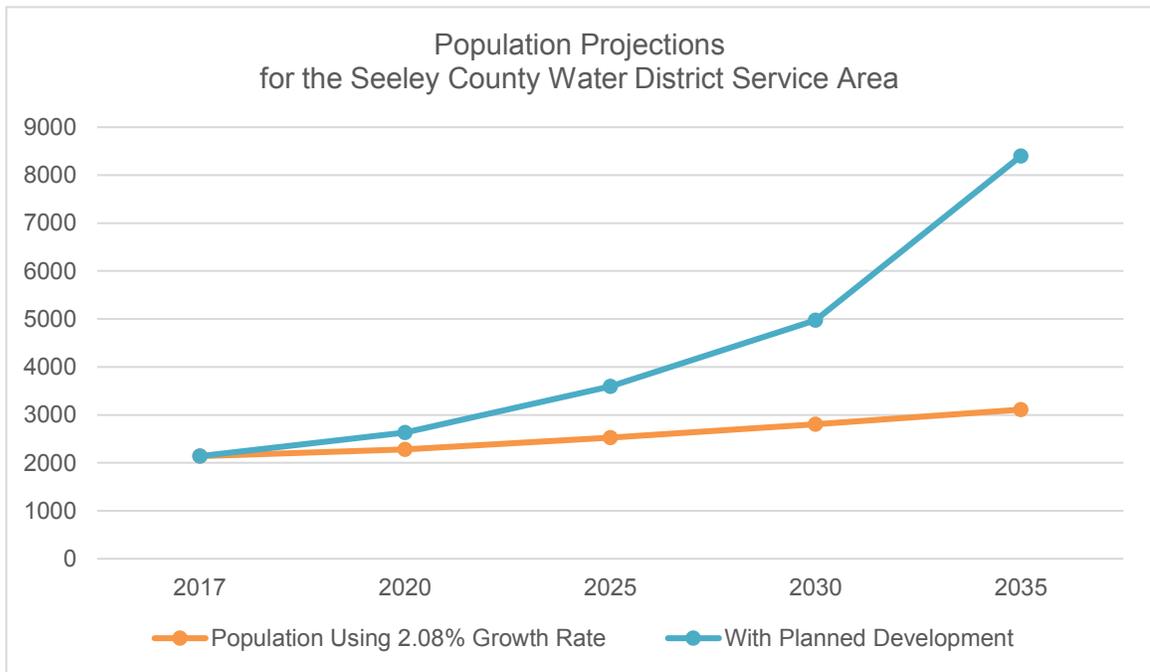

4.0 **BUILDOUT PHASING PROJECTIONS**

A significant task for District management and leadership is to plan for service facilities concurrently with the projected population growth and to do so in a proactive manner. The phasing of new facilities must be coordinated with the phasing of new development in order to adequately meet the projected service demand, while other infill development opportunities exist throughout several zoning densities and designations within the District. Please refer **Table 4-A – Available Undeveloped Land Within Seeley County Water District** below which includes a list of undeveloped land within the Seeley County Water District and acreage by zoning designation.

**Table 4-A
Available Undeveloped Land Within Seeley County Water District**

| Zoning | Acreage |
|---|---------|
| R-1 Low Density Residential | 73.95 |
| R-2 Medium Density Residential | .96 |
| R-3 Medium-High Density Residential | 5.37 |
| R-4 High Density Residential & Mobile Home Park | 4.58 |
| A-2 Agricultural, General | 0 |
| C-1 Light Commercial | 2.46 |
| C-2 Medium Commercial | 6.06 |
| M-1 Light Manufacturing | 5.58 |
| M-2 Manufacturing | 6.62 |
| G/S Government/Special | 3.85 |

Source: The Holt Group, Inc.2017

The District has much potential for residential development within its District boundaries. It is difficult to project how infill may be phased out over time, but for planning purposes, a reasonable estimate is based on county-wide residential new-construction absorption rates and historical development rates within the District. Seeley’s developable parcels can result in a maximum 536 dwelling units which could be built out over a 20-year period at a rate of approximately 26 new dwelling units per year. **Table 4-B – Potential Developable Units per Residential Zone** is a summary of the potential number of dwelling units per zone based on the allowed density for each zone.

**Table 4-B
Potential Developable Units per Residential Zone**

| Zone | Total Acres | Allowable Density | Potential Developable Units |
|-------------------------------------|---------------|-------------------|-----------------------------|
| R1 | 73.95 | 5 units/Net Acre | 369Units |
| R2 | .96 | 10 units/Net Acre | 9 Units |
| R3 | 5.37 | 29 units/Net Acre | 155 Units |
| R4 | 4.58 (3 lots) | 1 unit/ legal lot | 3 Units |
| Total Maximum Dwelling Units | | | 536 units |

Source: The Holt Group, Inc. 2017

Population Projections at Full Build-Out

A steady job growth within the Seeley County Water District service area could certainly entice new developers to construct housing near a regional park and recreation center, contributing to the growth of the Seeley County Water District service area. There are over 84 developable acres available for new residential development in varying densities within close proximity to SCWD service facilities.

As stated earlier, Sunbeam Lake Estates consists of 715 dwelling units and all potential infill development can result in an additional 536 dwelling units. New residential development will add an estimated 1,255 new residents. With the natural growth rate of 2.08%, Seeley can have an estimate population of 3,828 at full buildout in 20 years. This represents a 56% increase over the current population.

Another potential contributor to indirect population growth is the El Centro Naval Air Facility Base. Expansion of the Navy Base is contingent upon mission changes assigned by the Navy Headquarters not at the discretion of the local Navy Base. There are currently no plans for expansion. Currently the Navy Base provides over 1,267 long-term jobs for the region (Source: Naval Air Facility El Centro Range Complex Area: Military Readiness, Economic Contribution and Community Partnerships).

5.0 PUBLIC FACILITIES AND SERVICES

This section addresses how public facilities and services will be provided to the Seeley County Water District and development areas over the course of the 20-year planning period. An analysis of the following facilities and services is provided in this document:

- Administrative Facilities - SCWD
- Wastewater Facilities- SCWD
- Water Facilities- SCWD
- Park Facilities- SCWD/Imperial County
- Transportation Facilities- Imperial County
- Drainage Facilities - Imperial County/Imperial Irrigation District
- Fire Protection Facilities - Imperial County
- Police Protection - Imperial County
- Library Facilities - Imperial County

Each facility is analyzed in detail based on the standards developed by LAFCO for Service Area Plans. Each facility analysis is divided into four sections as follows:

Performance Standard: A description of the desired level of service that a public facility must provide.

Facility Planning and Adequacy Analysis: A description of the existing facilities, the current adequacy of the facilities, the future demand for facilities and the phasing of the demand for facilities as follows:

- Inventory of Existing Facilities
- Adequacy of Existing Facilities
- Inventory of Approved Facilities
- Growth Demand for Facilities
- Buildout/Phasing of Facilities

Mitigation: A series of recommendations to ensure that adequate facilities will be provided for throughout the planning period.

Financing: An explanation and identification of how the service and facilities are currently being funded, including a per capita cost, and how future services and facilities may be funded.

Findings are presented under the respective service provider as noted above. Each analysis is subsequently presented by facility sections and will provide a description of the nature of each service to be provided, a description of the service level capacity and demonstrate that adequate services will be provided within the demanded time frame. Presentations of maps that clearly indicate the location of existing and proposed facilities are provided for each facility. Discussion of any conditions which may be imposed or required within the affected territory are also noted.

5.1 SERVICES PROVIDED BY THE SEELEY COUNTY WATER DISTRICT

The Seeley County Water District, as a special district, provides a limited amount of services that include wastewater collection and treatment services, potable water treatment and distribution services, incidental administrative services and limited parks and recreation services to residents within the District's service area. This section also provides a cursory review for all other services provided by other agencies. Facilities planned for and financed by the District for services provided by the Seeley County Water District are described below and a full analysis is provided under this Service Area Plan Section.

- **Administrative Facilities-** Administrative facilities include buildings that house administrative staff that provide general administrative services to Seeley residents and business owners. Examples of administrative services include utility billing and collection, services to the Board of Directors, and other functions of the District.
- **Wastewater Treatment and Sewer Facilities-** Wastewater treatment and sewer facilities include the District's Wastewater Treatment Plant and the sewer collection system that collects and conveys the wastewater to the Wastewater Treatment Plant. Wastewater Facilities also includes sewer lift stations owned by the Seeley County Water District.
- **Water Treatment and Distribution Facilities-** Water treatment and distribution facilities include the District's Water Treatment Plant and the distribution pipelines that convey potable water to residences within the Seeley County Water District Service Area. Water facilities may further include any water transmission lines and pump systems necessary for the adequate conveyance of water, water storage tanks and fire hydrants.
- **Parks and Recreation Facilities-** Parks and recreation facilities include open space areas, both improved and unimproved for recreational use, owned and operated by the District. Facility amenities within the parks may include swings, slides, and shade structures for the use of the public. Only those park facilities owned by the Seeley County Water District are applicable under this discussion or that are contracted by Seeley County Water District for the provision of services.

5.1.1 Administrative Facilities

Administrative services for the Seeley community are provided in part by the Seeley County Water District Water Enterprise Fund and Sewer Enterprise Fund. The Seeley County Water District provides administrative services for the community of Seeley incidental to wastewater collection and treatment, water treatment and distribution and parks and recreation services. Additionally, Imperial County provides a number of administrative services to the Seeley community and the general countywide population including but not limited to planning and development services, street maintenance and other governmental services.


Performance Standard for Administrative Facilities

Imperial County's performance standard for administrative facilities in unincorporated areas is 1,030 square feet per 1,000 population (Source: County of Imperial Municipal Service Review Draft #3, 2011). The performance standard for administrative facilities under this analysis is based on existing administrative square footage at the time of preparation of the service area plan for facilities maintained and operated by the Seeley County Water District. Current management finds the current 1,059 square-foot building somewhat inadequate and unable to accommodate operations and staff for the natural population growth over the 20-year planning period. This finding is further consistent with the County ratio of 1,030 square feet per 1,000 in population. At the end of the planning period, the population of Seeley is anticipated to be 2,696, therefore if the performance standard is set at 1,030 square feet per 1,000 persons for the facility serving the Seeley community, the current 2,140 population would demand a 2,000 SF facility.

Inventory of Existing Administrative Facilities

The Seeley County Water District owns a 1,059 square-foot building at 1898 Main Street, Seeley, CA 92273. The building was constructed in 1966 and is appears to be in sound condition. The SCWD Board meets in a 513 square-foot space within the building, and the rest of the building is comprised of a 221 square-foot administrative office, and 277 square-foot operator office (**Refer to Exhibit 5-A**). Maintenance costs are shared between the Sewer Enterprise Fund and Water Enterprise Fund. According to the SCWD operation budget, administrative expenses are not tracked independently for the office building. Expenses such as utilities and building maintenance are simply allocated to either wastewater or sewer costs.

There are no local administrative offices maintained by Imperial County in the Seeley community. All planning and development services, and building services are housed out of the Imperial County Planning and Development Services office located at 801 Main Street in El Centro.

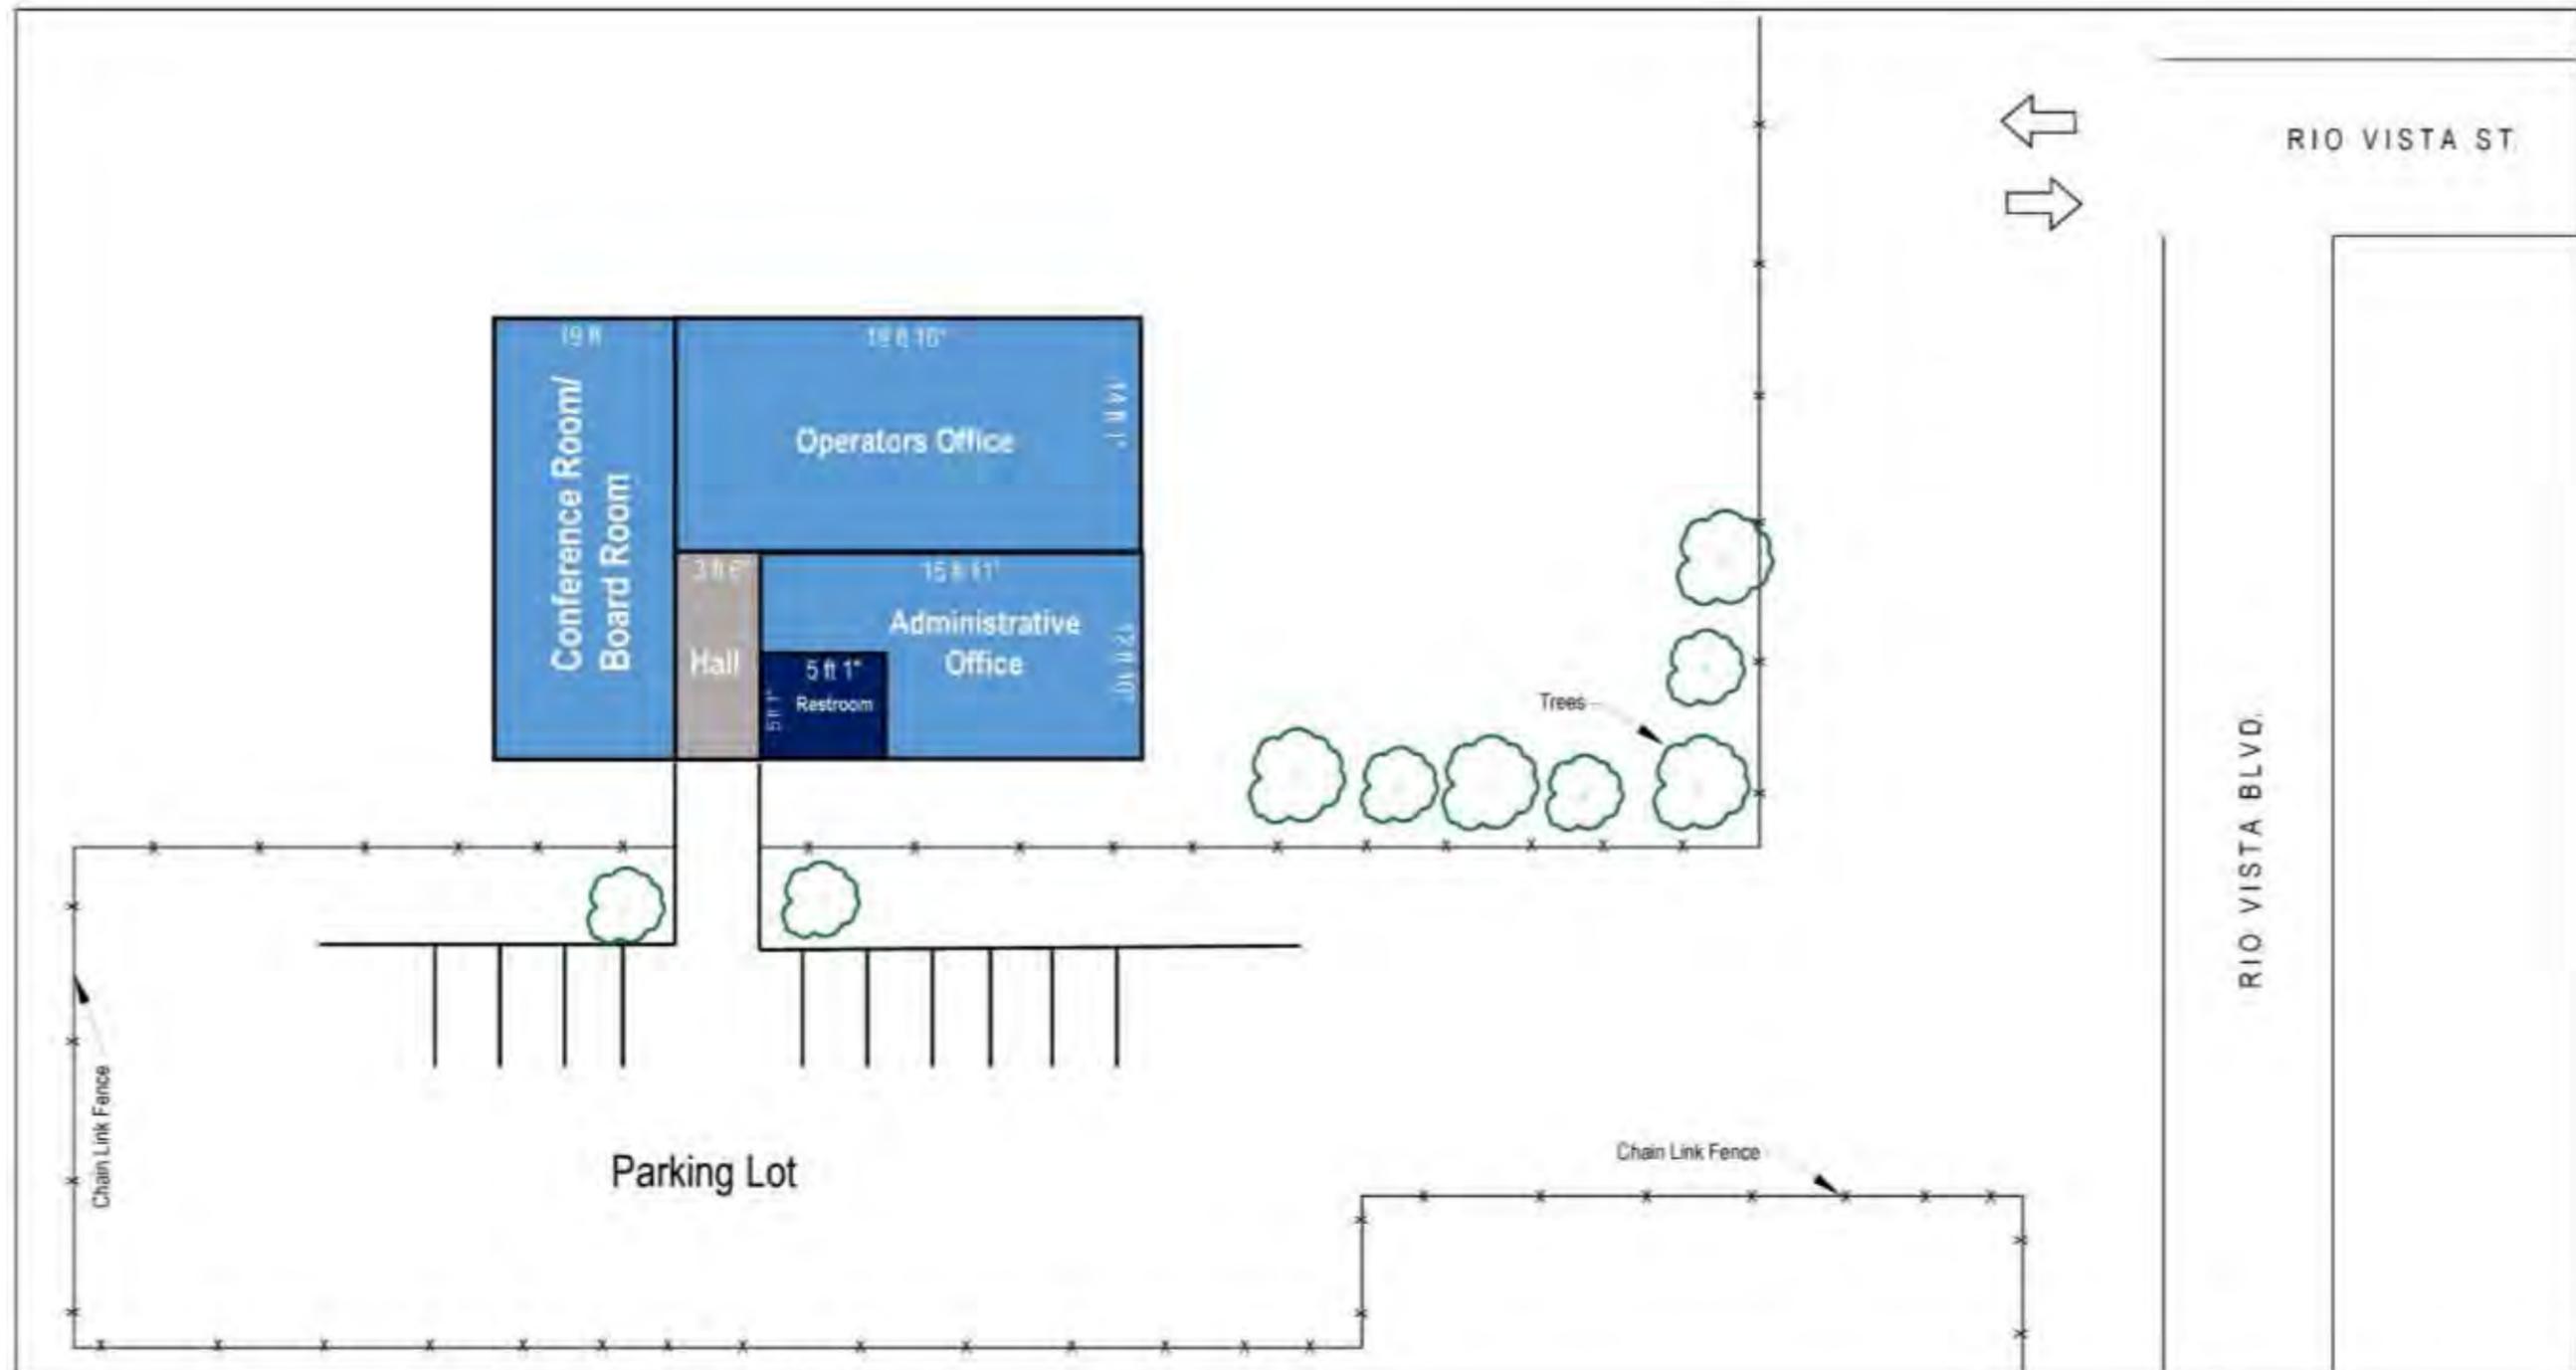

| | | | | |
|--|---------------------|---------------------|--|--------------------|
| <p>The Holt Group, Inc. -ENGINEERING -PLANNING -SURVEYING</p> | | <p>NOT TO SCALE</p> | <p>LAYOUT OF THE SEELEY COUNTY WATER DISTRICT SERVICE BUILDING</p> | <p>EXHIBIT 5-A</p> |
| <p>1601 NORTH IMPERIAL AVENUE EL CENTRO, CALIFORNIA 92243</p> | <p>760-337-3883</p> | | | |

Adequacy of Administrative Facilities

The Administrative Building is fifty-five years old and its size is insufficient to meet the needs of current staff and operations. The size of the existing facility would further be restricted from adequately serving the natural growth population during the planning period. Administrative staff and operators are in need of a larger work area that can either be accommodated by adding onto the current building or relocating to a new site.

The Seeley County Water District hired National Property Inspections to perform a site evaluation of the current administration and operations building. There were a number of typical repair needs noted due to normal wear and tear due to the age of the structure. One area of immediate need is to upgrade the electrical panel which is currently rated at 225 amps. While this is normally sufficient for a 1,030 square-foot office building, it appears that the panel is providing service to ancillary wastewater treatment plant operations exceeding the panel's capacity. An electrical disconnect for the electric water heaters was also noted.

Plumbing services also appear to be deficient due to age and general deterioration of cast iron pipes, albeit operable. The restroom facilities don't currently comply with the American with Disability Act standards.

Inventory of Approved Administrative Facilities

There are no approved administrative facilities at the time this Service Area Plan was prepared. However, given the condition of the existing administrative facilities, the Seeley County Water District is in the preliminary stages of discussing alternatives for improvements and relocation. It is anticipated that there will be a capital demand for administrative facilities during the 20-year planning period.

Buildout Demand for Administrative Facilities

A substantial increase in population will undoubtedly result in an increased demand for public services and the administration of the same. At full buildout of planned and infill development, Seeley's population will grow to 9,212 and at a ratio of 1,030 square feet of administrative office space per 1,000 residents, the administrative building will need to be at least 2,775 by the end of the planning period. A 9,490 square-foot building is required to service the full buildout population.

An administrative and operations building, built under traditional construction terms can range in cost from \$150 SF to \$240 SF. A premanufactured metal structure may cost \$160 SF to \$275 SF. A 2,775 SF building can therefore range between \$416,250 and \$763,125 for construction costs. An additional 14% would be needed for design and bidding services and 10% for construction management. The total amount the SCWD should budget for is between \$516,150 and \$946,275.

Opportunity for Shared Administrative Facilities

As previously stated, the SCWD Administrative office is shared between the two enterprise funds. The facility is not large enough to be shared with any other service providers. There may be an opportunity to share future facilities with the Imperial County Fire Department. These opportunities will be explored during the planning phases.

Phasing of Administrative Facilities

The District will consider designing the administrative facility in phases to be able to accommodate a 20-year planning period and ultimately accommodate the demand at build-out population.

Mitigation for Administrative Facilities

The Seeley Administrative Facilities are undersized and in need of moderate repair due to age of structure. A new facility will need to be planned for to continue to serve the anticipated population increase throughout a twenty (20) year planning term. Mitigation is recommended during this planning period. It is recommended that administrative expenses be budgeted and tracked separately in the future and then costs be equally shared between the sewer and water enterprise funds. It is also recommended that administrative fees be imposed to developers that require coordination of development plan review. The following are the recommendations for Administrative Facilities and Services:

- A-1** Establish an Administrative Budget that includes office equipment, supplies, utilities, building repairs, etc.
- A-2** Consider Adopting an Administrative Fee of 15% from developers above plan check review costs due to consultants. District policy would collect actual consultant cost + a 15% administrative fee.
- A-3** Determine a design concept, budget and funding resources for the future development of an Administration and Operations Building.

5.1.2 Wastewater Treatment Plant and Sewer Collection Facilities

The Seeley County Water District owns, operates and maintains a Wastewater Treatment System which provides wastewater collection and treatment services to the Seeley community, and areas immediately outside of the District boundary, but within the Sphere of Influence. The wastewater treatment plant (WWTP) is located at 1898 West Main Street in Seeley, California. The existing wastewater treatment plant is currently situated on a 31 acre parcel but only 14 acres of the site is usable for existing operations and future expansion because the rest of the parcel is part of the New River bank. The treatment plant has a maximum permitted capacity of 0.25 million gallons per day (MGD).

The wastewater treatment plant services an area of approximately 2.26 square miles and a population of 2,140 residents. The Wastewater Treatment Plant was constructed in 1965 and there have been numerous upgrades to the facility completed over the years. The most recent improvements were completed in 2014 and 2016 consisting of the conversion of an abandoned lagoon to a primary oxidation pond and installation of an additional secondary treatment filter and an additional in-line UV unit for effluent disinfection. No major expansions have been initiated and the plant operates at an influent average of 0.11 MGD; 45 percent capacity as of 2017.

Performance Standards for WWTP Plant and Sewer Collection Facilities

Wastewater Treatment Plant- The Performance standards and requirements for the Seeley Wastewater Treatment Plant are governed by the National Pollution Discharge Elimination System (NPDES) discharge permit number CA 0105023 and Board Order Number R7-2012-0011 adopted by the California Regional Water Quality Control Board, Colorado River Basin Region. The NPDES permit under which the Seeley Wastewater Treatment Plant operates expires on September 30, 2017. The NPDES permit establishes the Waste Discharge Requirements (WDR's) for the wastewater treatment plant. The NPDES permit establishes the rated capacity of the wastewater plant, discharge prohibitions, effluent limitations and discharge specifications, receiving water limitations, standard provisions for the operation of the wastewater treatment plant, monitoring and reporting program requirements, compliance requirements and special provisions. The NPDES discharge permit also establishes the standards and criteria by which the Seeley Wastewater Treatment Plant operates.

Sewer Collection System- The Seeley County Water District utilizes standards established by the United States Environmental Protection Agency (EPA), State Water Resources Control Board's Regional Water Quality Control Board, the Water Environment Federation (WEF) and American Water Works Association

(AWWA) to establish performance standards and criteria for the wastewater collection system.

Design capacity of a pipeline is the general calculated capacity of the pipeline using the Manning formula. For system analysis, peak dry weather flow (PDWF) does not exceed 75 percent of the design capacity of the pipeline. Accordingly, 25 percent of the pipeline capacity is reserved to accommodate peak wet weather flow (PWWF) incurred during wet weather conditions. The 25 percent reserve is therefore provided to account for groundwater infiltration and rainfall dependent inflow, plus additional sewer capacity reserve allowance. This 25 percent reserve contingency factor is a commonly used allowance in evaluating wastewater utilities. The following are general design criteria for determining sanitary sewer pipeline capacity:

**Table 5-A
Wastewater Pipeline General Design Criteria**

| Pipeline Size | Flow Capacity |
|-----------------|----------------------|
| 8" to 10" | 1/2 Full @ Peak Flow |
| 12" to 18" | 2/3 Full @ Peak Flow |
| 21" and Greater | 3/4 Full @ Peak Flow |

Gravity pipelines should also have a general peak flow velocity of 2.0 feet per second (fps) at peak wet weather flow (PWWF) to ensure adequate flow. Pipelines that cannot reach this minimum flow velocity should be assisted with pump stations. Pump station adequacy is based on two criteria: 1) the ability of the pump station to pump the PWWF and 2) wet well adequacy for pump cycling. The Seeley County Water District incorporates one privately owned and operated lift station into its collection system.

Inventory of Existing WWTP and Sewer Collection Facilities

Wastewater Treatment Plant- The existing wastewater treatment plant consists of one influent lift station with (2) constant speed submersible pumps rated at 140 gpm each. The influent pump station then pumps the influent wastewater to an aerated pond. There is currently (1) one aerated pond in operation and (1) one aerated pond in standby. The (2) two ponds were originally constructed as percolation and evaporation basins each with a volume capacity of 4,000,000 gallons.

The aeration basin effluent flows by gravity to a series of five smaller aeration basins, where solid settling occurs, also referred to as Clemson Ponds. Each Clemson pond has a volume capacity of approximately 97,000 gallons.


Wastewater from the Clemson ponds enters a secondary pump station that pumps wastewater through a 6-inch diameter force main to one or a combination of three pressure filters (sand media). The secondary pump station consists of (2) pumps rated at 140 gpm. Two of the sand media filters have a rated design treatment capacity of 140 gpm each. A third sand media filter, which was recently installed, has a rated design treatment capacity of 220 gpm.

Wastewater from the filters then gravity flows through one of two ultraviolet disinfection system units for disinfection. One UV disinfection unit has a treatment capacity of 170 gpm. The second UV disinfection unit was recently installed and is rated at 170 gpm. Treated effluent flows into a land outfall which then transports the effluent to the point of discharge into a tributary creek (Wildcat Drain) of the New River.

The existing wastewater treatment plant has a design capacity of 250,000 GPD and an average daily flow of about 120,000 GPD. According to John Kemp, consultant chief wastewater operator, the addition of the Clemson pond and ultraviolet disinfection have altered the original hydraulic and treatment capabilities of the system. A Wastewater Master Plan should be performed to determine the plants true capacity due to new regulations and modifications through the years.

A portion of the Seeley County Water District's Office Building is located on the wastewater treatment plant. A portion of the Office Building is used for operations of the wastewater treatment plant. The existing WWTP has two (2) separate electrical service panels: 1) Operations/Office Building and a portion of wastewater treatment facilities and 2) the wastewater treatment facilities. Only one of the power services, which only provide power to wastewater facilities, is supported with a backup system. No large-scale improvements have been accomplished at the WWTP since 2016. Please refer to **Exhibit 5-B Existing WWTP Design & Flow**.

Sewer Collection System- The SCWD owns over 5.4 miles (approx. 28,730 lineal feet) of sanitary sewer collection pipelines. The wastewater collection has a network of pipelines ranging in size from 6-inch to 12-inch in diameter. Most of the pipelines are predominantly located north of Evan Hewes and the Southern Pacific Railroad. There was a project completed circa 2008 that constructed a combination of force main and gravity flow sewer pipeline from the Sunbeam Lake RV Park along Drew Road to a point connecting with the existing WWTP collection system at manhole located at Mount Signal Avenue and Main Street. The existing wastewater collection system is composed of sanitary sewer gravity pipelines and sanitary sewer force mains. There is a sewer pump station that is privately owned and discharged into the sewer collection system. The collection system conveys wastewater from the residential, commercial, industrial, institutional, government, school and church developments to the Seeley County Water District Wastewater

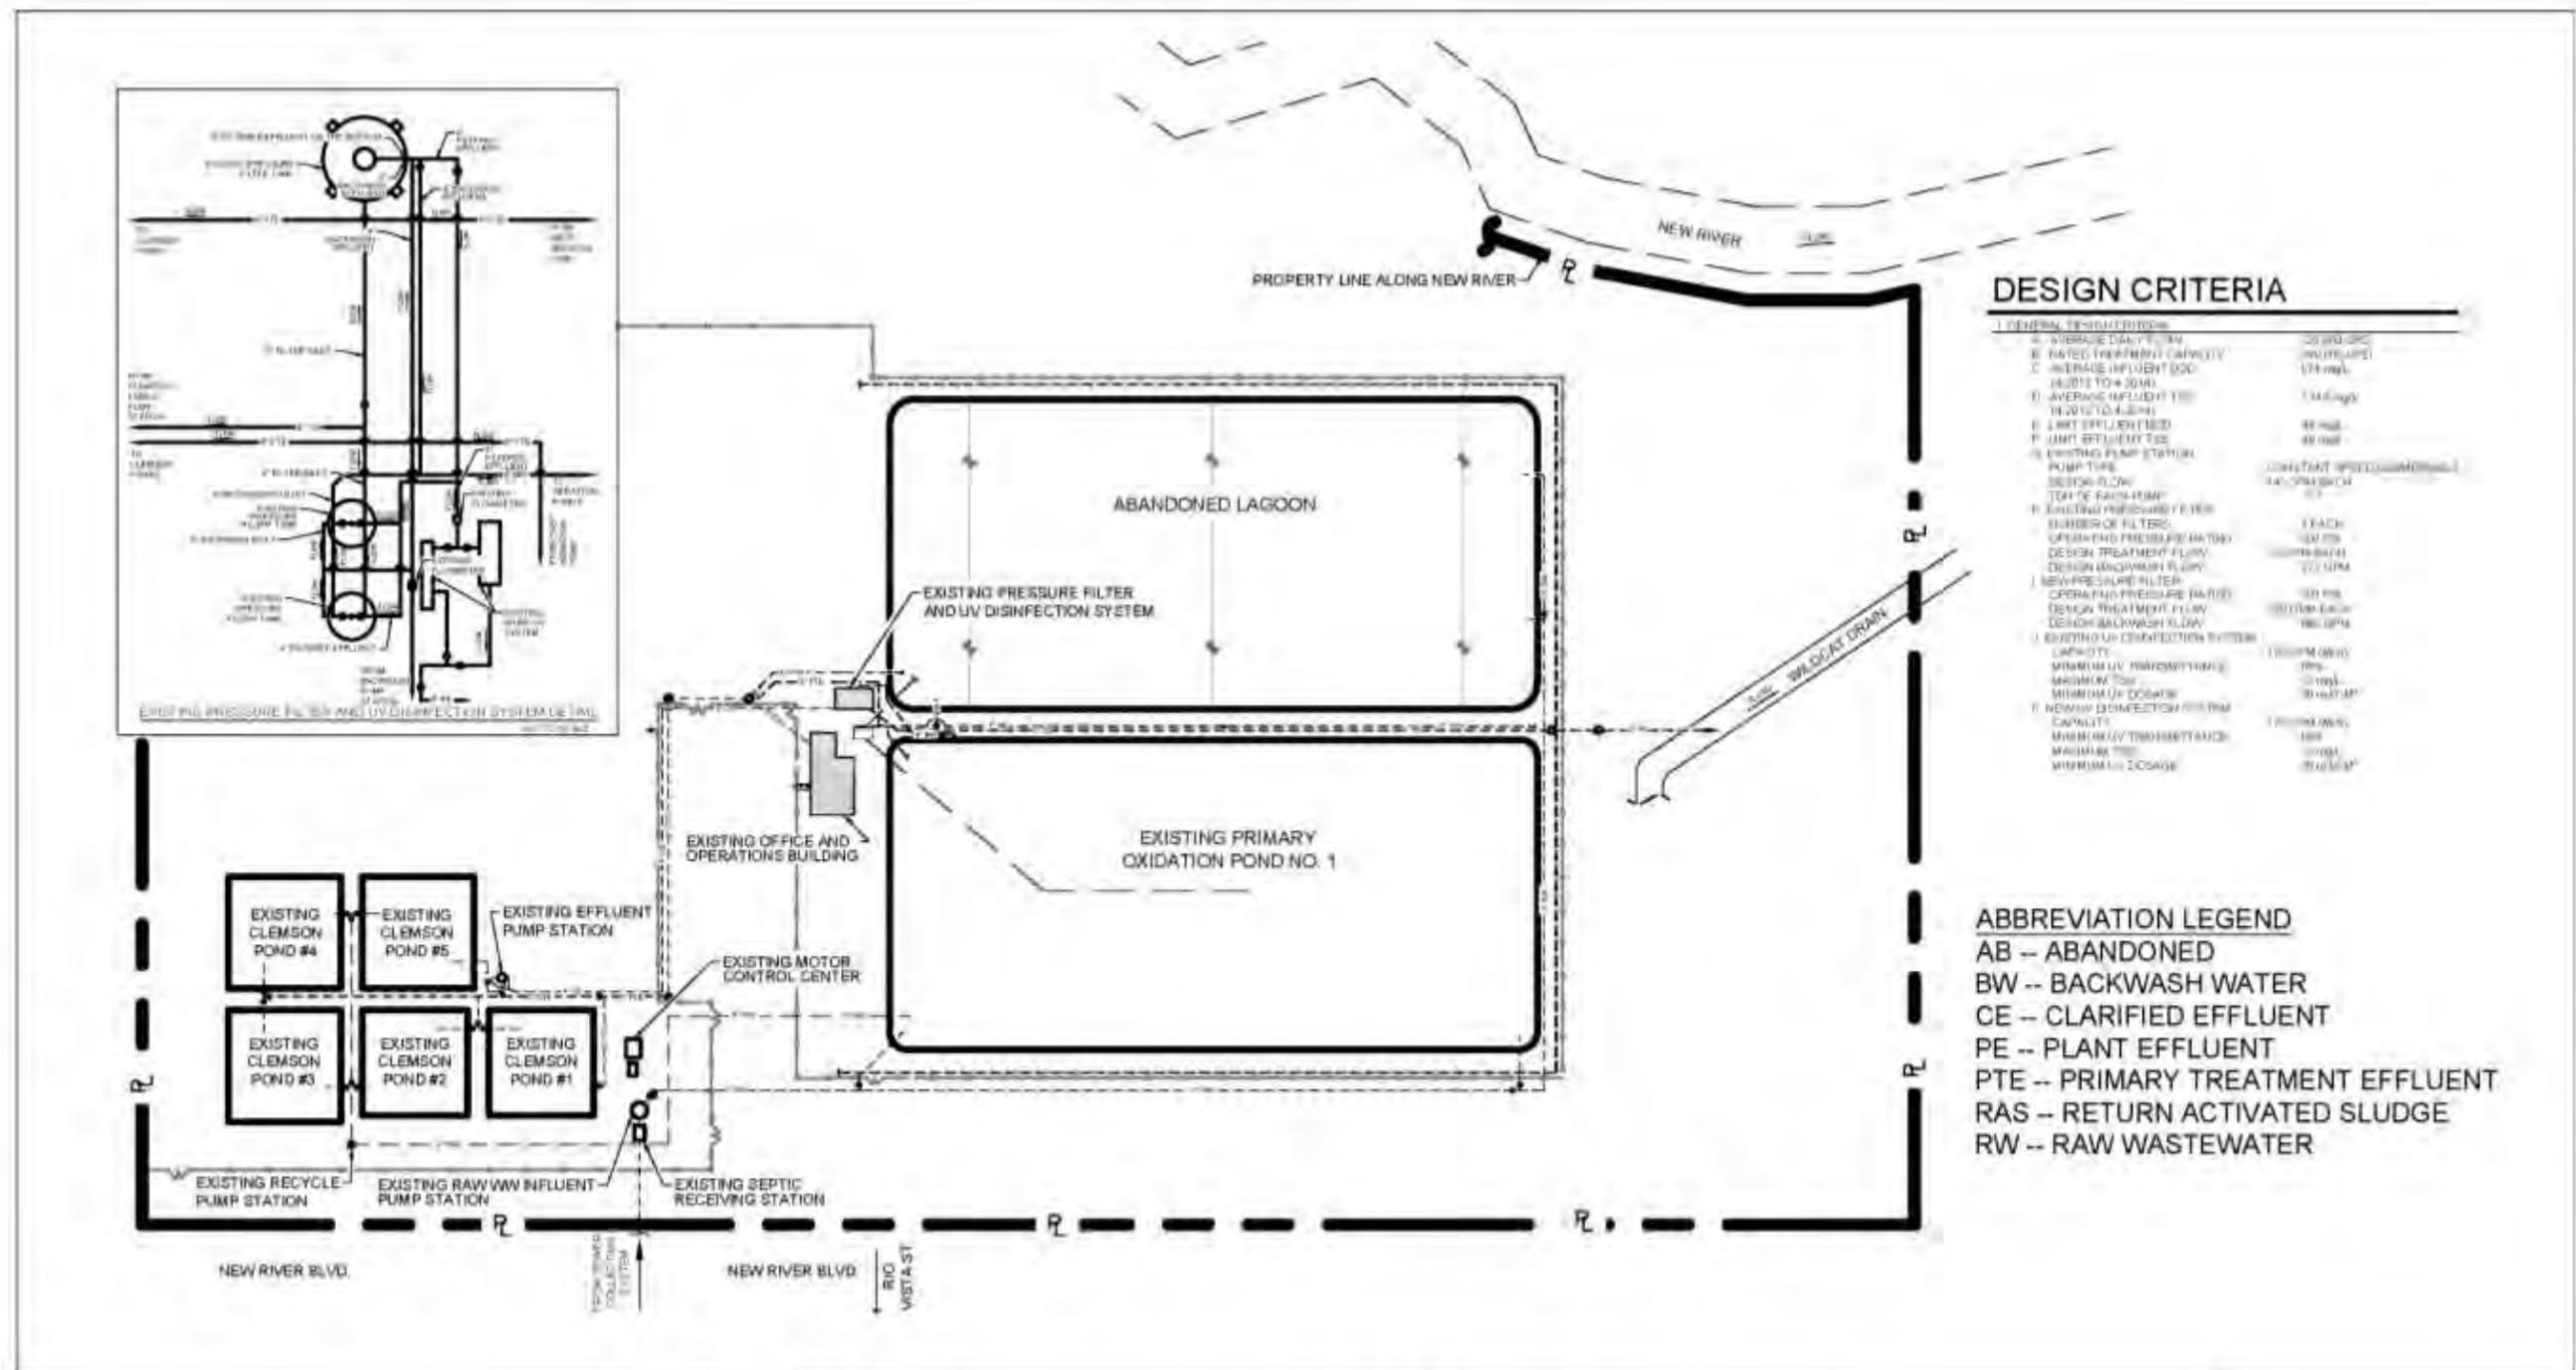

| | | | | | | |
|---|--|---|---|--|----------------------------|------------------|
| <p>The Holt Group, Inc. ENGINEERING PLANNING SURVEYING</p> |  |  NOT TO SCALE | <p>SEELEY COUNTY WATER DISTRICT EXISTING WASTEWATER TREATMENT PLANT DESIGN & FLOW</p> | <p>EXHIBIT 5-B</p> | | |
| 1601 NORTH IMPERIAL AVENUE EL CENTRO, CALIFORNIA 92243 | 760-337-3683 | | | <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 50%; padding: 2px;">PROJECT NO THG 1168.009</td> <td style="width: 50%; padding: 2px;">DATE May 2017</td> </tr> </table> | PROJECT NO THG 1168.009 | DATE May 2017 |
| PROJECT NO THG 1168.009 | DATE May 2017 | | | | | |

Plant for treatment and disposal. The following is a general inventory of the gravity flow Wastewater Collection Pipelines. An additional 4,000 LF of force main pipeline is also inventoried.


Table 5-B
SCWD Wastewater Collection Pipelines

| Pipeline Diameters | Material | Length (FT) |
|--------------------|---------------------------|-------------|
| 12-inch | Vitrified Clay Pipe / PVC | 3,810 |
| 10-inch | Vitrified Clay Pipe | 3,200 |
| 8-inch | Vitrified Clay Pipe | 13,040 |
| 6-inch | Vitrified Clay Pipe | 4,680 |

Source: 2003 Service Area Plan-SCWD; Updated 2017 The Holt Group, Inc. The sewer collection system serves users within the SCWD District boundary except for a few users located on the exterior edges of the District Boundary, but within the Sphere of Influence. The wastewater collection system, generally, extends within the footprint of the Seeley Townsite. Refer to **Exhibit 5-C - Existing Wastewater Collection and Sewer Facility Schematic Map**. The wastewater flows in a westerly direction through a series of pipelines and via gravity flow into the Wastewater Treatment Plant. There is only one lift station within the entire system. The sewer lift station is owned by and located within the Sunbeam Lake RV Park.

Adequacy of Existing WWTP and Sewer Collection Facilities

Wastewater Treatment Plant- The average daily flow (design and permitted flow) received at the Seeley County Water District Wastewater Plant in 2017 was approximately 0.11 MGD with peak flows up to 0.380 MGD, as experienced March of 2016. Thus, the WWTP is operating below capacity. The WWTP, however, has experienced recent challenges for effective treatment of effluent discharge and operated under a Cease and Desist Order since 2011 due to increasing effluent quality violations. The violations were largely due to bacteriological quality involving E. Coli and Fecal Coliform. The Cease and Desist Board Order was amended and has a compliance date of August 2016 to meet the board imposed effluent limitations. The Seeley County Water District met the Cease and Desist Board Order requirements by completion of an approved Compliance Project prior to August 1, 2016 consistent with a Wastewater Treatment Plant Assessment that was prepared by The Holt Group, Inc in 2014 that identified three viable and cost-effective options for improvements to the SCWD WWTP to address the disinfection system effluent violations. The most expedient and least costly method of addressing the violations was to increase the performance of the existing pressure filters and UV disinfection unit. An additional pressure filter and an additional UV Disinfection System were completed in July of 2016.

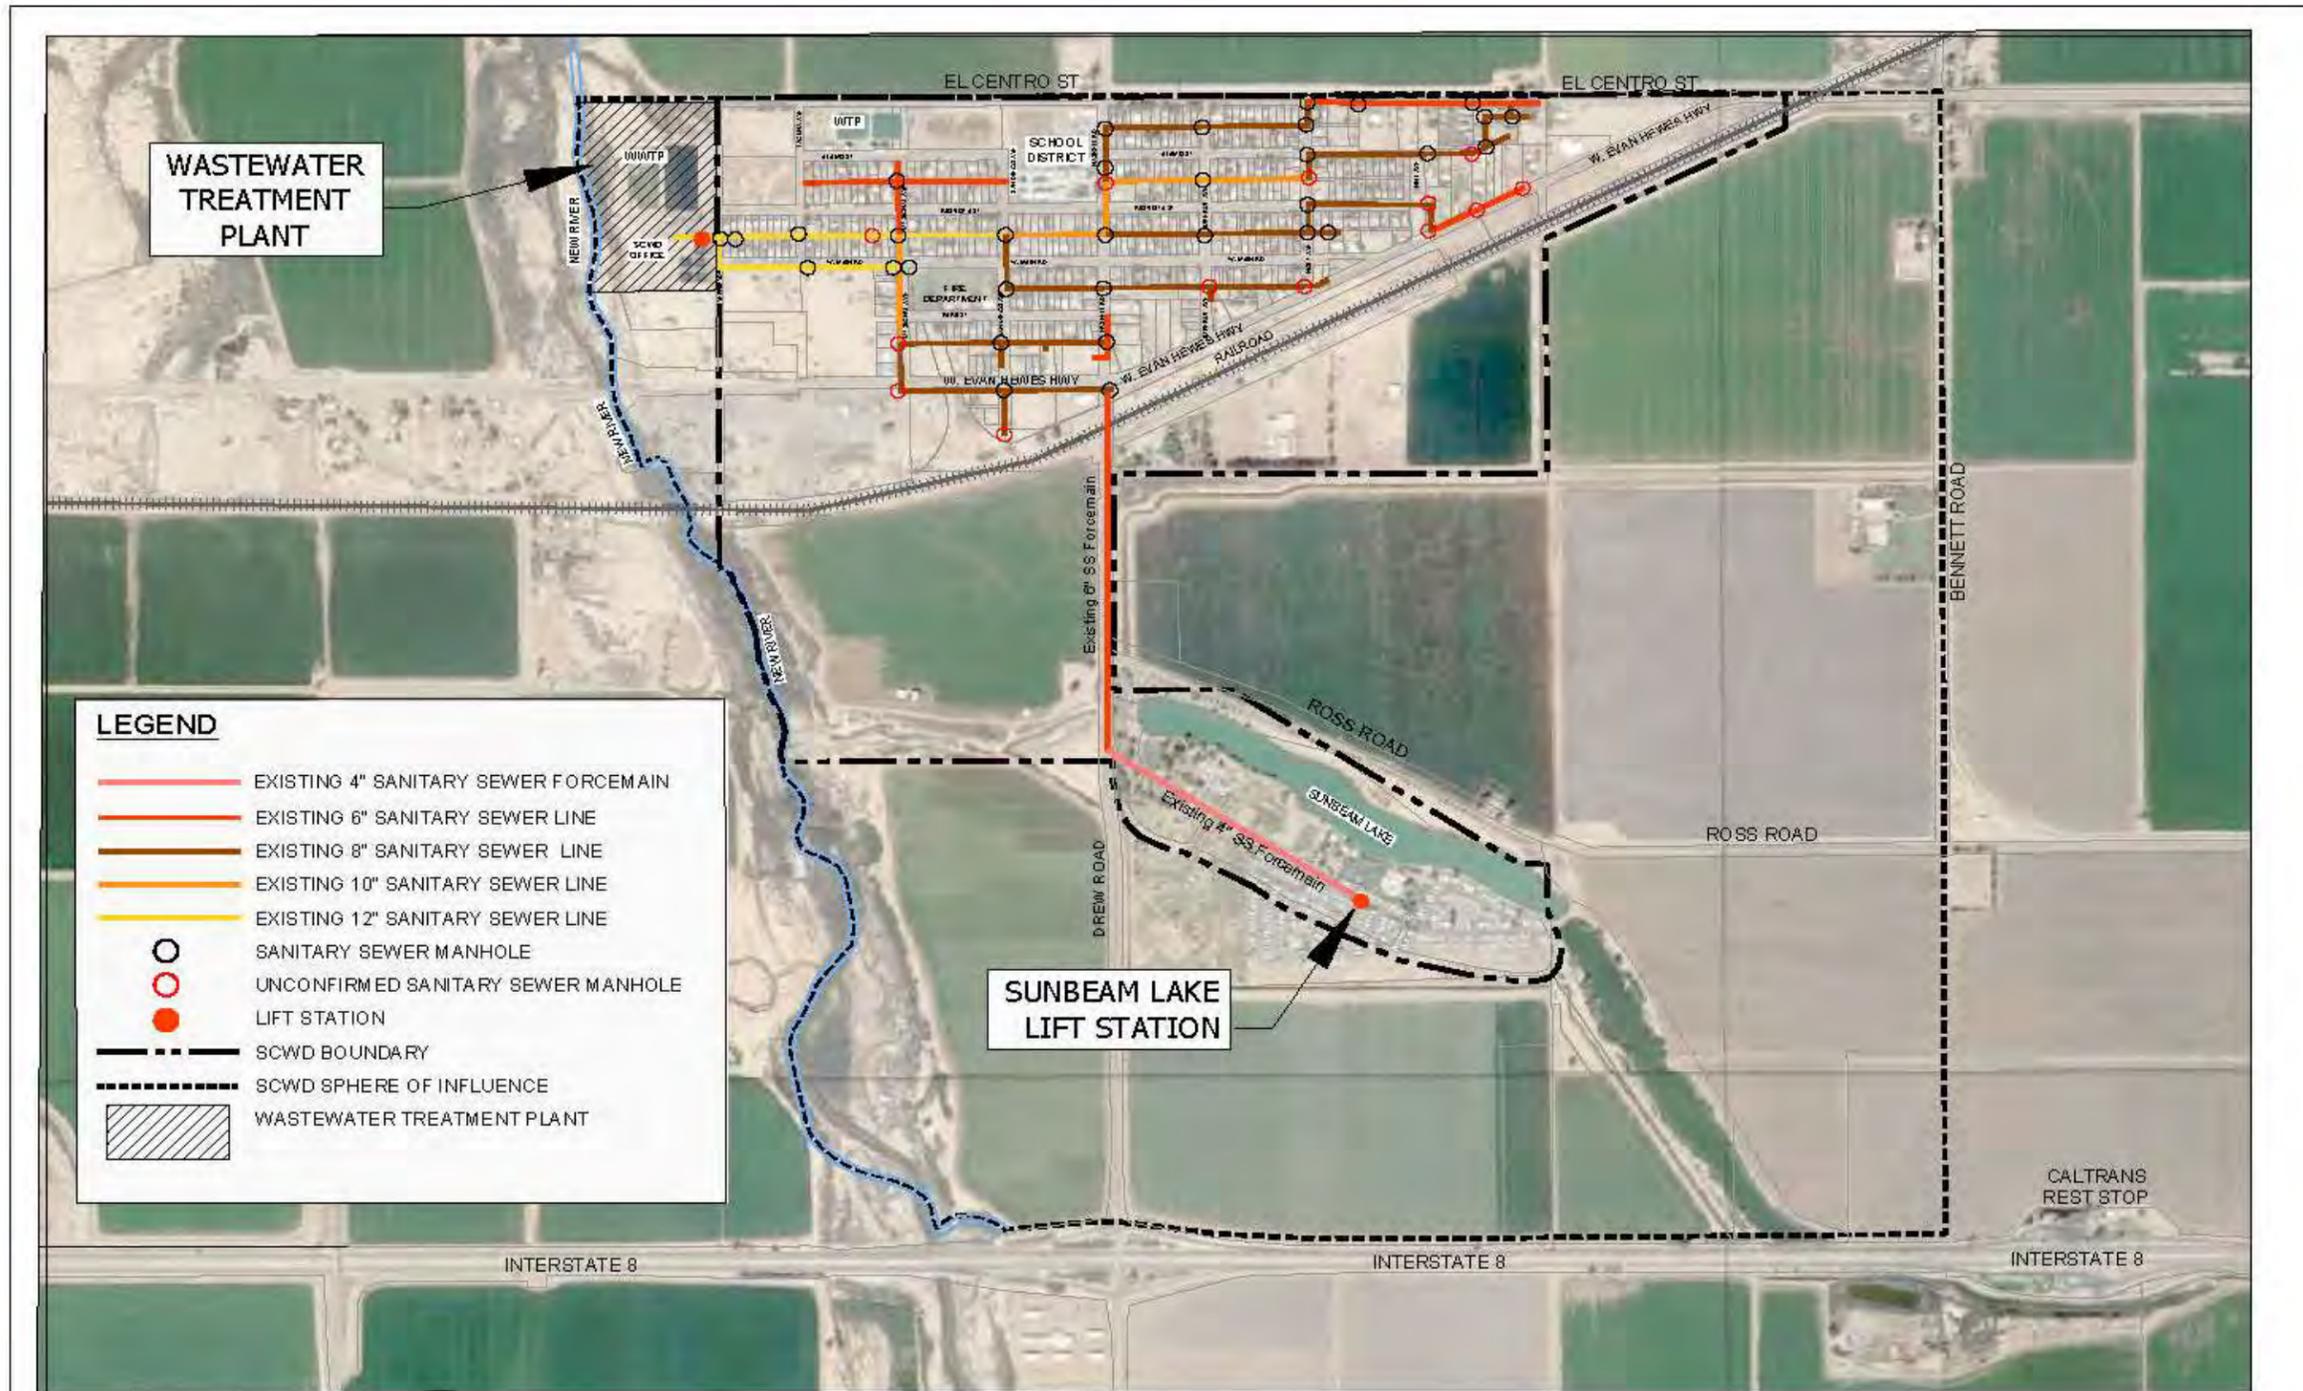

| | | | | |
|---|---------------------|---------------------|---|--|
| <p>The Holt Group, Inc. ENGINEERING PLANNING SURVEYING</p> | | <p>NOT TO SCALE</p> | <p align="center">SEELEY COUNTY WATER DISTRICT EXISTING WASTEWATER COLLECTION AND SEWER FACILITY SCHEMATIC MAP</p> | <p align="center">EXHIBIT 5-C</p> |
| <p>1601 NORTH IMPERIAL AVENUE EL CENTRO, CALIFORNIA 92243</p> | <p>760-337-3883</p> | | | <p>PROJECT NO THG 1186.009P</p> |

Sewer Collection System-The wastewater gravity pipelines within the Townsite of Seeley are composed of vitrified clay pipe (VCP). The vitrified clay pipelines are located within the alleys and streets. The VCP pipelines were cleaned and video camera inspected by the Seeley County Water District just prior to 2003 and were reported to be in fair condition. The investigation noted that some of the pipes were dirty with debris or that may contain tree roots. Hose jet cleaners have a maximum reach of 300 lineal feet making it difficult for operators to clean out clogged lines with distances exceeding 600 feet between manholes. There are eighteen (18) pipeline segments that exceed these length limitations.

The wastewater collection system is composed of a network of pipelines within the Townsite of Seeley with an additional pipeline extending south of the railroad tracks to serve Sunbeam Lake (refer to Exhibit 5-C). The network comprises of pipelines ranging in size from 6" to 12" within the Townsite and a 1,000 lineal feet of 4" force main transitioning to 3,000 lineal feet of 6" force main line serving Sunbeam Lake.

The existing system can support infill development but future growth areas would be required to construct new sewer mains. As noted earlier, the 12" sewer line on Main Street between Mount Signal Avenue and New River Boulevard is at capacity during peak flow. The other 12" line, located on Rio Vista Street between New River Boulevard and San Diego Avenue has approximately 25% capacity. These two lines are the only lines that connected directly to the treatment plant. New development projects would have to install new sewer main pipelines connecting directly to the treatment plant.

Inventory of Approved WWTP and Sewer Collection Facilities

There are currently no approved wastewater capital improvements approved for the Wastewater Treatment Plant. There are currently no approved wastewater collection pipelines planned within the service area. There are a number of projects recommended under build-out demand discussed in the proceeding section for SCWD Board consideration.

Buildout Demand for WWTP and Sewer Collection Facilities

Anticipated Capacity- The 2017 average daily wastewater flow entering the Seeley County Water District wastewater treatment plant was 0.12 million gallons per day according to operator records. The Seeley County Water District 0.25 million gallon wastewater treatment plant provides an average daily flow excess capacity of 0.13 million gallons per day. The average daily per capita (person) wastewater generation is estimated at 100 gallons per capita per day (gpcd). The residential per capita housing density in Seeley has been calculated at 3.53 persons per dwelling unit (2011-2015 ACS) as noted previously within the contents of this document. An equivalent dwelling unit (EDU) within the Seeley County

Water District is defined as the wastewater generation in a day by a single family residential housing unit. An EDU is therefore calculated as follows:

$$3.5 \text{ persons per dwelling unit} \times 100 \text{ gallons per capita per day (gpcd)}$$

$$= 350 \text{ gallons per dwelling unit}$$

Therefore,

$$1 \text{ EDU} = 350 \text{ gallons per day}$$

The additional capacity of the 0.25 million gallon wastewater treatment plant is 0.13 gallons and can be calculated as follows:

$$\frac{130,000 \text{ gallons (excess capacity)}}{350 \text{ gallons/EDU}} = 370 \text{ single family residences or 370 EDU's}$$

At the current growth rate of 2.08% per year and an estimated demand of 100 gpcd, the treatment plant will be at capacity in 2039 (see Table 5-C). It should be noted that 100 gpcd is the industry standard used in projecting demand, but actual usage in Seeley is 59 gpcd. Using a 65 gpcd forecasting number (which is more in line with actual usage), capacity would be reached in 2050.

Table 5-C
Capacity Demand Based on Historic Growth Projections

| Projected Population (Population Increase Based on Historic Growth Rate ¹) | | Wastewater Treatment Plant Capacity Demand |
|--|-------|---|
| Year 2017 | 2,140 | 0.125 mgd |
| Year 2020 | 2,278 | 0.139 mgd |
| Year 2025 | 2,581 | 0.164 mgd |
| Year 2035 | 3,176 | 0.224 mgd |
| After 2045 | 3,907 | 0.297 mgd |

¹Historical Growth Rate was calculated at 2.08% percent over a 20 year period between 1990 and 2010.

²1 EDU = 350 gallons/day-Based upon 3.5 persons per residence and 100 gallons/capita-day of wastewater

A multi-use, multi-density residential subdivision within SCWD's sphere of influence was recently approved by the County of Imperial in 2016. The project consists of 403 single-family residences, up to 312 multi-family dwelling units, and 16.95 acres of commercial land. Development of the project can begin as soon as 2018 and the residential component can be built out within ten (10) years. This subdivision increases demand on the treatment plant, and along with natural

population growth, treatment capacity will be reached in 2027. **Table 5-D** shows the population numbers and treatment plant demand to the year 2045.

**Table 5-D
Capacity Demand Based on Natural Growth Rate and Approved Projects**

| | Projected Population (Natural Growth + Approved Residential Development¹) | Wastewater Treatment Plant Capacity Demand |
|------------|---|---|
| Year 2017 | 2,140 | 0.124 mgd |
| Year 2020 | 2,867 | 0.155 mgd |
| Year 2025 | 4,110 | 0.215 mgd |
| Year 2035 | 6,340 | 0.359 mgd |
| After 2045 | 7,795 | 0.505 mgd |

¹Historical Growth Rate was calculated at 2.08% percent over a 20 year period between 1990 and 2010 and applied to projections. (Base year was derived from existing service connections).

²1 EDU = 350 gallons/day-Based upon 3.5 persons per residence and 100 gallons/capita-day of wastewater generation

If infill development were to occur at the same time as the approved subdivision project, capacity at the wastewater treatment plant would be reached much sooner. All developable infill parcels in Seeley’s service area boundaries can support up to 536 residential units. A 20-year buildout schedule was used for population projection estimates. Table 5-E shows population size with natural growth, infill development, and growth from the approved Sunbeam Lake Estates project. Treatment demand would exceed capacity in 2025.

**Table 5-E
Capacity Demand Based on Natural Growth Rate and Projected
Development Anticipated**

| | Projected Population (Natural Growth + Approved Residential Development¹ + Infill Development) | Wastewater Treatment Plant Capacity Demand |
|------------|--|---|
| Year 2017 | 2,140 | 0.124 mgd |
| Year 2020 | 3,158 | 0.163 mgd |
| Year 2025 | 4,930 | 0.242 mgd |
| Year 2035 | 8,398 | 0.442 mgd |
| After 2045 | 10,643 | 0.647 mgd |

¹Historical Growth Rate was calculated at 2.08% percent over a 20 year period between 1990 and 2010 and applied to projections. (Base year was derived from existing service connections).

²1 EDU = 350 gallons/day-Based upon 3.5 persons per residence and 100 gallons/capita-day of wastewater generation

The Regional Water Quality Control Board generally requires agencies to begin engineering design at 80% capacity and begin construction at 90% capacity. At 2.08% growth rate, SWCD should begin design work between 2031 and 2038, but the added demand from the approved residential subdivision and infill development, design work should begin in 2022 and construction should begin in 2024. Design and construction is generally a 3-5-year process.

The existing wastewater treatment plant is not designed in a manner that would allow modular upgrades to increase capacity. A new 0.75 MGD plant will need to be constructed to meet demand through 2045 (assuming no other residential subdivision projects are approved). The estimated cost of a new treatment plant is \$5-7 million. **Table 5-F** provides an overview of the Capital Improvement needs for the SCWD Wastewater facilities within the near-term.

**Table 5-F
Projected Near-Term Wastewater Facility Improvement Needs**

| Projects | Estimate (2017) | Funding Gap (2017) |
|---|------------------------|---------------------------|
| Wastewater Master Plan (2020) | \$150,000 | \$150,000 |
| Design Services for Wastewater Expansion (2022) | \$300,000 | \$300,000 |
| New Wastewater Main Pipeline 18" Diameter | \$267,000 | \$267,000 |
| Pond Lining and Six Aerators | \$750,000 | \$750,000 |

Source: The Holt Group, Inc. 2017 Estimates

Opportunity for Shared Wastewater Treatment Facilities

As previously noted, the nearest community to the Seeley service area is the City of El Centro which is 7.5 miles to the east of Seeley. Another wastewater treatment facility is the wastewater treatment facility serving the Centinela State Prison located 5.27 miles to the northwest. These facilities are too far away from the Seeley Wastewater Treatment Plant for a feasible consolidation.

The Navy Base, located at 1605 3rd St in El Centro, is one mile east of Seeley and is served by U.S. Navy via an onsite wastewater treatment facility with a capacity of 0.30 MGD. The Navy base is located approximately two miles uphill from Seeley in a northeasterly direction. In order to consolidate with the Navy base, a new lift station will have to be constructed, along with approximately 11,033 lineal feet force main line at an estimated cost of \$4.9 million. Consolidation with the Navy base may not be feasible due to military operations and potential security concerns.

Mitigation for Wastewater Treatment Plant and Sewer Collection Facilities

The Seeley County Water District should plan for immediate improvement to the WWTP associated with compliance and for future expansion needs. Strategies will include securing funding for all phases of facility development. Mitigation is noted as follows:

- WW-1** The District shall maintain adequate reserves for the proper repair and maintenance of the collection system.
- WW-2** The District should continue to pursue various means by which to obtain funding and provide for adequate wastewater treatment and collection/conveyance facilities for the existing and future residents of the District.
- WW-3** The District shall evaluate impact fees are to ensure fees are sufficient to support the costs of the projected expansion needs at the WWTP.
- WW-4** The District shall develop a Wastewater Master Plan, as funds become available, to ensure that new development will construct sewer main lines to be compatible with the sewer collection system.
- WW-5** New Development shall continue to be held responsible for constructing adequate wastewater collection system facilities and the fair share costs.
- WW-6** A Sewer System Management Plan (SSMP) should be developed and implemented to effectively manage the sewer system as well as assist in identification of facilities (pipelines, manholes, etc.) that are in need of rehabilitation.

5.1.3 Water Facilities

The District owns, operates and maintains a system for the treatment, distribution and storage of potable water resources that currently serves approximately 411 water service connections for residences, businesses, and public facilities within the District and the District's Sphere of Influence (Source: Seeley County Water District- June 5, 2017 Board Report). The water treatment plant is located at the northeast corner of the Alamo Street and Laguna Avenue intersection where the administration office is located. The District purchases all of its untreated water from the Imperial Irrigation District, which is conveyed to SCWD facilities via IID's Elder Canal located east of the water treatment plant. Water treatment and distribution facilities are owned and maintained by the Seeley County Water District. The SCWD sub-contracts the testing of the treated water to a certified laboratory.

Performance Standard for Water Facilities

Although the Seeley County Water District does not have an adopted performance standard for water facilities, there are design criteria that must be met to ensure that adequate potable water supply and fire flow needs are provided. Potable water must meet or exceed water quality standards established by the Water Resources Control Board, Division of Drinking Water and the US Environmental Protection Agency. SCWD's goal in the operation and maintenance of its water facilities is to provide adequate potable water service to every customer. Seeley County Water District operates under Domestic Water Supply Permit No. 05-14-05P-007 issued May 10, 2005.

The California Waterworks Standard requires that specific system pressures be maintained under normal and peak demand conditions. Additionally, each distribution system shall be operated in a manner to assure that the minimum operating pressure in the water main at the user service line connection throughout the distribution system is not less than 20 pounds per square inch at all times, per California Code of Regulations Title 22 related to drinking water and the 2016 California Fire Code related to fire flow.

The criteria outlined in **Table 5-G** considers adequate water pressure for service to customers in addition to technical specifications that assure a properly designed system. As discussed with the Imperial County Fire Department and based on the California Fire Code, the following fire flows are required: 1,000 gallons per minute for residential; 1,500 gallons per minute for commercial; and 2,000 gallons per minute for industrial. The fire flows are required to be maintained for a minimum duration of 2 hours.

**Table 5-G
Water Flow Standards**

| Flow Demand | Maximum Velocity | Pressure Level |
|---------------------------------|--------------------|-----------------|
| Maximum Day Demand + Fire Flow* | 15.0 ft per second | 20 psi - 35 psi |
| Maximum Day Demand | 7.0 ft per second | ≥ 20 psi |

*Fire flow minimums are targeted at 1,000 GPM for residential, 1,500 GPM for commercial, and 2,000 GPM for industrial.

The water treatment plant capacity shall further meet the demand of the maximum daily flow, plus provide an operational storage capacity of at least 50 percent of the maximum day demand used. Systems with less than 1,000 service connections must have storage capacity that is equal to or greater than the Maximum Day Demand (MDD), unless the system can demonstrate that it has an additional source of supply or has an emergency source connection that can meet the MDD requirement.

Inventory of Existing Water Facilities

Water Treatment Plant- The SCWD owns and operates a public water treatment plant located on a 2.5 acre parcel on the northeast corner of the Alamo Street and Laguna Avenue intersection. The plant was originally constructed in 1965 and has a design capacity of 1.08 MGD and a current treatment demand average of 214,800 gallons per day. The Water Treatment Plant operates on a 24 hour a day basis.

Raw water is conveyed to the Seeley County Water District (SCWD) Water Treatment Plant (WTP) by gravity flow from the Imperial Irrigation District’s canal. The WTP’s raw water storage consists of two (2) raw water storage basins with a combined capacity of 4.3 million gallons (MG). The raw water pump station is supplied with raw water by gravity from the raw water basins. The inlet piping and outlet piping of the raw water pump station allow for a raw water pumping capacity of 700 gallons per minute (gpm) with two pumps running to the Treatment Units.

The Treatment Units are comprised of two (2) packaged water treatment units and coagulant storage and feed system. Each Treatment Unit is composed of a combined adsorption clarification and media filtration system which is designed to treat the capacity of 350 gallons per day (GPD) each. A finish water pump is located downstream of each Treatment Unit pumps 350 gpm to the potable water Storage Tanks. There are two (2) Storage Tanks which have total capacity of 1.0 Million Gallons (MG). Each Storage Tanks has four (4) baffles which will assist with contact time for chlorine disinfection.

Finished water is supplied from the Storage Tanks to the distribution pump station. The distribution pump station is downstream of the storage Tanks. The distribution pump station consists of two (2) 250 gpm pumps and four (4) 500 gpm pumps all drive by VFD's. The pump station has a maximum flow capacity of 2,500 gpm at 80 psi pressure. The pumps are operated via VFD drives, which allow efficient operation for various water distribution water demands. The pump station conveys potable water to the SCWD Water Distribution System at pressure range of 50 to 60 psi.

Treatment Units are equipped with a Programmable Logic Controller (PLC) which provides controls required for operation of the Water Treatment Plant. Disinfection is provided via a chlorine storage and chemical feed system. Chlorine is injected downstream of the Treatment Units, with an option to dose downstream of the Distribution Pump Station.

Potable Water Storage Facilities/Pump Stations-The SCWD maintains two storage sites at the 2.5-acre site to be used for finished or treated water. The treated water is stored in two (2) on-grade bolted steel tanks, each with a capacity of 500,000 gallons. The tanks operate in series and have the ability to operate separately in any case where one (1) of the storage tanks is placed out of service. Both storage tanks have baffles which were installed to improve CT disinfection conditions. The finished water is then pumped into the water distribution system by a variable frequency drive pump station capable of a maximum fire flow output of 2,500 gpm. This pump station is the only pump station used in the SCWD Water Distribution System.

Water Distribution Facilities- The SCWD operates approximately 8.75 miles of distribution pipeline. The pipelines range from 3-inch to 12-inch in diameter and are primarily situated in a grid-like pattern within an approximate 0.50 square mile radius, encompassing the Seeley Community. The distribution pipeline system within the community of Seeley is generally bound by El Centro St. to the north, Evan Hewes Highway to the south and southeast, and the wastewater treatment plant to the west. A 4-inch diameter distribution pipeline runs south from the Seeley Community along Drew Road for approximately half a mile to service the County of Imperial Sunbeam Lake Park and RV Resort. The 4-inch diameter distribution line then runs southeast from the County of Imperial Sunbeam Lake Park and RV Resort for approximately 1.25 miles to service the California Department of Transportation (Caltrans) Interstate 8 Rest Stop Area. The Caltrans rest area is the furthest point south in the distribution system and serves as the bacteriological and TTHM sampling site under the current Stage 2 Disinfection Byproduct Rule (DBPR). SCWD has 99 water valves and 48 hydrants within the

distribution system (**Refer to Exhibit 5-D – Seeley County Water District Existing Water Distribution System**).


Adequacy of Existing Water Facilities

Adequacy of Treatment Capacity- The Seeley County Water Districts WTP's maximum operation capacity is 1.08 MGD. The plant is experiencing an average daily demand of .214 MGD with a peak flow demand of 0.39 MGD. The daily demand has substantial capacity at 20% of the maximum capacity. Thus the plant is capable of meeting the treatment demand projected for the planning period.

Seeley County Water District has been issued several citations by the California Department of Public Health between 2006 and 2014 after failing to comply with the drinking water Standard for the Running Annual Average Maximum of Total Trihalomethanes (TTHM) of a maximum of 80 micrograms per liter ($\mu\text{g/L}$). Most recently in April 29, 2015 an amendment was made to Citation No. 05-14-14C-001 after Seeley failed to comply with Directive 4 of the approved June 11, 2014 TTHM Reduction Plan. An updated TTHM Reduction Plan dated February 25, 2015 was approved where it was understood that the submitted project schedule was subject to change based on funding. Construction is scheduled to begin in August 2017. Improvements proposed to be made include the construction of a Trihalomethane Removal System which will be incorporated as part of the potable water storage tanks which will treat up to 500,000 gallons per day.

Adequacy of Storage System- Thus, the water treatment plant has adequate storage capacity of one (1) million gallons which is divided into two (2) storage reservoirs having a total storage capacity of five hundred thousand (500,000) million gallons each. The two (2) Storage Tanks operate in series and have baffles which were installed to improve CT disinfection conditions. The existing reservoirs have a water capacity that may supply more than two (2) days of water demand from its consumers.

Adequacy of Distribution System- In 2011 the Water District replaced approximately 70% of the water distribution system. As previously noted, the water distribution system consists of distribution pipelines ranging from three (3) inch diameter to twelve (12) inch diameter. The only 3-inch pipelines serve two different residential neighborhoods and are considered substandard. Per California Code of Regulations Title 22, the minimum allowed pipeline has a four (4) inch diameter. The inadequately sized pipelines serve residential homes at the north-west corner of the intersection at Evan Hewes Highway and San Diego Avenue and as well as the east side of the intersection at Haskell Road and Park Street (See **Exhibit 5-D**).

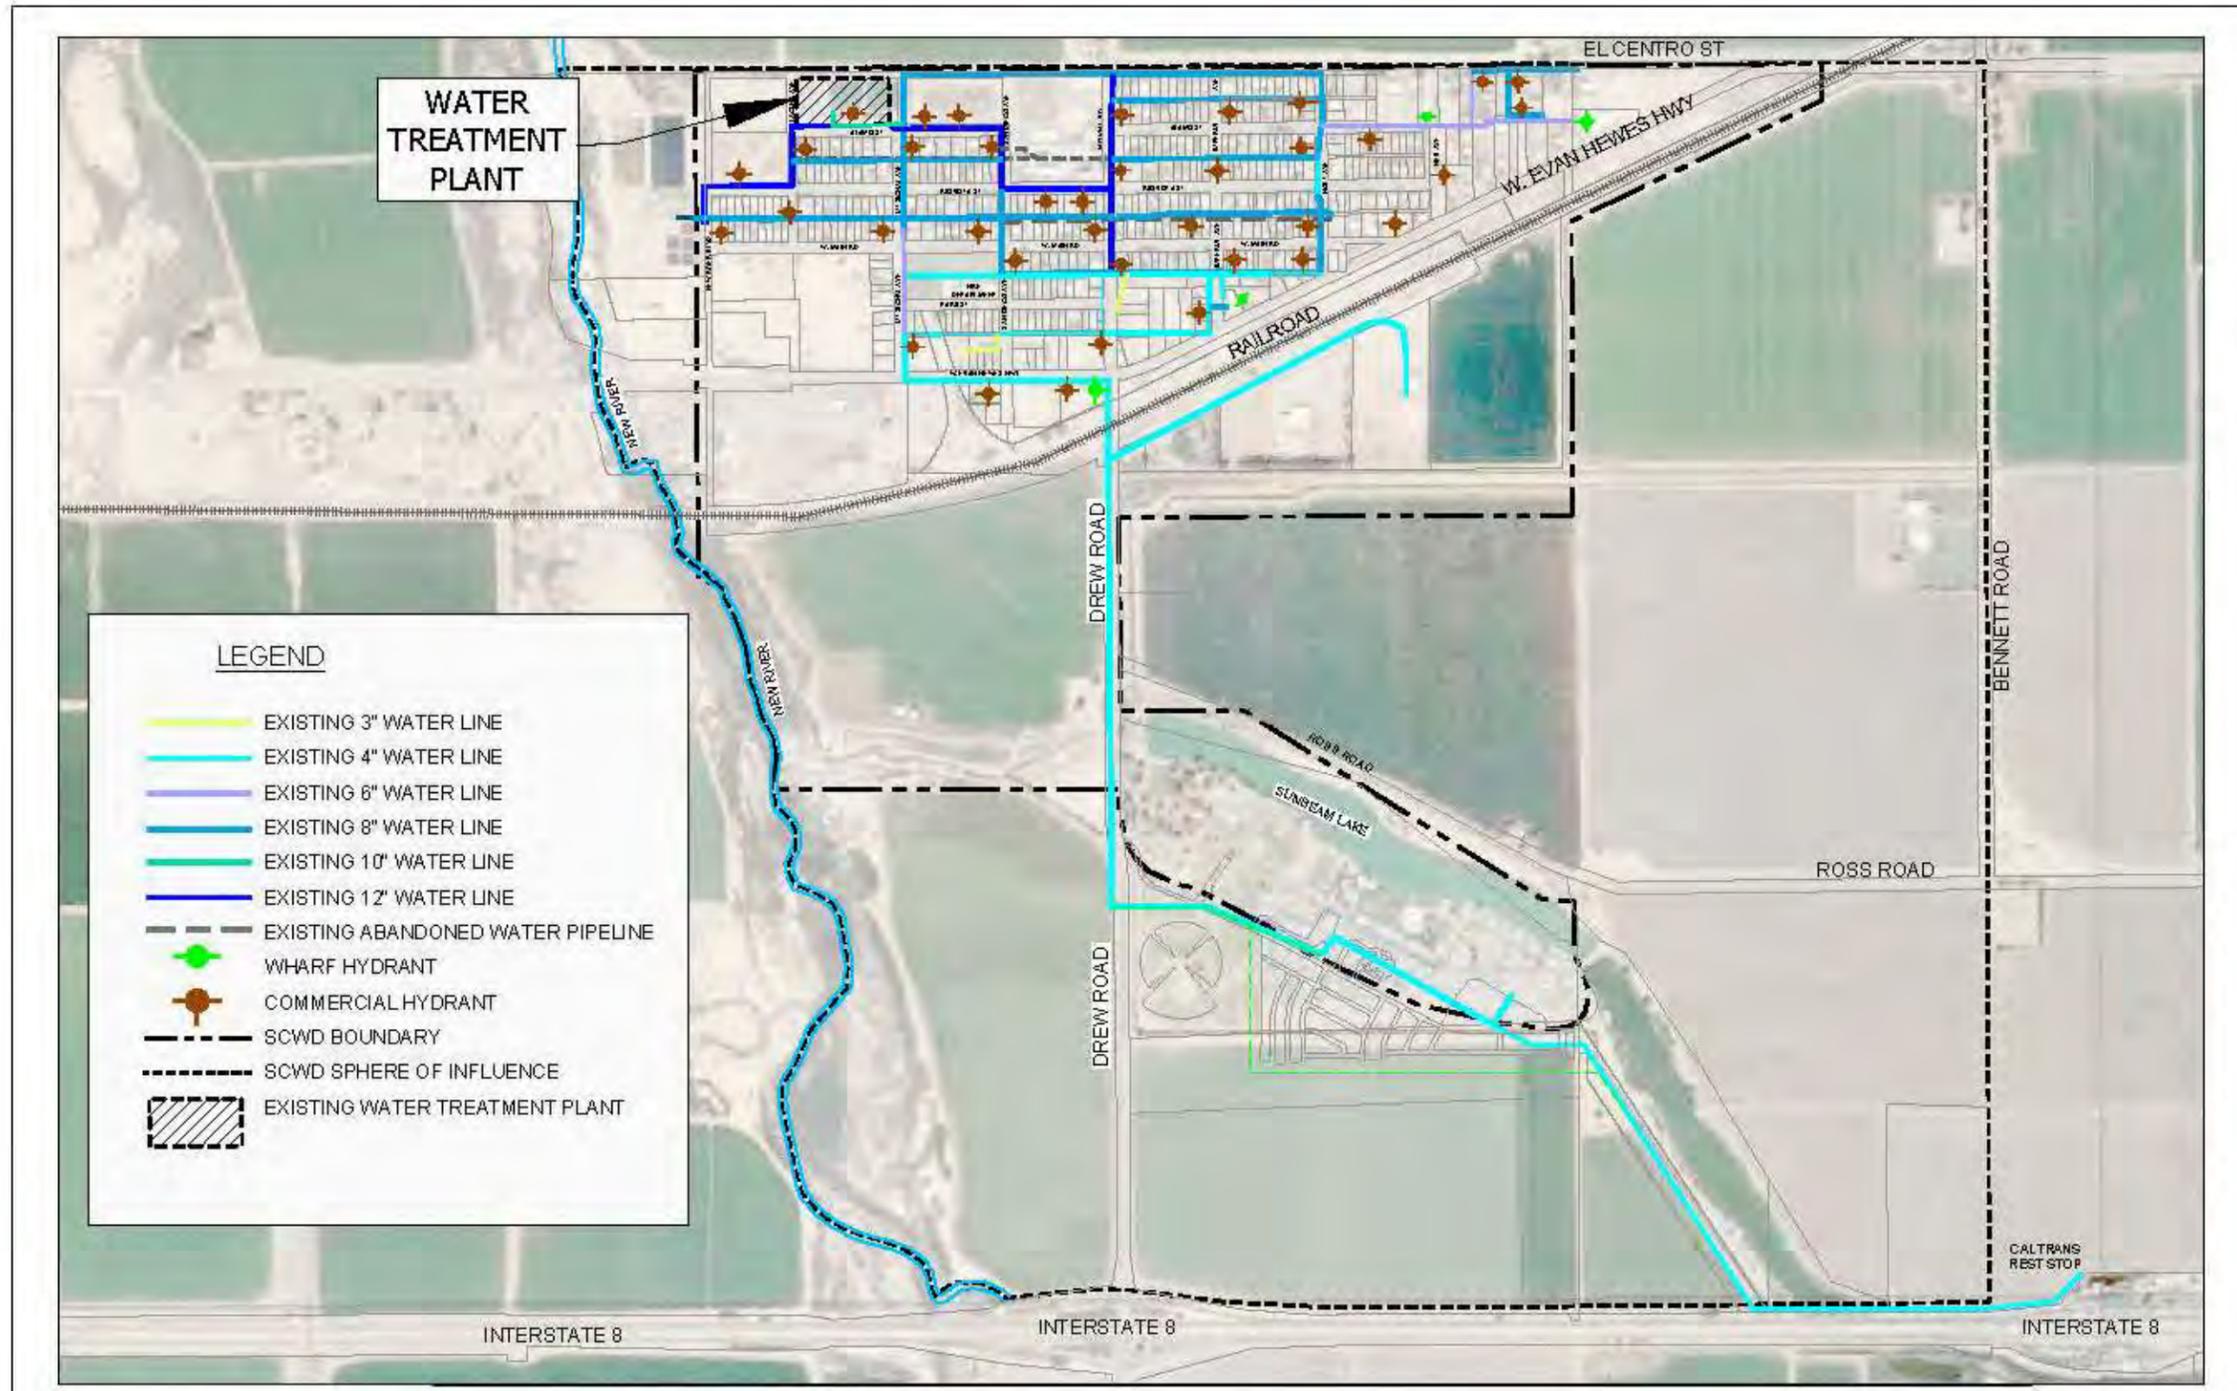

| | | | | | |
|---|---------------------|--|---|------------------------------|-------------------|
| <p>The Holt Group, Inc. ENGINEERING PLANNING SURVEYING</p> | | <p>SEELEY COUNTY WATER DISTRICT EXISTING WATER DISTRIBUTION SYSTEM</p> | <p>EXHIBIT 5-D</p> | | |
| <p>1601 NORTH IMPERIAL AVENUE EL CENTRO, CALIFORNIA 92243</p> | <p>760-337-3883</p> | <p>NOT TO SCALE</p> | <table border="1"> <tr> <td data-bbox="2377 1794 2564 1834">PROJECT NO THG 11 86.009P</td> <td data-bbox="2564 1794 2657 1834">DATE July 2017</td> </tr> </table> | PROJECT NO THG 11 86.009P | DATE July 2017 |
| PROJECT NO THG 11 86.009P | DATE July 2017 | | | | |

The Seeley County Water District is proposing to conduct a complete hydraulic analysis of the existing water distribution system review to determine adequate demand, flow and pressure capacities of the distribution system during the Fall of 2017. In specific, Seeley County Water District is interested in the required fire protection flow and pressure capacities at fire hydrant locations throughout the distribution system, serving adequate demand for the residents and commercial facilities within its service area, and residence time of water in pipelines. Based on the hydraulic analysis, Seeley County Water District will evaluate recommended improvements and funding options for water distribution system improvements.

As of the current date, a portion of the hydraulic analysis has been conducted. The current distribution system has been evaluated for residence time (water age) in an attempt to identify long residence time of water pipeline sections, which may also contribute to the generation of Trihalomethanes (THM's) which have been reported at different sampling points throughout the system. A basic hydraulic model has been prepared and results imply that the water distribution system is flushing adequately based on the average daily demands that have been recorded for all existing water services. Residence times are low in all pipe segments with the exception of fire hydrant connections and dead end pipe segments near the Seeley WWTP.

There is a single 4-inch ACP pipeline that extends south of the railroad tracks and routes to the Sunbeam Rest Area along I-8. This 4-inch ACP pipeline is providing potable water to the Sunbeam Lake Recreation Facility, Sunbeam BMX, Sunbeam Ball Park, Sunbeam Lake R.V. Resort and the Sunbeam Rest Area. Based on average daily demand this pipeline provides potable water at a rate of about 26 GPM. This line would have to be replaced with a 12" Water Main Pipeline in order to accommodate future connections. The pipeline is considered to be operating at 100 percent capacity. The pipeline would require replacement in order to accommodate future connections.

Inventory of Approved Water Facilities

TTHM Treatment Improvements-The Seeley County Water District (SCWD) has designed and is in the process of constructing a Trihalomethane (THM) Removal System to be incorporated into and become a part of the potable water treatment process which would be able to treat up to 1,000,000 gallons per day. A modified spray aeration system with forced ventilation is proposed. The spray is proposed to be installed in the roof of the tanks stripping the TTHMs into the open head space. The head space will be fed with fresh air to optimize the TTHM removal, via forced ventilation to exhaust air into the atmosphere. The project is an improvement project which includes the following; installation of a pressure spray

aeration (via water pumps and piping) within the storage tank, and a forced air ventilation system (via blowers). The existing Storage Tanks will further need to be retrofitted for construction of the THM Removal System.

The intent of this Project is to serve as an action/response for SCWD to comply with Division of Drinking Water Citation requirements and Safe Water Drinking Act standards for drinking water. In specific, the TTHM Reduction improvements are proposed meet the TTHM's MCL standards and will not affect capacity. Please refer to **Exhibit 5-E- Proposed Water Treatment Improvements** that illustrates the planned improvements to the Water Tanks.

Buildout Demand for Water Facilities

Operator records show that 0.39 million gallons per day (MGD) is the peak demand produced by the SCWD water treatment plant with the average demand of 0.214 MGD. The current treatment capacity at the plant is 1.08 MGD and the plant is operating at 20% of its capacity with 0.86 million gallons of excess capacity. The average daily per capita (person) water demand is estimated at 150 gallons per capita per day (gpcd). The residential per capita housing density in Seeley has been calculated at 3.53 persons per dwelling unit (2011-2015 ACS) as noted previously. An equivalent dwelling unit (EDU) within the Seeley County Water District is defined as the water used in a day by a single family residential housing unit. An EDU is therefore calculated as follows:

$$\begin{aligned} & 3.5 \text{ persons per dwelling unit} \times 150 \text{ gallons per capita per day (gpcd)} \\ & = 525 \text{ gallons per dwelling unit per day} \end{aligned}$$


Therefore,

$$1 \text{ EDU} = 525 \text{ gallons per day}$$

The 0.86 million gallon per day excess capacity can provide service to 1,638 EDU's as calculated below:

$$\frac{860,000 \text{ gallons (excess capacity)}}{525 \text{ gallons/EDU}} = 1,638 \text{ EDU's}$$

At the current growth rate of 2.08% per year and an estimated demand of 150 gpcd, the treatment plant will be at capacity in 2079. It should be noted that 150 gpcd is the industry standard used in projecting demand, but actual usage in Seeley is 100 gpcd. Seeley's treatment plant will not reach capacity until the year 2079 if population growth remains the same as it has in the past. **Table 5-H** below shows the population project to the year 2045 and the level of demand on the treatment plant.

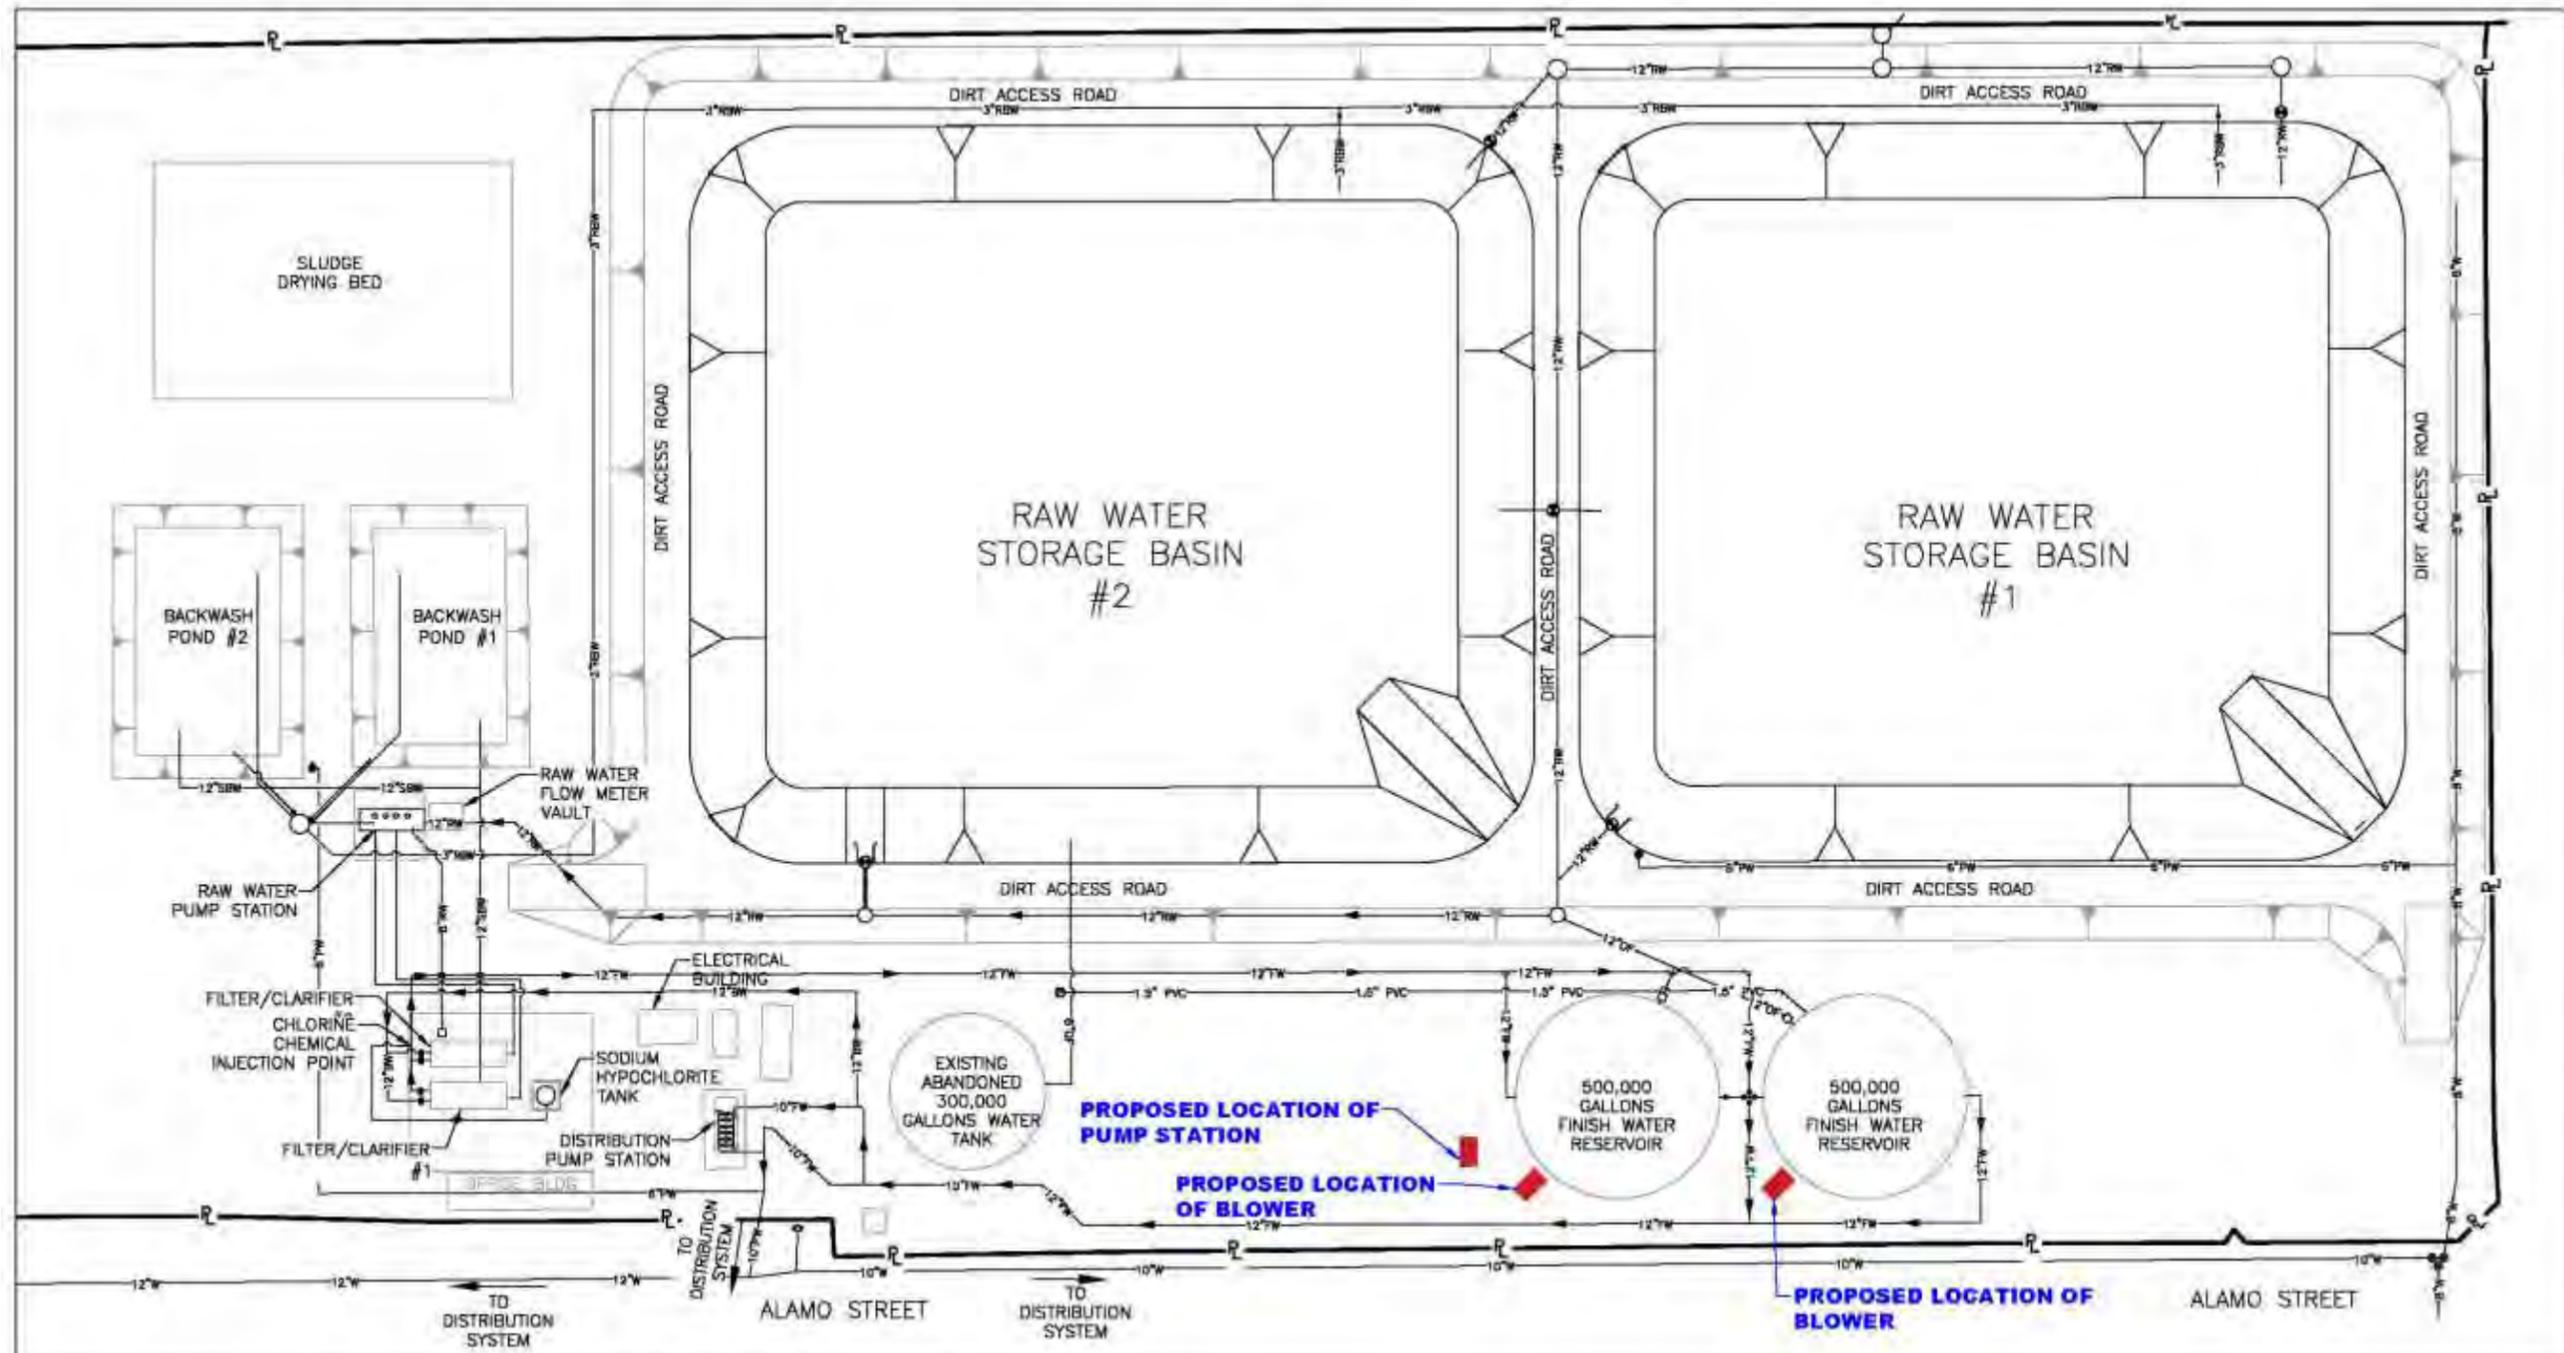

| | | | | | | |
|--|--|---|--|---|----------------------------|-------------------|
| <p>The Holt Group, Inc. •ENGINEERING •PLANNING •SURVEYING</p> |  |  NOT TO SCALE | <p>SEELEY COUNTY WATER DISTRICT PROPOSED WATER TREATMENT IMPROVEMENTS</p> | <p>EXHIBIT 5-E</p> | | |
| <p>1801 NORTH IMPERIAL AVENUE EL CENTRO, CALIFORNIA 92243</p> | <p>760-337-3883</p> | | | <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 50%; padding: 2px;">PROJECT NO THG 1186-009</td> <td style="width: 50%; padding: 2px;">DATE June 2017</td> </tr> </table> | PROJECT NO THG 1186-009 | DATE June 2017 |
| PROJECT NO THG 1186-009 | DATE June 2017 | | | | | |

**Table 5-H
Water Capacity Demand Based on Historic Growth Projections**

| Projected Population (Population Increase Based on Historic Growth Rate ¹) | | Water Treatment Demand |
|--|-------|------------------------|
| Year 2017 | 2,140 | 0.22 mgd |
| Year 2020 | 2,326 | 0.24 mgd |
| Year 2025 | 2,581 | 0.28 mgd |
| Year 2035 | 3,176 | 0.37 mgd |
| After 2045 | 3,907 | 0.48 mgd |

¹Historical Growth Rate was calculated at 2.08% percent over a 20 year period between 1990 and 2010.

²Based on an industry standard of 150 gpd per person, a peaking factor of 2.0.

Infill development and the recently approved Sunbeam Lake Estate project have an impact on population growth and the capacity of the water treatment plant. **Table 5-I** below shows what the population numbers would look like to the year 2045 if all infill areas are developed and the Sunbeam Lake Estate project were to be built. Capacity at the water treatment plant will be reached in 2033.

**Table 5-I
Buildout Demand for Water Treatment Plant**

| Projected Population (Natural Growth + Approved Residential Development ¹ + Infill Development) | | Water Treatment Demand |
|--|--------|------------------------|
| Year 2017 | 2,140 | 0.22 mgd |
| Year 2020 | 3,158 | 0.37 mgd |
| Year 2025 | 4,930 | 0.63 mgd |
| Year 2035 | 8,398 | 1.15 mgd |
| After 2045 | 10,643 | 1.50 mgd |

The Regional Water Quality Control Board generally requires agencies to begin engineering design at 80% capacity and begin construction at 90% capacity. At 2.08% growth rate, SWCD will not need to consider expansion until 2070, but the added demand from the approved residential subdivision and infill development, design work should begin in 2028 and construction should begin in 2032. Design and construction is generally a 3-4 year process.

The Seeley County Water District may expand the water treatment plant based on the same design facilities that are in place without significant alterations to the existing system. The Seeley County Water District may use the Clarifier/Filter Water Treatment Unit which are often referred to as “packaged treatment systems.” The packaged water treatment systems are pre-assembled prior to delivery to a given water treatment plant. The packaged water treatment systems are purchased and delivered at a designated treatment capacity. Each of the existing packaged treatment system is designed to treat 1.08 MGD. Thus, SCWD would be upgrading the water treatment plant in 1.08 MGD pre-packaged units gradually, as water demand increases.

The near-term and mid-term demand on the water treatment and distribution system are tied to immediate needs or future planning expenses. Accommodating any new development south of Evan Hewes Highway would require replacement of the undersized 4” water pipeline that serves as the main distribution line to the Sunbeam Lake area and is unable to meet fire-flow demands. The previously noted deficient residential distribution lines north of Evan Hewes would also need replacement, and in order to proactively plan for community development with the adequate provision of treated water facilities and services, a Water Master Plan needs to be developed. **Table 5-J** provides a general estimate of these near-term to mid-term costs.

**Table 5-J
Projected Near-Term to Mid-Term Water Facility Improvements**

| Projects | Estimate (2017) | Funding Gap (2017) |
|--|------------------------|---------------------------|
| Water Master Plan (2020) | \$150,000 | \$150,000 |
| 3” Water Distribution Residential Pipeline Replacement | \$60,500 | \$60,500 |
| 4” Water Distribution Main Pipeline Replacement (12”) | \$700,000 | \$700,000 |

Source: The Holt Group, Inc. 2017 Cost Estimates

Opportunity for Shared Water Facilities

The District does not share water treatment, storage, or distribution facilities with other Districts or jurisdictions. As previously noted, the nearest community to the Seeley service area is the City of El Centro which is 7.5 miles to the east of Seeley. Another water treatment facility is the wastewater treatment facility serving the Centinela State Prison located 7.5 miles to the northwest. These facilities are too far away from the Seeley Water Treatment Plant for a feasible consolidation.

The Navy Base, located at 1605 3rd St in El Centro, is one mile east of Seeley and is served by U.S. Navy via an onsite water treatment facility with a capacity of 2 MGD. The Navy base is located approximately two miles uphill from Seeley in a

northeasterly direction. In order to consolidate with the Navy base, a new booster station will have to be constructed, along with approximately 11,033 lineal feet force main line at an estimated cost of \$2.8 million. Consolidation with the Navy base may not be feasible due to military operations and potential security concerns.

Phasing of Water Facilities

The immediate water facility projects are near-term projects. No major capital improvement projects need to be programmed in phases beyond the Water Master Plan as the initial phase.

Mitigation for Water Facilities

In order for SCWD to assure adequate service to its water customers as development continues within the District boundaries and sphere of influence, the following measures should be implemented:

- W-1** The District shall maintain adequate reserves for the proper repair and maintenance of the distribution system.
- W-2** The District should continue to pursue various means by which to obtain funding and provide for adequate water treatment and distribution facilities for the existing and future residents of the District.
- W-3** The District shall evaluate impact fees to ensure fees are sufficient to support the costs of the projected expansion needs at the WTP.
- W-4** The District shall develop a Water Master Plan, as funds become available, to ensure that new development will construct water main lines to be compatible with the water distribution system.
- W-5** New Development shall continue to be held responsible for constructing adequate water distribution system facilities and the fair share costs.

5.1.4 Park and Recreational Facilities

Unincorporated communities such as Seeley are usually served by the County for parks and recreation services and facilities, however SCWD owns and actively seeks funding for improvements to Robert Bates Memorial Park. The community park is leased out to Imperial County for operation and maintenance. Sunbeam Lake Park, owned and operated by the County of Imperial as a regional park, is also located within the boundaries of SCWD and is available to its residents.

Performance Standard for Recreational Facilities

The Seeley County Water District has not adopted a performance standard ratio and relies on the County’s adopted standard which is larger than the State’s minimum ratio for park facilities of three acres of park space per 1,000 persons. The locally adopted standard is higher than the Quimby Act of 1975 and uses a service ratio of five (5) acres of parkland per 1,000 persons.


Inventory of Existing Recreational Facilities

There are over 70 acres of park facilities in the Seeley community (slightly over 11 acres are improved). They consist of two recreational facilities: 1) Robert Bates Memorial Park which is located at the northwest corner of San Diego Avenue and Park Street and 2) recreational area known as Sunbeam Lake Park located at 1750 Drew Road. **Table 5-K** lists the parks in Seeley with respective acreage while **Exhibit 5-F-SCWD Park and Recreational Facilities Map**, delineates park locations throughout the District’s Service Area.

**Table 5-K
SCWD Existing Parks**

| Park Name | Owner | Location | Size |
|--------------------------------|--------------------|------------------|-----------------|
| Sunbeam Lake Park | County of Imperial | 1750 Drew Road | 66.55 AC |
| Robert Bates Memorial Park | SCWD | 1826 Park Street | 3.58 AC |
| Total Acres of Parkland | | | 70.13 AC |

Robert Bates Memorial Park- The park is centrally located in Seeley at 1826 Park Street. It is important to note that both the fire station and the park are located on the same 4.13-acre parcel, but for the purposes of the Service Area Plan, Robert Bates Memorial Park is 3.58 acres in size. Amenities include a large playing field, playground equipment and a basketball court.

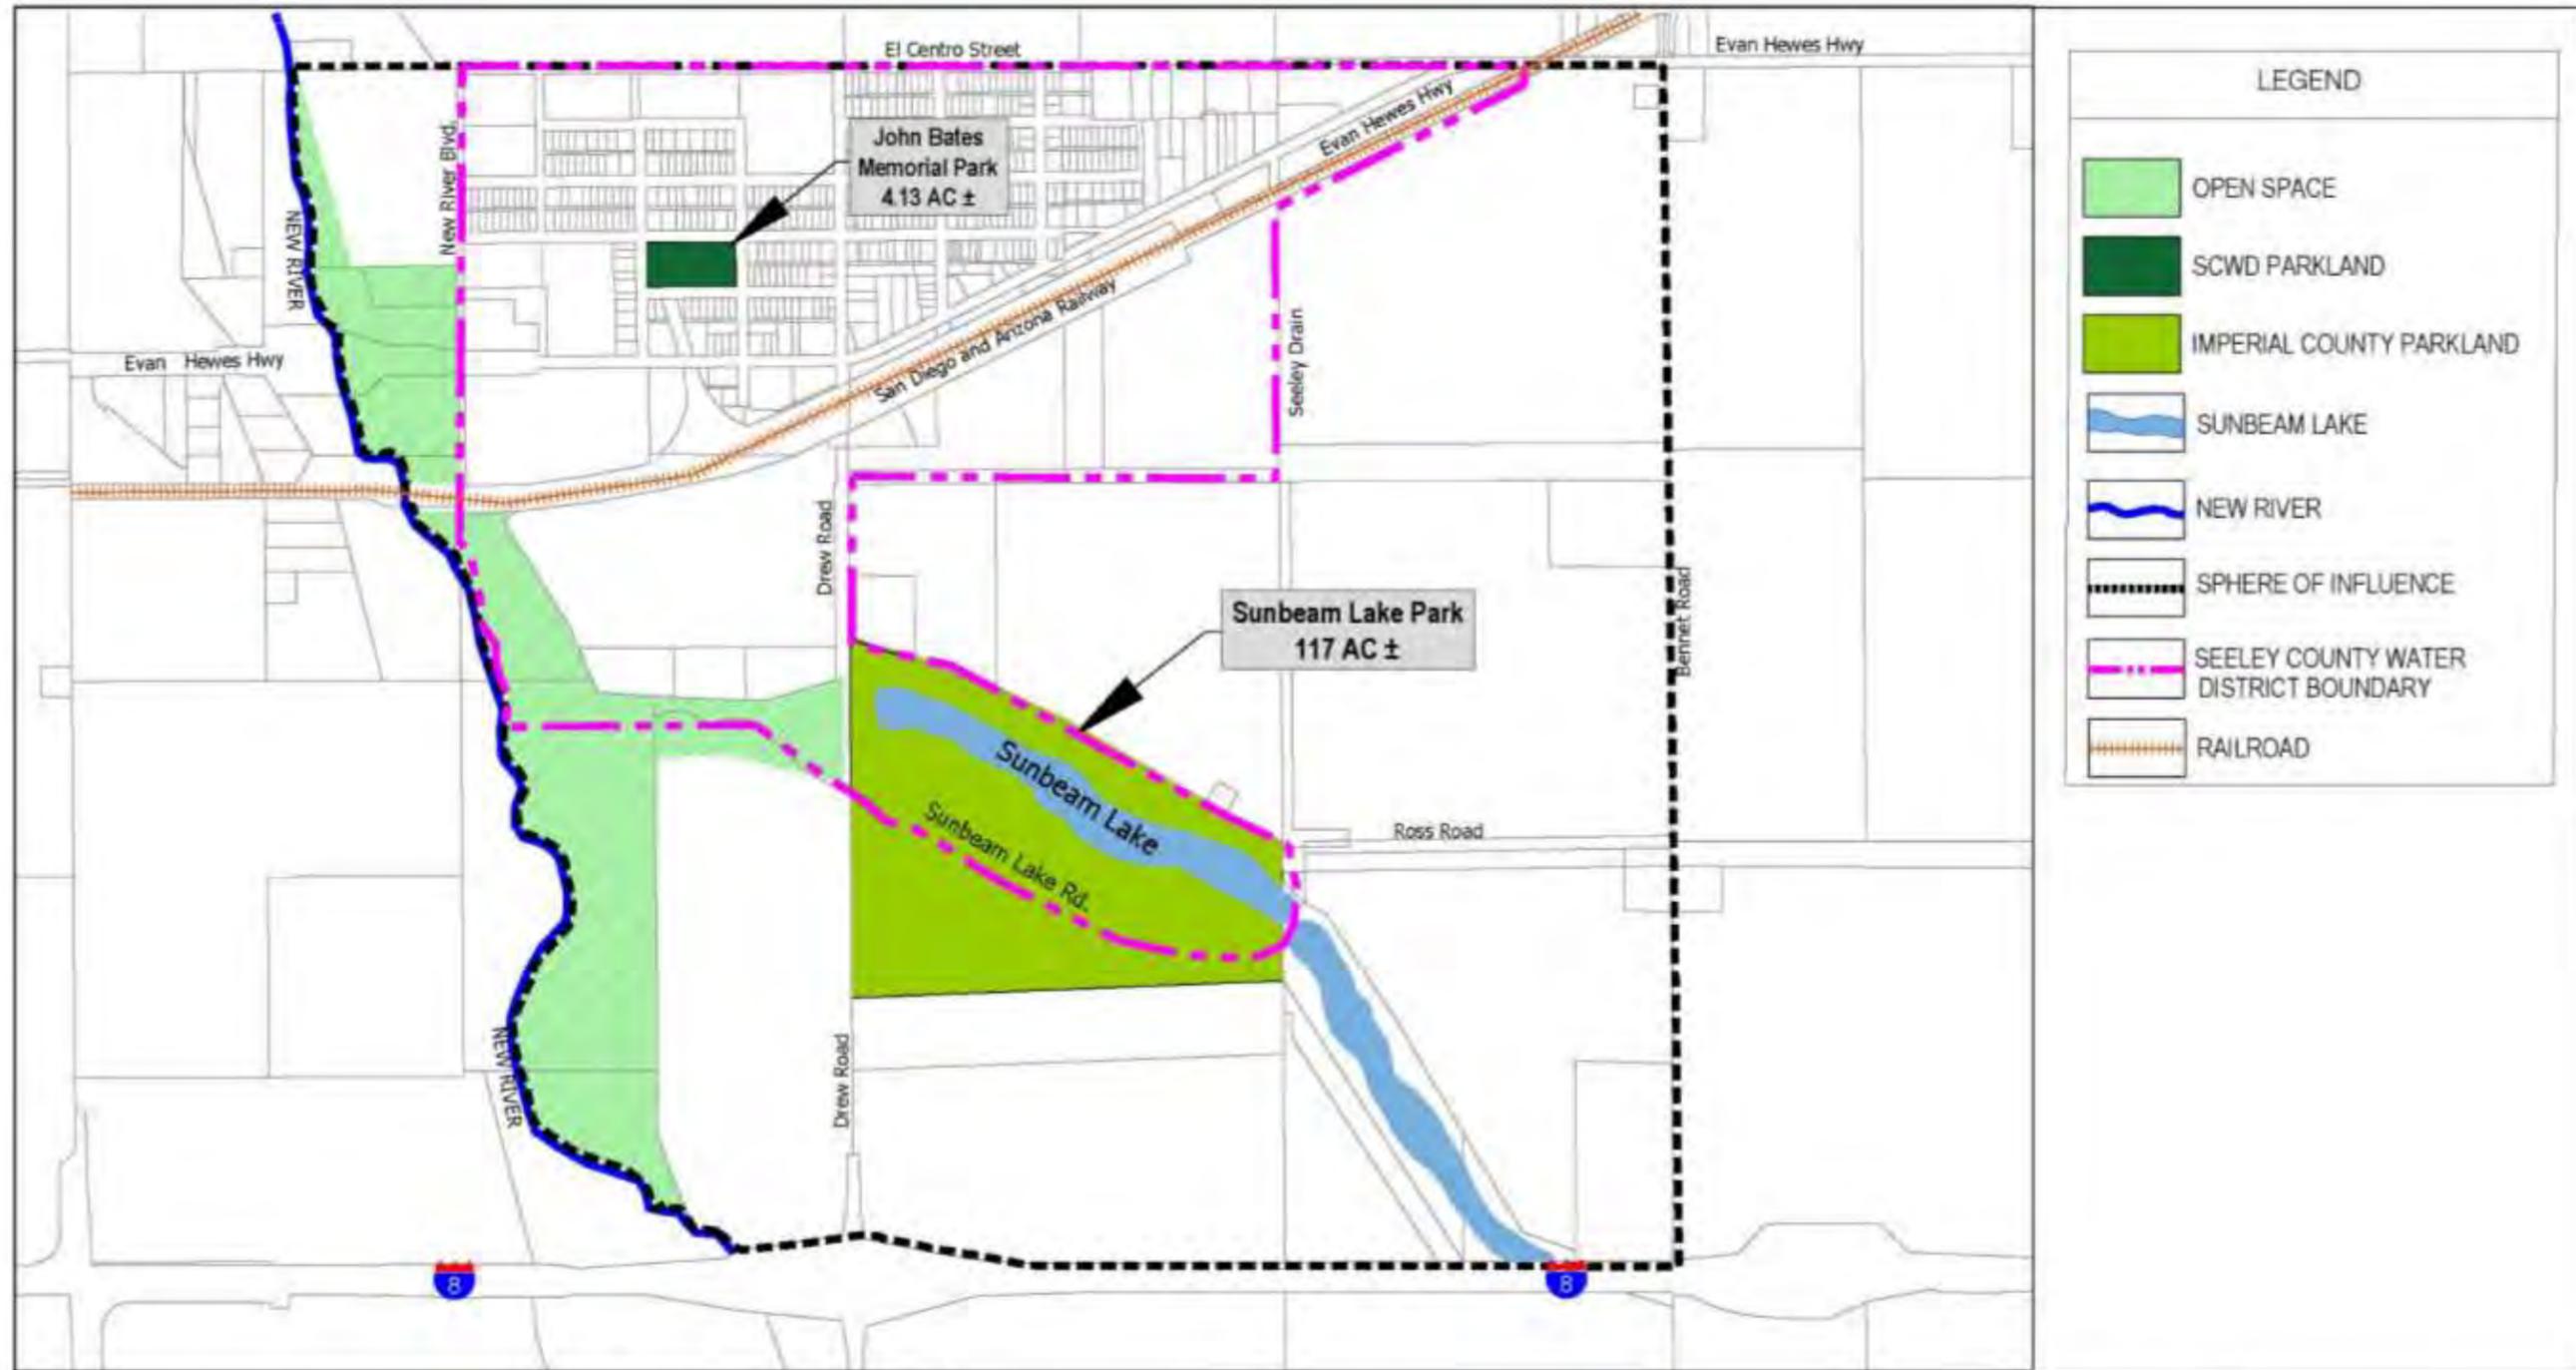

| | | | |
|---|--|---|--|
| <p>The Holt Group, Inc. •ENGINEERING •PLANNING •SURVEYING</p> |  <p>NOT TO SCALE</p> | <p>PARK AND RECREATIONAL FACILITIES MAP SEELEY COUNTY WATER DISTRICT</p> | <p>EXHIBIT 5-F</p> |
| <p>1601 NORTH IMPERIAL AVENUE EL CENTRO, CALIFORNIA 92243</p> | <p>760-337-3883</p> | | <p>PROJECT NO: THG 1186.008 DATE: July 2017</p> |

Sunbeam Lake Park is located partially within SCWD's service boundaries and serves as a regional park for all of Imperial County. Amenities at the park include a man-made lake available for fishing and limited boating, improved playing fields for basketball, soccer, baseball, and BMX, covered playground, and a walking trail. Although the park is located on 117 acres of land, only 66.55 acres is included in the inventory. The remaining portion of the parcel is occupied by a gated, private RV resort. The baseball fields are home to the Sunbeam Little League while the BMX area is home to Imperial Valley BMX.

School Facilities - Seeley School contains a playing field, running track, and playground equipment, but the space area is restricted to student use during school hours. Community groups may request use of the facilities subject to the discretion of the school district and as long as the use does not interfere with class hours.

Adequacy of Existing Park and Recreational Facilities

Residents of the District have 70.13 acres of parkland available to them. With an existing population of 2,140 people, the park ratio is 32 acres per 1,000 persons. Due to the proximity of Sunbeam Lake Park, the park ratio exceeds the County standard of five (5) acres per 1,000 persons. The National Recreation and Parks Association (NRPA) published park location, size, and amenities standards in 1970 and is still widely used. The NRPA recommends that a neighborhood park of 1-2 acres in size for every 1,000 residents be located within a half-mile radius of all residential uses. Those dwelling units to the east of Heil Avenue are just beyond the recommended half-mile radius. NRPA standard further require certain amenities based on population size. For example, one (1) picnic shelter and one (1) playground equipment should be provided for every 2,000 residents, but the NRPA also recommends one (1) tennis court for every 2,000 residents. Most communities will use NRPA standards as a starting point in determining the type of amenities required. Neither Seeley nor the County of Imperial have adopted specific park development standards. Although the NRPA recommends a park every half-mile, this standard can not be applied in every situation and the distribution of parkland for Seeley is adequate given its population size.

Inventory of Approved Recreational Facilities

Robert Bates Memorial Park- the SCWD received a \$150,000 from the Imperial Irrigation District Local Entity Grant Program for park improvements. The District proposes to install lighting, shade structure, pedestrian walkways and drinking

fountain. The District has further budgeted for a Master Plan Development in efforts to assist with future funding.

Sunbeam Lake Park-There are nine (9) acres of Sunbeam Lake park area that are proposed to be developed as part of the Sunbeam Lake Estates development project. Proposed improvements include shade structures, tot lot and play ground areas, picnic areas, bike racks, BBQ grills, lighting and dock area. Trees, plants and a landscaped retention basin area are also proposed.

Buildout Demand for Recreational Facilities

As previously noted, the performance standard for the District is currently 5 acres of parkland per 1,000 persons. Due to the size of the Sunbeam Lake Park, additional recreational facilities are not needed within the planning period. It is anticipated that the Seeley community will have a population of 9,212 by the year 2038 at which time the parkland demand would only be 40-45 acres, far less the current available acreage. At full buildout, the ratio would be 7.6 acres for every 1,000 residents.

Opportunity for Shared Recreational Facilities

As mentioned previously, Seeley School contains recreational amenities such as playing field, running track, and a playground but these are only available to students and by special permit. SCWD and the School District can enter into a Joint Use Agreement. The 6.7-acre field is approximately 1/8-mile from Robert Bates Memorial Park but does not provide the required half-mile for the residents east of Heil Avenue. Given the abundance of parkland for the current population and at buildout, the need for shared facilities is not necessary. There are no other parks within the vicinity of Seeley.

Phasing of Recreational Facilities

The only approved development project in the vicinity of SCWD is the Sunbeam Lake Estates residential subdivision with an anticipated buildout date of 2030. The subdivision is located outside of SCWD's current service boundaries but within its sphere of influence. The Mitigated Negative Declaration for the project states that the demand for additional parks and recreational services will be met by Sunbeam Lake Park and developers of Sunbeam Lake Estates will provide additional amenities at Sunbeam Lake Park to offset the impacts. Required improvements include additional playground equipment, shades, trees, sitting areas, BBQ tables, and landscaping. The timing and phasing of the improvements are to be determined at the time of residential development.

Mitigation for Recreational Facilities

The Seeley Parks and Open Space Facilities meet the established performance standards and are adequate in size and condition to continue to serve the current population. As new development is proposed, projects are required to incorporate park space per the performance standard of five (5) acres per 1,000 in population. It is anticipated that projects contributing to the population increase throughout a twenty (20) year planning term, will satisfactorily fulfill these requirements.

Although there is sufficient park space to support current and future population, the ability to maintain SCWD's own park and any future parks is an issue. SCWD should examine opportunities to generate revenues for park maintenance. In order for SCWD to assure adequate parks and recreation services, the following measures should be implemented:

- PR-1** The District should examine opportunities to generate revenues for park maintenance and the provision of recreational programs.
- PR-2** The District should continue to seek grant funding for capital improvements to the only neighborhood park-Robert Bates Memorial Park.

5.2 SERVICES PROVIDED BY IMPERIAL COUNTY

Given that the services provided by Seeley County Water District are limited, and that the District lies within an unincorporated area of Imperial County, there are numerous services provided by the County of Imperial including administration, transportation, fire protection, law enforcement, library facilities and to some extent, parks and recreation. Administration facilities and parks and recreation facilities through Imperial County have already been discussed indirectly in Section 5.1.1 and 5.1.4, respectively and will not be analyzed further. More detailed information regarding Imperial County administrative and parks and recreational services is available in the Imperial County Municipal Service Review and can be accessed through Imperial County's LAFCO or Imperial County's Website.

The following section discusses services provided directly by the County of Imperial within the Seeley County Water District boundaries and Sphere of Influence. The data collected for this discussion was obtained from Imperial County's Service Plan, prepared by Hofman Planning and Engineering in 2011. A cursory review is being provided for these services under this Service Area Plan Section.⁵

- **Fire Facilities-** Fire facilities include the fire station, and other support equipment including firefighting equipment such as fire engines, water tenders, and aircraft firefighting units. Fire facilities also include the staffing level needed to operate the aforementioned equipment and deliver emergency and fire-protection services.
- **Law Enforcement Facilities-** Law enforcement facilities include the sheriff's station, and other support facilities including patrol vehicles, the Imperial County jail, and the Coroner's office. Law enforcement facilities further includes the staffing level needed to provide law enforcement and protection services.
- **Library Facilities-** Library Facilities include the library space, the contents of the library as well as the Staff that manage the library. It also includes any support equipment such as computers, copy machines, and other office equipment that may be available to the general public.
- **Transportation Facilities-** Transportation facilities consist primarily of roadways including Local and State owned roadways. Transportation facilities may also include pedestrian facilities such as sidewalks.
- **Stormwater & Drainage Facilities-** Stormwater and drainage facilities consist primarily of storm-drain pipelines along roadways, open drain ditches, retention basins and any pumping facilities.

⁵ Although the Imperial County Municipal Service Review has been under review by Imperial County since January 2011, as of June 2017, Imperial County has not commented on the document. As such, the Municipal Service Review has not been adopted by LAFCo and has since been removed from LAFCo's project list.

5.2.1 Fire Facilities

Fire protection services are provided to the Seeley community by the Imperial County Fire Department (ICFD). The ICFD maintains and operates five (5) fire stations throughout the County of Imperial. Seeley is serviced by Imperial County Station #3, located at 1828 West Park Street in Seeley and was constructed in 1975.

Performance Standard for Fire Facilities

The National Fire Protection Association (NFPA) outlines performance standards related to deployment and organization of firefighting operations. NFPA 1710 recommends a response time of 8 minutes for first-alarm response and that each company be staffed with four (4) firefighters including a company officer. These standards are based on a typical 2,000 square-foot, two-story single-family residential structure. Personnel and equipment can be adjusted to ensure that the fire department can maintain the 8-minute response time.


Inventory of Existing Fire Facilities

Station #3 in Seeley is one of the second oldest fire stations within the County. The station sits on a 4 acre lot that is shared with Joh Bates Memorial Park, and is situated within a 3,974 square foot building located at 1828 West Park Street. Existing equipment at the station includes one (1) Type I Engine, and one (1) Type III Brush Engine. The Seeley Station is operated by three County employees at any given time. There are three (3) firefighters per shift, including one (1) captain. Their average response time is 8 minutes for the entire service area which encompasses 160 square miles. The average response time for the area is 6.5 minutes. These ratios of service and response are reasonable and acceptable. Please Refer to **Exhibit 5-G– Imperial County Fire Station Location and Service Area**, for the service area.

Adequacy of Existing Fire Facilities

The average response time of 6.5 minutes is well within NFPA's standard of 8 minutes, and according to the Fire Chief, the existing staffing levels are sufficient based on the current demands. Numerous factors affect response time including development densities, population intensity, building height, building materials, and roadway configuration. Infill development north of Evan Hewes Highway can be reasonably supported by Station #3 and its current equipment and personnel.

Response times south of Evan Hewes Highway can be affected by delays caused by the railroad. Although it is a rare occurrence, delays would affect residents of Sunbeam Lake RV Resort and the approved Sunbeam Lake Estates residential subdivision. Response time is also affected by Station #3's vast service area (see Exhibit 3-G) which is much larger than SCWD's service area.

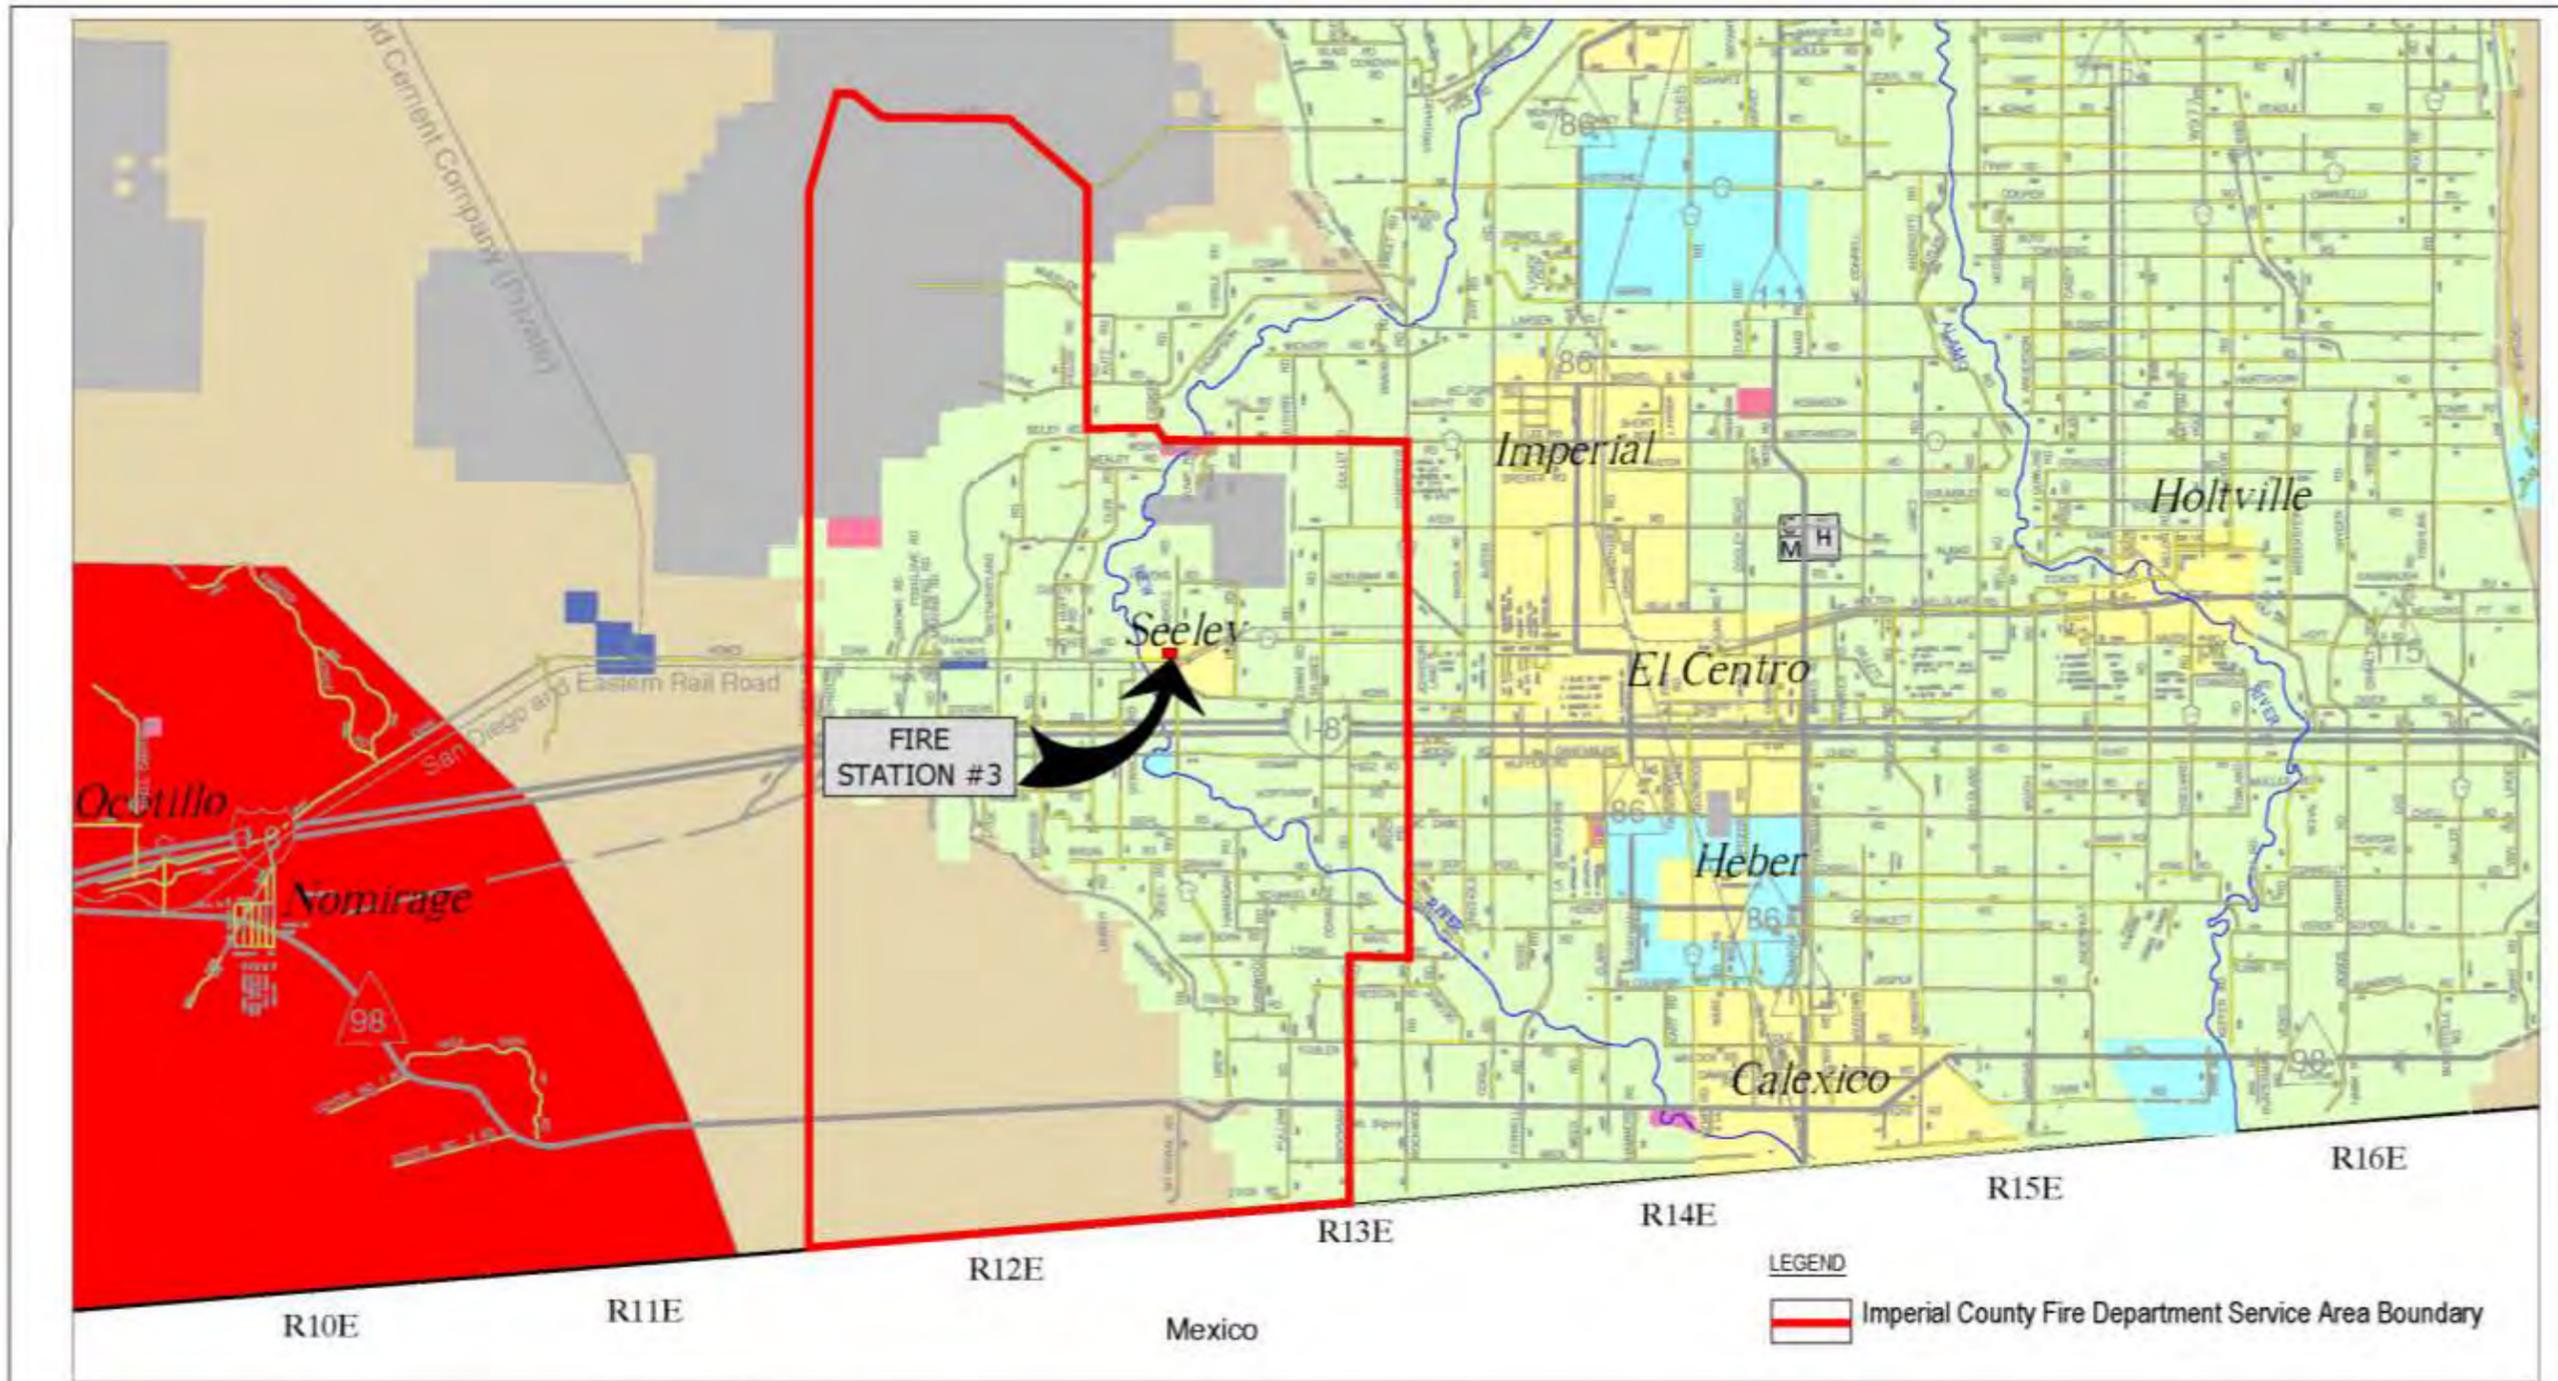

| | | | | |
|---|---------------------|---------------------|---|--|
| <p>The Holt Group, Inc. ENGINEERING PLANNING SURVEYING</p> | | <p>NOT TO SCALE</p> | <p align="center">IMPERIAL COUNTY FIRE STATION LOCATION AND SERVICE AREA</p> <p align="center">County of Imperial Municipal Service Review 2011</p> | <p align="center">EXHIBIT 5-G</p> |
| <p>1601 NORTH IMPERIAL AVENUE EL CENTRO, CALIFORNIA 92243</p> | <p>760-337-3883</p> | | | |

When the Fire Department is responding to call to the outer portions of its service area, no additional personnel is available to residents of Seeley thereby affecting response times. Mutual Aid Agreements with the El Centro Fire Department and the Naval Air Facility Fire Department can minimize delays in response time.

The most recently adopted Emergency Services Master Plan (2012) for the County Fire Department identified various deficiencies in the existing fire facility given the fact that it is one of the oldest fire stations in the county. Heating, ventilation, and air condition (HVAC) will need to be updated; the building needs to be painted; a back-up power generator needs to be installed; and the entire Station needs to be retrofitted to comply with the requirements of the Americans with Disabilities Act (ADA) and the Architectural Barriers Act (ABA). There are currently no plans to improve the facility until grants or other funding sources are secured.

Inventory of Approved Fire Facilities

There are no additional fire facilities planned for the Seeley community. Fire Station renovations will be planned as funding opportunities arise. Facility improvements that have been budgeted are the following: making all four apparatus doors operable, slate apparatus doors for electrical operators, provide central air conditioning, paint, apparatus floor repairs, repair subfloor, and add a new staircase. Improvements such as backup generator and improvements for ADA compliance have not been budgeted as funding is not currently available.

Buildout Demand for Fire Facilities and Services

Increased development places a strain on the services, personnel, and equipment of County Fire Station #3. As calls volumes increase, the Fire Department will experience an increase in emergency and non-emergency response times which compromises the ability of the Fire Department to provide life-saving services to the residents of Seeley. SCWD's Sphere of Influence is already within Fire Station #3's service boundary would still be able to respond to the needs of future population resulting from infill development and the approved Sunbeam Lake Estates residential subdivision. The Sunbeam Lake Estates Mitigated Negative Declaration identified a potential impact to fire facilities and services unless a Community Facilities District is formed to provide revenues to offset the cost of additional personnel and equipment at Fire Station #3.

The Sunbeam Lake Estates Mitigated Negative Declaration only identified an additional 1,411 residents resulting from the single-family units but did not analyze population increase resulting from the proposed multi-family development which can potentially add another 1,102 residents to Station #3's service area can call volume. Again, Mutual Aid Agreement can minimize delays in response time but call volume needs to be examined further.

Opportunity for Shared Fire Facilities

The Imperial County Fire Department Station #3 does not share facilities but is located on parkland owned by Seeley County Water District. Thus the current site is shared with a park facility. Imperial County Fire Department has Mutual Aid Agreements with the El Centro Fire Department and the Naval Air Facility Fire Department to provide personnel and equipment as needed in emergency situations.

Phasing of Facilities

There are currently no new fire facilities planned within the Seeley County Water District Sphere of Influence. Future improvements only involve building modifications and will not impact capacity.

Mitigation for Fire Facilities

The Imperial County Fire Department is responsible for the continuous monitoring of the adequacy of the existing Imperial County Fire Department facilities to ensure that adequate fire protection services are provided. Seeley County Water District, however, shall periodically monitor and ensure that adequate fire flow suppressions are maintained throughout the District for fire protection services. SCWD should also review all future residential developments within its Sphere of Influence to ensure that any new construction will not diminish Fire Station #3's ability to provide life-saving services to its residents.

5.2.2 Law Enforcement Facilities

Law enforcement services are provided to the Seeley community by the Imperial County Sheriff's Department. The County Sheriff's department maintains one headquarters office located in El Centro, and five substations located in Brawley, Niland, Palo Verde, Salton City, and Winterhaven. The nearest sheriff station to the Seeley population is the South County Patrol located at 328 Applestill Road in El Centro which is the main headquarters. The Sheriff's Department provides services to the entire unincorporated areas of Imperial County with a population of approximately 39,902 persons (Source: County of Imperial Municipal Service Review Draft #3, 2011). Services include patrol, criminal investigations, civil services, bailiff enforcement, correctional services, crime prevention, off-highway law enforcement, waterway enforcement, and dispatch services. The Sheriff's Department only provides service to the unincorporated County population as Cities have their own police departments, unless there is a mutual agreement in place. This section will discuss patrol services provided to the Seeley community by Imperial County only.

Performance Standard for Law Enforcement Facilities

A general industry standard for law enforcement services is one (1) officer per 1,000 persons. This standard is widely recognized and used by jurisdictions. However, given the characteristics of Imperial County such as geographical challenges, size, and the fact that it is an international border, this ratio appears simplistic. Nevertheless, the ratio is a quantifiable standard that can provide a general basis for levels of service specifically for patrol. The existing patrol officer to population ratio for the entire unincorporated County of Imperial is 1.43 patrol officers per 1,000 persons (p.44 of County of Imperial Municipal Service Review Draft #3, 2011) which has been determined as an adequate service ratio by Imperial County.

Inventory of Existing Law Enforcement Facilities

The sheriff's administrative facility that serves the Seeley community is approximately 23, 274 square feet and is responsible for civil services for the entire County of Imperial along with the previously mentioned five (5) substations. Staffing of the Sheriff's Office includes sworn and non-sworn positions. Of the sworn positions there is 1 sheriff, 1 undersheriff, 2 chief deputies, 3 sheriff lieutenants, 20 sheriff sergeants, 26 senior deputy sheriffs, and 55 deputy sheriffs. Of the non-sworn positions there is one scientific investigation supervisor, 2 identification technicians and 88 administrative and support staff (County of Imperial Municipal Service Review Draft #3, 2011) The sheriff's office operates on two 12-hour shifts over four patrol areas. For each shift there are 12 patrol officers and there are a total of 4 shift teams. These patrol areas are divided as follows,

South County, North County, Winterhaven, and Salton City. The Seeley community is patrolled by South County.

Adequacy of Existing Law Enforcement Facilities

The South County serving Sheriff's office is located at 328 Applestill Road in El Centro at an approximate 7-mile distance from Seeley County Water District. (Please refer to **Exhibit 5-H – Law Enforcement Location Map**). Given the existing level of service ratio of 1.43 law enforcement officers per 1,000 persons, which is well about the 1.00 officer per 1,000 standard, the current demand is 58 officers assigned to patrol duties. Given that there is a demand of 58 officers and that currently there are only 48 deputies dedicated to patrol, there is a deficiency of 10 officers. Based on input from the Sheriff's Office, the staffing shortage should be addressed by hiring 6 deputies and 2 sergeants (County of Imperial Municipal Service Review Draft #3, 2011).

Inventory of Approved Law Enforcement Facilities


Imperial County's Service Area Plan notes there are no-law enforcement facilities planned for within the Seeley County Water District or its Sphere of Influence. Upgrades to the Main Facility serving the South County Patrol Unit are planned and include a keyless entry system for security and access control, modernization of exercise rooms, replacement of roofs, and resurfacing of the parking lot. Improvements to equipment include installation of video recording in patrol units.

Buildout Demand for Law Enforcement Facilities and Services

There are no new law enforcement facilities planned within the Seeley County Water District Sphere of Influence within the next twenty years. However, it is noted in the 2011 County of Imperial Municipal Service Review Draft #3, that a law enforcement substation be considered for the Gateway Specific Plan project area by 2030 to meet the projected demand in Heber. The development of such a substation may alleviate some of the shared demand to other coverage areas.

The Mitigated Negative Declaration (MND) for the proposed Sunbeam Lake Estates residential subdivision only analyzed the impacts resulting from single-family residences. The MND noted that there would be impacts to law enforcement services and facilities, but the formation of a Communities Facilities District (CFD) would alleviate those impacts through additional revenues for hiring additional personnel.

The MND did not analyze the impacts from the multi-family units within Sunbeam Lake Estates which can potentially add another 1,102 residents. There is already a deficiency in the county-wide demand for patrol officers. The buildout population of 9,212 residents would require seven (7) additional deputies.

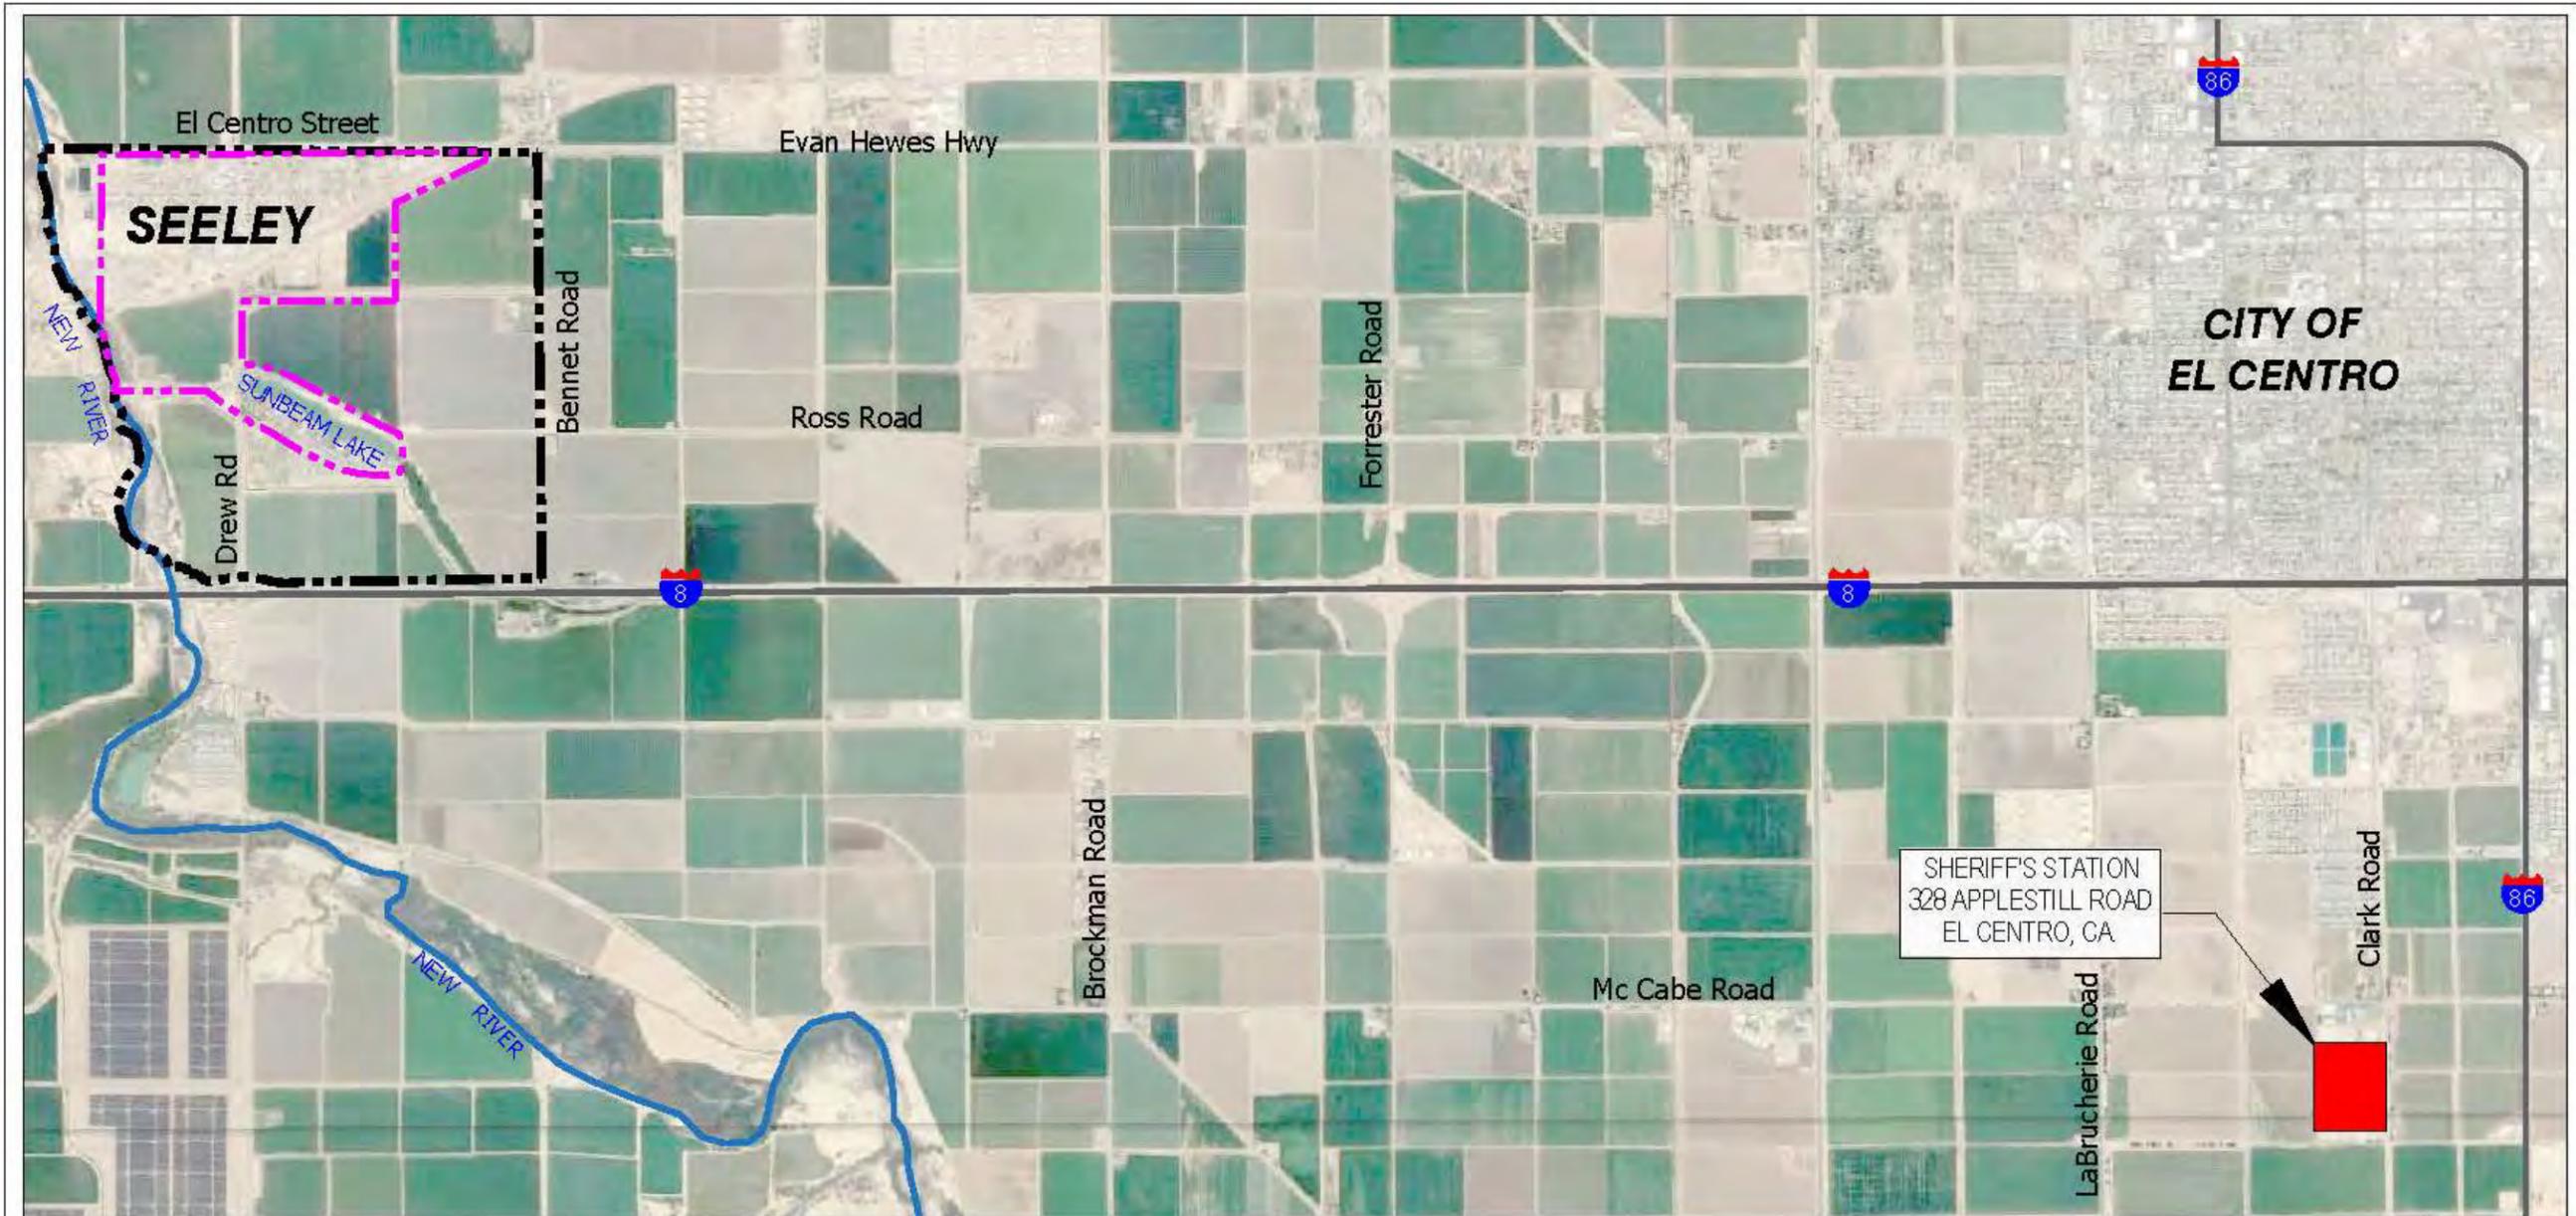

LEGEND:

- DISTRICT BOUNDARY
- SPHERE OF INFLUENCE
- IMPERIAL COUNTY SHERIFF STATION

| | | | | | | |
|--|---------------------|---------------------|---|---|---------------------------|------------------|
| <p>The Holt Group, Inc. •ENGINEERING •PLANNING •SURVEYING</p> | | <p>NOT TO SCALE</p> | <p>SEELEY COUNTY WATER DISTRICT LAW ENFORCEMENT FACILITIES LOCATION MAP</p> | <p>EXHIBIT 5-H</p> | | |
| <p>1601 NORTH IMPERIAL AVENUE EL CENTRO, CALIFORNIA 92243</p> | <p>760-337-3883</p> | | | <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 50%; padding: 2px;">PROJECT NO THG1186.009</td> <td style="width: 50%; padding: 2px;">DATE May 2017</td> </tr> </table> | PROJECT NO THG1186.009 | DATE May 2017 |
| PROJECT NO THG1186.009 | DATE May 2017 | | | | | |

Opportunity for Shared Law Enforcement Facilities

The Imperial County Sherriff's office does not currently have facilities in Seeley, and operate from the main Sherriff facility in El Centro. The call volume is relatively low and there is no need for a substation in Seeley, but Fire Station #3 can be used to house a report-writing desk to provide additional law enforcement presence in Seeley. At ultimate buildout, a substation may be necessary to address the increased population. A substation can be co-located with Fire Station #3.

Phasing of Law Enforcement Facilities

No new law enforcement facilities are planned during this 20-year period within the Seeley County Water District Sphere Influence nor within any proximity that would impact the service ratio to SCWD.

Mitigation for Law Enforcement Facilities

Periodic evaluations of law enforcement services are the responsibility of the Imperial County's Sheriff's Office. Evaluations should base service demand on not only population growth projections but incidents of crime, and emergency response times and service ratio of at least 1.2 patrol officers per 1,000 residents as noted in the 2011 County of Imperial Municipal Service Review Draft #3.

5.2.3 Library Facilities

The Imperial County Free Library (ICFL) formed in 1912 to serve the people of Imperial County who reside outside the city limits of Brawley, Calexico, El Centro and Imperial. There are currently four library branches open to the public in Calipatria, Heber, Holtville, and Salton City. The ICFL provides recreational and informational reading, audiotapes, some videos and DVDs, periodicals, and reference services to its patrons. Materials can be requested via interlibrary loan. Internet and public-access computers are available at most branches.

There are no libraries in Seeley. The nearest library to the Seeley is the El Centro Public Library located at 1140 North Imperial Avenue, El Centro, CA 92243, approximately 7.7 miles from Seeley.

Performance Standard for Library Facilities

The Imperial County Free Library does not have adopted performance standards for library facilities and the State Library system has not created standards. However, the State Library has definitions that provide a basis for facility needs and services. The County librarian provided the following information from the State Library:

- **Library Branch-** “A branch is an extension library, open at least five days a week, has at least 1,400 square feet of floor space, a general book collection of at least 7,000 volumes and staffed with at least one (1) librarian and one clerical employee during the hours open for service.”
- **Library Station-** “A station is a smaller version of a branch with one (1) separate quarters, a permanent basic collection of at least one established paid position and a regular schedule for opening to the public.”

The American Library Association, Subcommittee on Standards for Small Libraries published a brief 16-page report in 1962 outlining minimum space requirements for libraries serving population of less than 50,000. The report recommends that a 2,000 square-foot library is adequate to serve a population of under 2,499. The location of a library is also an important performance standard. The American Library Association recommends that patrons should be able to reach the library within 30 minutes travel in rural and suburban areas.

Inventory of Existing Library Facilities

Seeley County Water District does not have a library, nor does it have a library branch. The nearest public library is located in the City of El Centro, approximately 7.7 miles away. However, minimal library services are provided by the Imperial County Library team to the Seeley community on an average of two times per month. Light library services include story time for children and some books are brought to Seeley Community Church located at 1774 Rio Vista Street to be used

by patrons. The Brawley Public Library also provides a mobile library in the form of a 32' long specialty vehicle traveling throughout Imperial County giving underserved children ages 0-5 years and their parents access to literacy activities and services. The Literacy and Mobile Book Services (LAMBS) is outfitted with a wheelchair lift, a removable puppet stage, laptop computers with software for both parents and children, and ample shelf space to house the materials that will be available for parents and children to checkout and also for books that will be given to the children to keep at the end of each program.

Library Facilities Location

There are no facilities dedicated to Library resources in Seeley. The bi-weekly Light library services provided by the Imperial County Free Library are delivered at the Seeley Community Church located at 1774 Rio Vista Street.

Adequacy of Existing Library Facilities

Since there are no library facilities in Seeley, the limited service is considered inadequate due to the limited hours library services are brought in for the benefit of the public. The hours of service are the first and third Wednesday of each month from 5:30 pm to 6:45 pm.

Inventory of Approved Library Facilities

There are currently no planned or approved library facilities beyond the limited outreach services that are offered through Imperial County Library Services. As Seeley continues to grow, it may be necessary to plan for increased hours or for a full-service library branch. The Imperial County Free Library will be conducting a library needs assessment in late 2017 (Source: Crystal Duran, County of Imperial Librarian, April 11, 2017).

Buildout Demand for Library Facilities

The current Seeley population of 2,410 is unable to warrant a demand for a new facility. It is very likely that as the community grows within the next 20-year planning term, at minimum, the hours of operation for the Seeley Library Station will be extended. The Cities of Holtville (population 5,939) and Calipatria (population 4,019, excluding institutionalized population) have County Library branches. As Seeley approaches similar population size, a library branch in Seeley will be needed. The El Centro Public Library is within the 30-minute proximity recommended by the American Library Association but it is only able to serve El Centro's own resident population and cannot be counted as a resource to service Seeley residents.

Opportunity for Shared Library Facilities

Seeley does not have any dedicated library facilities but minimal services are collocated at the Seeley Community Church. Expanded hours and library materials

can continue to be housed at the Seeley Community Church. As Seeley's population increases, it may outgrow the Seeley Community Church and other shared facilities can be explored. Seeley School is an opportunity for shared library facility and its resources can be expanded through the inter-library loan program.

Phasing of Library Facilities

The County of Imperial does not propose any dedicated library facilities within the Seeley community during the planning period. It is likely that the hours of service will increase as the population increases and the demand for library services rises.

Mitigation

It is the responsibility of Imperial County to address the library service demand in unincorporated areas. As previously noted, the Imperial County Free Library will be conducting a library needs assessment in late 2017.

5.2.4 Transportation Facilities

Given that the Seeley County Water District area is within an unincorporated area of Imperial County, the information contained in this section is based on Imperial County’s Circulation & Scenic Highways Element which was updated in 2008. Seeley’s roadways and pedestrian facilities are maintained by the Imperial County Public Works Department with the exception of Interstate 8 which is maintained by the Federal Highway Administration through the State Department of Transportation (Caltrans).

Performance Standard for Transportation Facilities

The Circulation and Scenic Highways Element for the Imperial County has established a threshold of performance standards for the road segments located in the Seeley County Water District area. The Circulation Element identifies criteria upon which roadway capacity and flow are evaluated. The criteria are based on the level of service (LOS) classification system. The LOS is a professional industry standard by which the operation conditions of a given roadway segment or intersection are measured. LOS A indicates free flow of traffic with minimal vehicle delays, whereas LOS F indicates extreme congestion with significant delays. Refer to **Table 5-L – Roadway Performance Standard**.

| Level of Service | Table 5-L Roadway Performance Standard |
|------------------|---|
| LOS “A” | Represents free flow. Individual drivers have a high degree of freedom to select their travel speeds and are unaffected by other vehicles. |
| LOS “B” | Represents stable flow, but individual drivers are somewhat affected by other vehicles in determining travel speeds. |
| LOS “C” | Represents stable flow, but the selection of the speeds of individual drivers is significantly affected by other drivers. |
| LOS “D” | Represents a condition of high density, stable traffic flow in which speed and freedom of movement are severely restricted by the presence of other vehicles. |
| LOS “E” | Represents operating conditions at or near capacity. Individual vehicles have little free to maneuver within the traffic stream and any minor disruptions can cause a breakdown in the flow of traffic. |
| LOS “F” | Represents breakdown conditions. At this level of service, speeds are low, delay is high, and there are more vehicles entering the roadway than can be accommodated. |

It is the intent of the Imperial County that all roadways within unincorporated areas, including the Seeley County Water District area operate at a LOS “C” level or better. The criteria range is adjusted for the different street classifications depending on the street designation and thus designed capacity. **Table 5-M** describes the average vehicle trips that can be supported by the respective street classification in order to operate at LOS-C or better.

Table 5-M
Imperial County Standards Per Street Classification


| Street Classification | Average Daily Trips for Level of Service | | | | |
|-----------------------|--|--------|--------|--------|--------|
| | A | B | C | D | E |
| Highway/Expressway | 30,000 | 42,000 | 60,000 | 70,000 | 80,000 |
| Prime Arterial | 22,200 | 37,000 | 44,600 | 60,000 | 57,000 |
| Minor Arterial | 14,800 | 24,700 | 29,600 | 33,400 | 37,000 |
| Major Collector | 13,700 | 22,800 | 27,400 | 30,800 | 34,200 |
| Minor Collector | 1,900 | 4,100 | 7,100 | 10,900 | 16,200 |
| Local County | * | * | <1,500 | * | * |

Levels of service are not applied to residential streets since their primary purpose is to serve abutting lots, not carry through traffic. Levels of service normally apply to roads carrying through traffic between major trip generators and attractors.

Inventory of Existing Transportation Facilities

The circulation system within the Seeley County Water District is comprised of numerous grid style roadways under different classifications that are designed to accommodate varying traffic flows. Most local streets are oriented in a north/south and east/west grid style system and are not improved with curb, gutter or sidewalk. The Street Classification Map incorporated as **Exhibit 5-I** provides a visual display of the roadway system serving the Seeley community. The following is the identification of the different roadway classification and the applicable roadways within the Seeley Sphere of Influence that meet that respective classification:

Interstate Freeway-the main function of this roadway is to provide a system linking major cities within the contiguous states of the country. Features include high design standards with multiple travel lanes. The States own and operate the Interstate highway which means that the States establish the operating requirements, such as speed limits, and are responsible for enforcement. The following is a list of Interstates located within Seeley County Water District.

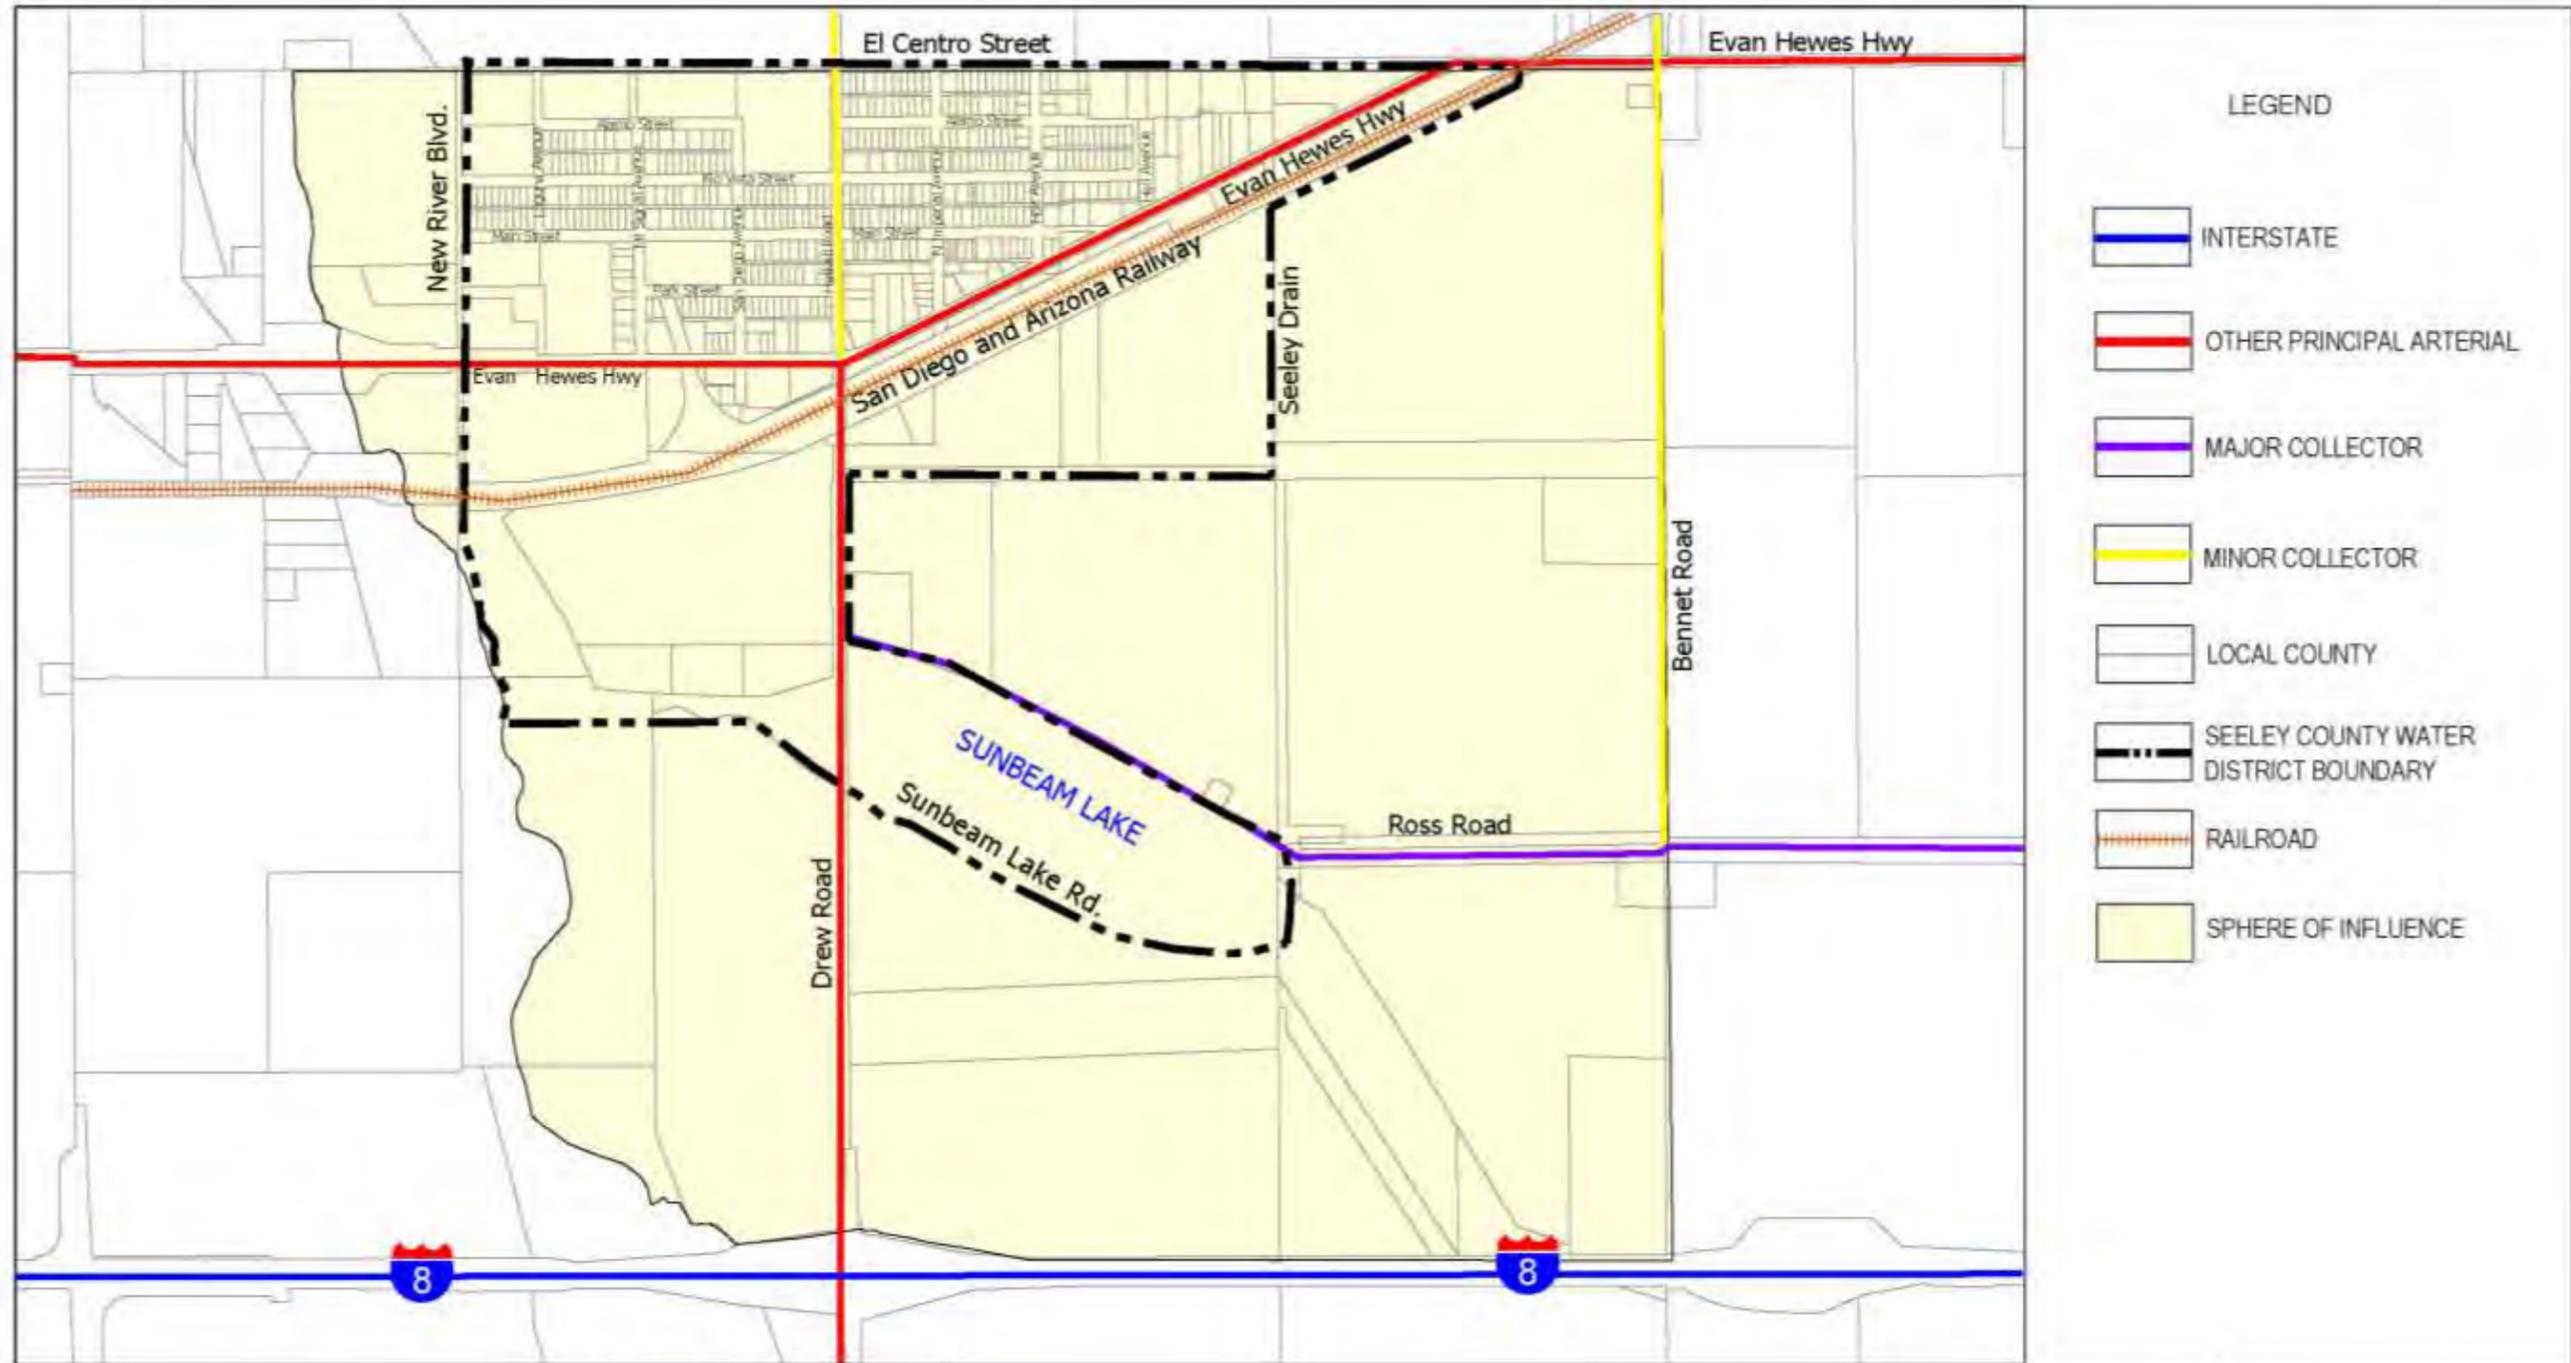

| | | | | |
|--|---------------------|------------------|--|--|
| <p>The Holt Group, Inc. ·ENGINEERING ·PLANNING ·SURVEYING</p> | | NOT TO SCALE | <p align="center">SEELEY COUNTY WATER DISTRICT STREET CLASSIFICATION MAP</p> <p align="center">Approved by Federal Highway Administration on 8/5/2011</p> | <p align="center">EXHIBIT 5-1</p> |
| <p>1601 NORTH IMPERIAL AVENUE EL CENTRO, CALIFORNIA 92243</p> | <p>760-337-3883</p> | | | |

- **Interstate 8-** The Interstate 8 (I-8) is the primary east-west route through Imperial County and runs for 350 miles from the Pacific coast to its terminus in Arizona where it intersects with Interstate 10. With two travel lanes, it spans 79 miles within the Imperial County. It serves regional, cross-border, and interstate traffic and provides access to desert recreational areas. According to Caltrans' latest traffic census from 2015 (source: <http://www.dot.ca.gov/trafficops/census/volumes2015/Route7-10.html>) the annual average daily traffic (AADT) volumes on I-8 is 13,800 west of Drew Road and 15,600 east of Drew Road.

Prime Arterial – The main function of this classification is to provide regional, sub regional, and intra-county travel services. Features include high design standards with four to six travel lanes, raised and landscaped medians, highly restricted access, which in most cases will be a one mile (1 mile) minimum, provisions for public transit lanes, including but not limited to bus lanes, train lanes, or other mass transit type means and no parking. The following is the prime arterial located within Seeley:

- **Evan Hewes Highway** – Evan Hewes is an east/west roadway paralleling Interstate 8 to the North at an approximate distance of 2 miles. It was originally commissioned in 1926 as part of US Route 80 which was the first all-weather coast-to-coast route available to auto travelers. US 80 was gradually decommissioned between 1964 and 1974 as I-8, through San Diego and Imperial counties, was completed. The roadway eventually became Evan Hewes Highway connecting the communities of Ocotillo, Plaster City, Seeley, and El Centro. Daily traffic volumes range from 300 ADT in the Ocotillo vicinity to 9,000 ADT just east of the El Centro city limits. Most portions of this facility are constructed with one travel lane in each direction as within the community of Seeley. All commercial development in Seeley is located along Even Hewes Highway.
- **Drew Road (S29)** – Drew Road is a north/south roadway connecting Evan Hewes Highway to State Route 98 in the south spanning an approximate distance of 8.1 miles. Drew Road becomes Haskell Road through Seeley and continues on for another 1.6 miles connecting to Havens Road which extends to the Naval Air Facility. Currently this roadway is a two lane undivided roadway and provides access to Interstate 8 via a diamond-type interchange with stop sign controls at the east and westbound off ramps. Drew Roads carries 2,400 and 1,300 ADT north and south of Interstate 8, respectively.

Major Collector (Collector) – These roadways are designed for intra-county travel as a link between the long haul facilities and the collector/local facilities. The following is a list of the major collectors located within Seeley:

- **Ross Road** – A two lane east-west roadway that begins at Drew Road and runs approximately 17 miles to the east connecting Seeley and Sunbeam Lake with El Centro and the outskirts of Holtville. The primary land use on Ross Road in Seeley is Sunbeam Lake. Ross Road is proposed for a re-alignment to accommodate residential development within the approved Sunbeam Lake Estates.

Minor Local Collector (Local Collector) – These roadways are designed to connect local streets with the adjacent Collectors or arterial street system. The following is a list of the local collector located within Seeley:

- **Haskell Road** – A two lane north-south roadway that begins as Drew Road south of Evan Hewes Highway and terminates at Havens Road to the north connecting to the Naval Air Facility. Commercial uses are located at the intersection of Haskell Road and Evan Hewes Highway. Haskell Road also passes by the Seeley School. Otherwise, Haskell Road is primarily residential.
- **Bennett Road** – A two lane north-south roadway that begins at Ross Road and terminates at the Naval Air Facility. Bennett Road serves as the eastern boundary of Seeley's Sphere of Influence and collects traffic from Ross Road and Evan Hewes Highway to deliver traffic to and from the Naval Air Facility.

Residential/Local Street – The remainder of streets in Seeley are classified as (residential) local streets which provide direct access to abutting properties and to give access from neighborhoods to the Collector Street system.

Alternative Transportation

Pedestrian facilities such as sidewalks or transit facilities are also considered transportation facilities. Pedestrian facilities are owned and maintained by the County of Imperial while Transit Facilities are owned and maintained both by local jurisdictions and the Imperial County Transportation Commission.

Pedestrian Facilities- Imperial County was awarded grant funding via the Safe Routes to School grant program. The overall purpose of the grant was to improve the safety of the students who walk to school and bike to school. It was determined that various sidewalks in Seeley were absent, substandard and/or required linear improvements, and that Seeley was lacking bicycle parking within the community. (Source: IC Safe Routes to School Master Plan,

2016. The following is a listing of pedestrian project priorities for Seeley, and their current status:

1. Sidewalk improvements on Rio Vista Street from Laguna Avenue to Holt Avenue. *Only San Diego to Imperial Avenue was completed.*
2. Sidewalk improvements along south side of El Centro Street from Haskell Avenue to Holt Avenue. *Holt to 1400' east were completed.*
3. Sidewalk improvements along the west side of Haskell Road from Rio Vista Street to Evan Hewes Highway. *Completed between Rio Vista and Alamo.*
4. Sidewalk improvements along the east side of Haskell Road from Park Street to Evan Hewes Highway. *Not Completed yet.*
5. Sidewalk improvements along both sides of Evan Hewes Highway from Mount Signal Avenue to Haskell Road. *Not Completed yet.*

Transit Facilities-The Imperial Valley Transit Services is an inter-city fixed route bus system subsidized by the Imperial County Transportation Commission. Existing ridership averages approximately 70,000 passengers a month (Source: ICTC, 2016). There is one IV Transit stop in the Seeley community, at the intersection of Evan Hewes Highways, and Haskell Road. Bus Line 4 starts and ends in Seeley and connects Seeley to El Centro where transfers can be made to other bus routes to connect to the rest of the county. A bus shelter is available on the east side of Haskell Road.

Freight Facilities

Seeley is traversed by a non-passenger, freight only rail system. Union Pacific owns the rail lines through Seeley connecting freight from all points east and Mexico to San Diego.

Adequacy of Existing Transportation Facilities

Roadways-Per the Imperial County Circulation Element, updated in 2008, all roadways within the Seeley Sphere of Influence are operating at a Level of Service C or better. As areas within the District and Sphere of Influence continue to develop road improvements to accommodate the existing and projected demand will be necessary. Future roadway improvements will be required to be constructed to the design standards set forth by the County of Imperial.

Roadway conditions are evaluated by the County of Imperial. Imperial County prepared a Pavement Management Report in February of 2012. Under the report, roadway improvement projects were identified based on condition. There are three steps to the pavement management process; 1) system configuration, 2) field surveys, and 3) analysis and reporting. System configuration involves identifying all roadways in the County's network where they are given an identification number, noting their physical characteristics such as length and width, pavement

type, traffic, and functional classification. The second step of the pavement management process is field surveys. Pavement Management Software uses a Laser Road Surface Tester (Laser RST) which observes the condition of the pavement surface, collects digital imagery, and spatial coordinate information. Data collected by the Laser includes rutting, roughness index which measures bumps per mile, and surface distress index which observes the extent and severity of the distress on pavement. The final step is Analysis and reporting which creates a single score that represents the overall condition of the pavement known as the Pavement Condition Index (PCI). The PCI adds thirty-three percent (33%) of the roughness index and sixty-seven percent (67%) of the surface distress index to provide a range. PCI ranges are divided into the following six descriptions: 100-85 are described as excellent, 70-85 are described as very good, 60-70 are described as good, 40-60 are described as fair to marginal, 25-40 are described as poor, and 0-25 are described as very poor. The PCI is used along with the priority weighting factor (PWF) to determine the priority ranking of each road way as shown in the following formula: $Priority = (100 - PCI) \times PWF$. The priority weighting factor (PWF) are predetermined numbers used by the County which gives emphasis to arterial roadways, and is followed by residential road ways, and leaves collector roadways with the lowest priority weighting factors.

The Pavement Management Analysis determined that certain roadways within the Seeley community necessitated improvement (See **Appendix B**). Roadways assessed within the Seeley County Water District include but are not limited to the following:

| | | |
|-------------------------|-------------------------|---------------------------|
| Alamo Street | PCI = 26, 38, 46 | Rehabilitated 2012 |
| El Centro Street | PCI = 20, 32 | Rehabilitated 2012 |
| Haskell Road | PCI = 24 | Rehabilitated 2012 |
| Heil Avenue | PCI = 14 | Rehabilitated 2012 |
| Holt Avenue | PCI = 27, 36 | Rehabilitated 2012 |
| Laguna Avenue | PCI = 30, 55 | Rehabilitated 2012 |
| Main Street | PCI = 26, 44, 43 | Rehabilitated 2012 |
| Mount Signal | PCI = 52 | Rehabilitated 2012 |
| New River | PCI = 44 | Rehabilitated 2012 |
| Imperial Avenue | PCI = 48, 57 | Rehabilitated 2012 |
| Rio Vista Street | PCI = 20, 35 | Rehabilitated 2012 |
| San Diego Avenue | PCI = 37 | Rehabilitated 2012 |

The entire street system in the Seeley Townsite was improved (rehabilitated in 2012). The streets received a 1 inch A.C. leveling course followed by an asphalt rubber aggregate membrane (ARAM) followed by a slurry sealcoat at a cost of approximately \$2 Million dollars due to the level of disrepair. The Holt Group, Inc. completed a windshield survey of the Seeley Street System in August 2017. The street surface was found to be generally in good condition except that cracking is

evident on the street surface. Cracking is evident throughout the entire street system. Although cracking is unsightly, the pavement surface is presently in good condition, the street sections are smooth and “ride” adequately and the street system should last for 10 to 15 years if adequately maintained.

It should be noted that although the pavement cracks did not pose a significant pavement surface problem, at the time of the field review, the cracks will result in a significant deterioration of the pavement if not addressed within a short time period. Cracks allow water to enter the subbase of the street and ultimately result in the alligator cracking and complete failure of the pavement. Crack Sealing is regarded as street maintenance work and can be completed relatively inexpensively at an estimated construction cost of \$200,000 (including design, bidding and construction management services). It is recommended that the 7.2 mile Seeley Street System be crack sealed as soon as possible and no later than June of 2018 to prevent the deterioration of the pavement surface. As time goes on the cracks will continue to increase in length and width. It is estimated there are approximately 250,000 lineal feet of cracks at this time.

It is important that these roadways be maintained at least every four years to prevent fast paced deterioration. Since the County has not adopted a Capital Improvement Program for roadway maintenance it is unknown as to when the next roadway maintenance will occur.

Sidewalks-There are minimal sidewalk facilities in Seeley. It is estimated that over 9,080 lineal feet (1.72 miles) of sidewalk are needed along school routes, the community park and developed neighborhoods. Accessible curb returns are also part of the need in conjunction with the sidewalks. Sidewalks should be constructed consistent with the County of Imperial Development Standards and concurrent with curb and gutter along paved streets. The community however is also lacking curb and gutter as discussed in the Stormwater & Drainage Section.

Buildout Demand for Transportation Facilities

Roadways are improved as development occurs and needs are determined under the environmental review process. Imperial County is responsible for ensuring that developers construct required street improvements associated with each project and/or impacted by each proposed development. Sunbeam Lake Estates residential development will generate approximately 14,611 trips per day with 639 vehicles per hour during morning peak hour and 1,393 vehicles per hour during afternoon peak hour at project buildout. The project is required to complete ultimate half-section street improvements on Drew Road and full ultimate cross-section street improvements for the re-alignment of Cross Road with signalization of Drew Road at Ross Road.

Opportunity for Shared Transportation Facilities

The Seeley community mainly uses County roadways with little opportunity for facility sharing with other agencies. The San Diego and Arizona Eastern Railroad system, however, may pose an opportunity for a shared facility. Passenger rail service is being studied to provide service between El Centro and San Diego. It presently provides freight rail service only between El Centro and the US Gypsum plant in Plaster City.

Phasing of Transportation Facilities

It is procedural that new improvements to transportation facilities be provided during the development process. As previously noted, the Sunbeam Lake Estates residential development is required to complete street improvements on Drew Road and Cross Road. The improvements must be completed during the first phase of the project (single-family residential development). The signalization of Evan Hewes Highway and Drew Road is not required until project buildout.

Mitigation for Transportation Facilities

Cooperative efforts between the District and the County will ensure that transportation facilities are adequately maintained and upgraded to prevent service deterioration. Additionally, Imperial County has adopted procedures and development standards in place for facility adequacy from new development.

5.2.5 Stormwater & Drainage Facilities

The primary purpose of maintaining, planning, designing and constructing drainage facilities is to control flooding. Generally, in urbanized areas, stormwater is collected through a network of surface (roadway) gutters and stormwater pipelines. In some cases, stormwater is deposited to a retention basin where it percolates into the ground. Stormwater can also be directed to a detention basin where it is held before it is discharged into IID drainage canals which ultimately drain into the Alamo River or New River, both of which are a tributary to the Salton Sea. In Seeley, surface drainage facilities are part of the street system which is a responsibility of the County of Imperial.

Performance Standard for Drainage Facilities

The County of Imperial adopted design standards for specific components of drainage systems, but there are no adopted performance standards. The goal of any drainage system is to prevent or minimize the impacts of flood conditions that would adversely affect residences and businesses. Requirements established by the National Pollution Discharge Elimination System, Colorado River Basin Water Quality Control Plan, and the Federal Emergency Management Agency (FEMA) affect the local drainage system. Since most of the stormwater discharges onto IID drainage canals, certain IID requirements must also be followed.

The County typically evaluates drainage conditions of for all new development and for the project site and requires the construction of any necessary drainage infrastructure. The County requires developers to construct all drainage facilities within each project as a condition of approval. Additionally, a drainage study be conducted by a registered civil engineer and submitted for review and approval by Imperial County and the IID prior to approval of a final subdivision map, a grading plan or development permit.

Inventory of Existing Drainage Facilities

Seeley's drainage facilities are primarily composed of non-engineered drainage swales adjacent to all roadways. There are currently no underground catch basins or stormwater pipelines with the original Seeley Townsite. The drainage system generally flows from east to west and ultimately discharges onto the New River via overland flow on natural terrain features along Evan Hewes Highway and north of the wastewater treatment plant. Although there are sporadic curbs and gutters throughout Seeley, the only sizeable curb and gutter system that conveys stormwater is located on the western part of town, specifically, on the east side of the entire length of Laguna Avenue, on the south side of Rio Vista Street between Laguna and New River Boulevard, and on the east side of New River Boulevard. A stretch of curb and gutter also exists on the south side of El Centro Avenue from Holt Avenue to a point approximately 1,400' to the east.

In urbanized areas, retention or detention basins are used to minimize overflowing conditions on regional drainage systems that ultimately flow to a natural body of water. Because of Seeley's size and proximity to the New River, there are no retention or detention basins, but according to the 2010 Drainage Master Plan prepared for County of Imperial (see **Appendix C**) several topographic low spots and isolated drain inlets function as impromptu retention facilities due to lack discharge locations. The topographic low spots are located on the south side of El Centro Avenue in front of the water treatment facility spanning approximately 1,300'; at the intersection of Imperial Avenue and El Centro Avenue; and at the intersection of Holt Avenue and Alamo Street.

Drainage within the Sunbeam Lake Park area sheet-flows onto IID's drainage system before it ultimately discharges to the New River. Sunbeam Lake itself acts as a retention basin with a drainage outlet connecting to a drain extending east across Drew Road and connecting to the New River.

Inventory of Approved Drainage Facilities

The 2010 Drainage Master Plan identified seven (7) prioritized improvement recommendations to convey a 25-year storm event. None of these recommendations are currently planned for construction due to lack of funding.

The Sunbeam Lake Estates residential subdivision includes a network of curb-and-gutters, stormwater pipelines, and a 5.2-acre retention basin to address the subdivisions drainage impacts. Stormwater from the subdivision will then discharge onto IID's drainage system.

Adequacy of Existing Facilities

Imperial County participates in the National Flood Insurance Program (NFIP) which is managed by the Federal Emergency Manager Agency (FEMA). The Flood Insurance Rate Map (FIRM), effective September 26, 2008 identifies portions of the New River as a Zone A floodplain subject to inundation by the 1-percent-annual-chance flood event. The area immediately surrounding Sunbeam Lake is also identified as Zone A. The remaining portions of Seeley's service boundaries and Sphere of Influence is within Zone X where flood hazard is minimal and higher than the elevation of the 0.2-percent-annual-chance flood.

Standing water from nuisance water and the occasional rainfall has been observed and indicates deficiencies in the drainage system. Drainage swales are not maintained and erosion over time has changed the slopes and carrying capacities of those slopes. Construction of driveways across surface drainage flowlines have also impeded the flow of water. Recommendations from the 2010 Drainage Master Plan indicate there are deficiencies in the system that must be addressed. The following **Table 5-N** summarizes the recommended improvements and the estimated project costs, in order of priority.

**Table 5-N
Recommended Drainage Improvements**

| Project ID | Location | Pipe Sizes | Total Length | Number of Inlets | Estimated Cost |
|--------------|--|------------|--------------|------------------|---------------------|
| SD-01 | Rio Vista Street, Haskell Road, San Diego Ave | 36'-84" | 4,512 FT | 12 | \$7,828,700 |
| SD-02 | Rio Vista Street, Imperial Avenue | 24"-72" | 1,853 FT | 8 | \$2,096,700 |
| SD-03 | San Diego Ave, Park Street | 36"-48" | 1,547 FT | 9 | \$1,110,700 |
| SD-04 | Rio Vista, Holt Ave, West Main, Evan Hewes HWY | 36"-60" | 1,769 FT | 5 | \$1,619,900 |
| SD-05 | Holt Avenue, El Centro Street | 36"-48" | 2,228 FT | 8 | \$1,619,500 |
| SD-06 | Laguna Avenue | 36" | 804 FT | 4 | \$555,700 |
| SD-07 | Evan Hewes Highway | 36"-48" | 3,477 FT | 5 | \$3,210,400 |
| Total | | | | | \$18,041,600 |

Buildout Demand for Drainage Facilities

Development activity alters natural slope and the decrease of pervious areas which lead to additional runoff. As development occurs, stormwater drainage systems must be installed to ensure adequate removal of runoff. Developments will be required to construct grass lined detention basins to retain stormwater that may be generated by a 100-year, 24-hour storm. Stormwater will be discharged into existing drains upon the IID’s approval. Some development projects will also be required to relocate and underground the existing canals and drains within their project areas to satisfy Imperial Irrigation District requirements.

Opportunity for Shared Drainage Facilities

The primary drainage system within the SCWD service area is managed by IID and is not intended to convey stormwater generated by urban runoff, although some storm water does flow into the IID drainage system as previously noted. The County of Imperial, Imperial Irrigation District, and Seeley County Water District maintain different components of the total drainage system which in essence are connected and shared facilities.

Future planned detention basins could be used for joint use as parks. However, that would require public ownership of the basins by either the Seeley County Water District or the County of Imperial, both of which have no established revenue source for the ongoing maintenance and repairs that would be needed over time.

Phasing of Drainage Facilities

The construction of future storm water drainage facilities is based on the rate of new development. Additional storm water drainage facilities will be needed in the proposed development areas in order to properly convey storm water into the IID drainage system. The storm water systems will be determined during the Tentative Map and designed during the Final Map stage of development. The stormwater systems will be approved by the County of Imperial and Imperial Irrigation District.

Mitigation for Drainage Facilities

Imperial County will continue to review all development proposed, prior to development approval and shall ensure design standards of stormwater facilities are per Best Management Practices prior to issuing permits. Seeley County Water District Mitigation recommendations are as follows:

- D-1** Seeley County Water District shall not accept the granting of improved retention basin for dual park use and stormwater infrastructure unless the District has adopted Stormwater Standards, and;
- D-2** Seeley County Water District shall not accept the granting of improved retention basin for dual park use unless there is a financing mechanism in place that will cover anticipated maintenance and repair costs of shared facilities.
- D-3** Seeley County Water District shall periodically note any incidents of violations from stormwater facilities and report them immediately to Imperial County for enforcement.

5.3 SERVICES PROVIDED BY OTHERS

There are additional services provided within the Seeley Service Area by agencies other than Seeley County Water District or Imperial County. These special services include educational facilities and other utility services from various purveyors. The sections that follow will discuss these services that are provided by other special districts in brief overview as follows:

- **Solid Waste Facilities-** Solid Waste services consist of the collection and transport of solid waste generated by households and businesses and transported to a landfill for disposal.
- **Public Lighting Facilities-** Lighting facilities refer to the existing street lighting system within the Seeley County Water District service area. The street lighting system consists of the street lights and supporting facilities such as poles and wires.
- **School Facilities-** School facilities consist of improvements necessary to provide educational services including classrooms, libraries, cafeterias, etc. School facilities may further incorporate support services such as school buses, gym or lab equipment and recreational facilities.

5.3.1 Solid Waste Services and Facilities

Typically, the jurisdictional agency oversees contracts for waste collection and disposal. In some communities, it may be the sewer facility district while in others it may be the governing body. The Seeley community does not receive solid waste services under any umbrella contract with a solid waste service purveyor. Citizens independently obtain solid waste services with the company of their choosing. Currently there are three companies that service Seeley: 1) Republic Services, 2) Lucky Tire Inc., and 3) CR&R.

Performance Standards for Solid Waste Services

The State regulates solid waste via laws such as the California Integrated Waste Management Act (AB 939) which requires solid waste reduction, recycling and composting and environmentally safe transformation and land disposal. Municipalities will typically enter into a franchise agreement with solid waste collection purveyor and performance standards are outlined in the franchise agreements. Collection times and schedules, noise and disruption, solid waste containers, bulky item pick-up, electronic waste, green waste, and commercial roll-off provisions are typically spelled out in the franchise agreement to ensure order pick-up and disposal of solid waste. Franchise agreements will also details regarding compliance with recycling, source separation, and other State

requirements. Since Seeley is located in an unincorporated area, the County of Imperial is responsible for ensuring compliance with AB 939.

Inventory of Solid Waste Facilities

There is no solid waste office or landfill within the Seeley community. All service purveyors collect and haul off solid waste to a legally permitted landfill. Republic Services transports waste collected to the Allied Waste Land Fill in a privately-owned landfill, located at 104 East Robinson Road, within an unincorporated area, east of the SCWD; Lucky Tire Inc. and CR&R both take their solid waste to the CR&R Landfill located out of State in Yuma, to a location at 19536 South Avenue 1E in Yuma Arizona.

Adequacy of Solid Waste Services and Facilities

Residents are provided receptacles from the company that they choose. CR&R does not provide recycling services. CR&R picks up solid waste on Fridays. Lucky Tire Inc. collects solid waste as the customer requires from Monday to Friday. Additionally, Lucky tire Inc provides recycling services approximately once a week, but frequency may increase based on customer needs. Republic Services collects solid waste on Thursdays. While they do not currently offer recycling services, it is currently being considered by the company.

An estimated 2,788 tons of solid waste are collected annually from the Seeley community. An Estimated 3 – 10 tons are collected from the Seeley community by CR&R alone. The following are the capacities of each of the landfills:

- **Imperial Allied Waste Landfill**, used by Republic Services and Lucky Tire Inc. was recently expanded and has a disposal acreage of 162 acres (15,054,198 Tons) and an expected closure date of December 31, 2040.
- **CR&R Landfill**, used by CR&R currently has 1,913,636 tons of solid waste on site. The land fill has a disposal acreage of and a closure year of 2050. The Allied Waste Landfill may be used in cases of emergency, or through negotiations between CR&R and Republic Services.

Solid waste can also be disposed of at other landfills within Imperial County if the purveyors negotiate agreements with them. There are currently four (4) Imperial County-owned landfills: near Imperial, Calexico, Niland, and Bombay Beach. Additionally, there are two (2) privately owned landfills located in Salton City and Brawley.

Inventory of Approved Solid Waste Facilities

There are no additional Solid Waste Facilities proposed.

Buildout Demand for Solid Waste Facilities and Services

There are no additional Solid Waste Facilities and Services proposed. Existing solid waste facilities are adequate in size and no additional facilities are necessary. As development occurs, through the entitlement process, developers are required to ensure that solid waste facilities are adequate and in place before any new development is approved. Given that the Imperial Landfill was recently expanded, there are adequate solid waste facilities. The Sunbeam Lake Estates Mitigated Negative Declaration found that there is sufficient capacity at the existing landfill and buildout of the project would create less-than-significant impact to solid waste facilities and services.

Opportunity for Shared Solid Waste Services and Facilities

The landfill are shared facilities with many other jurisdictions in Imperial County. There may be an opportunity, however, for SCWD to negotiate and contract for waste disposal services on behalf of the Seeley Community and establish an enterprise fund in the future for the purpose of maximizing these services.

Phasing of Solid Waste Facilities

There are no additional solid waste facilities being proposed under the SAP, as there is no contract with the District for the provision of these services.

Mitigation for Solid Waste Facilities

No mitigation measures are required.

5.3.2 Lighting Facilities

Public lighting facilities are typically owned by the jurisdiction owning the right-of-way under which they are found. All rights-of-way within the Seeley Community belong to the County of Imperial. Operation costs for electrical services are typically borne by the jurisdiction owning the right-of-way unless a contract for service exists with private owners or another entity.

Performance Standard for Lighting Facilities

There are no adopted performance standards by Imperial County or Imperial Irrigation District for lighting facilities. Typical street lights with 150-watt bulbs provide a coverage of approximately 150' diameter, and as such, street lights should be located every 300' to provide full coverage along sidewalks. Street lights should also be installed at intersections to ensure night-time visibility for vehicular traffic. Lighting provides safety and security but fixtures should be shielded to minimize light spill on to homes and to minimize light pollution to maintain a dark, night sky.


Generally, if lights are not functioning, IID makes the repair to the light and the cost is borne by designated owner. Older street lights generally have wooden poles and are owned by the Imperial Irrigation District while the newer lights within more recent developments consist of metal poles. It is important to note that IID incorporates energy efficiency components throughout its lighting facilities.

Inventory of Existing Lighting Facilities


There are approximately 47 street lights within the Seeley County Water (**Refer to Exhibit 5-J – Street Lighting System in Seeley**). There is an average of one light pole every 300 linear feet in north-south directions and 600 linear feet in east-west directions. Street lights within the Seeley County Water District Area are high-pressure sodium (HPS) bulbs varying from 70 Watts to 150 Watts.

Adequacy of Existing Lighting Facilities

As stated earlier, street lights should be located every 300' and at intersections to ensure full coverage for safety and security. Lighting in north-south streets appear to be adequate as there are light poles every 300'. Lighting in east-west streets, however, appear to deficient in that there are light poles every 600'. Most intersections appear to be lighted with the exception of Rio Vista-New River, Mount Signal-Main, Mount Signal-Park, and Evan Hewes-New River intersections.

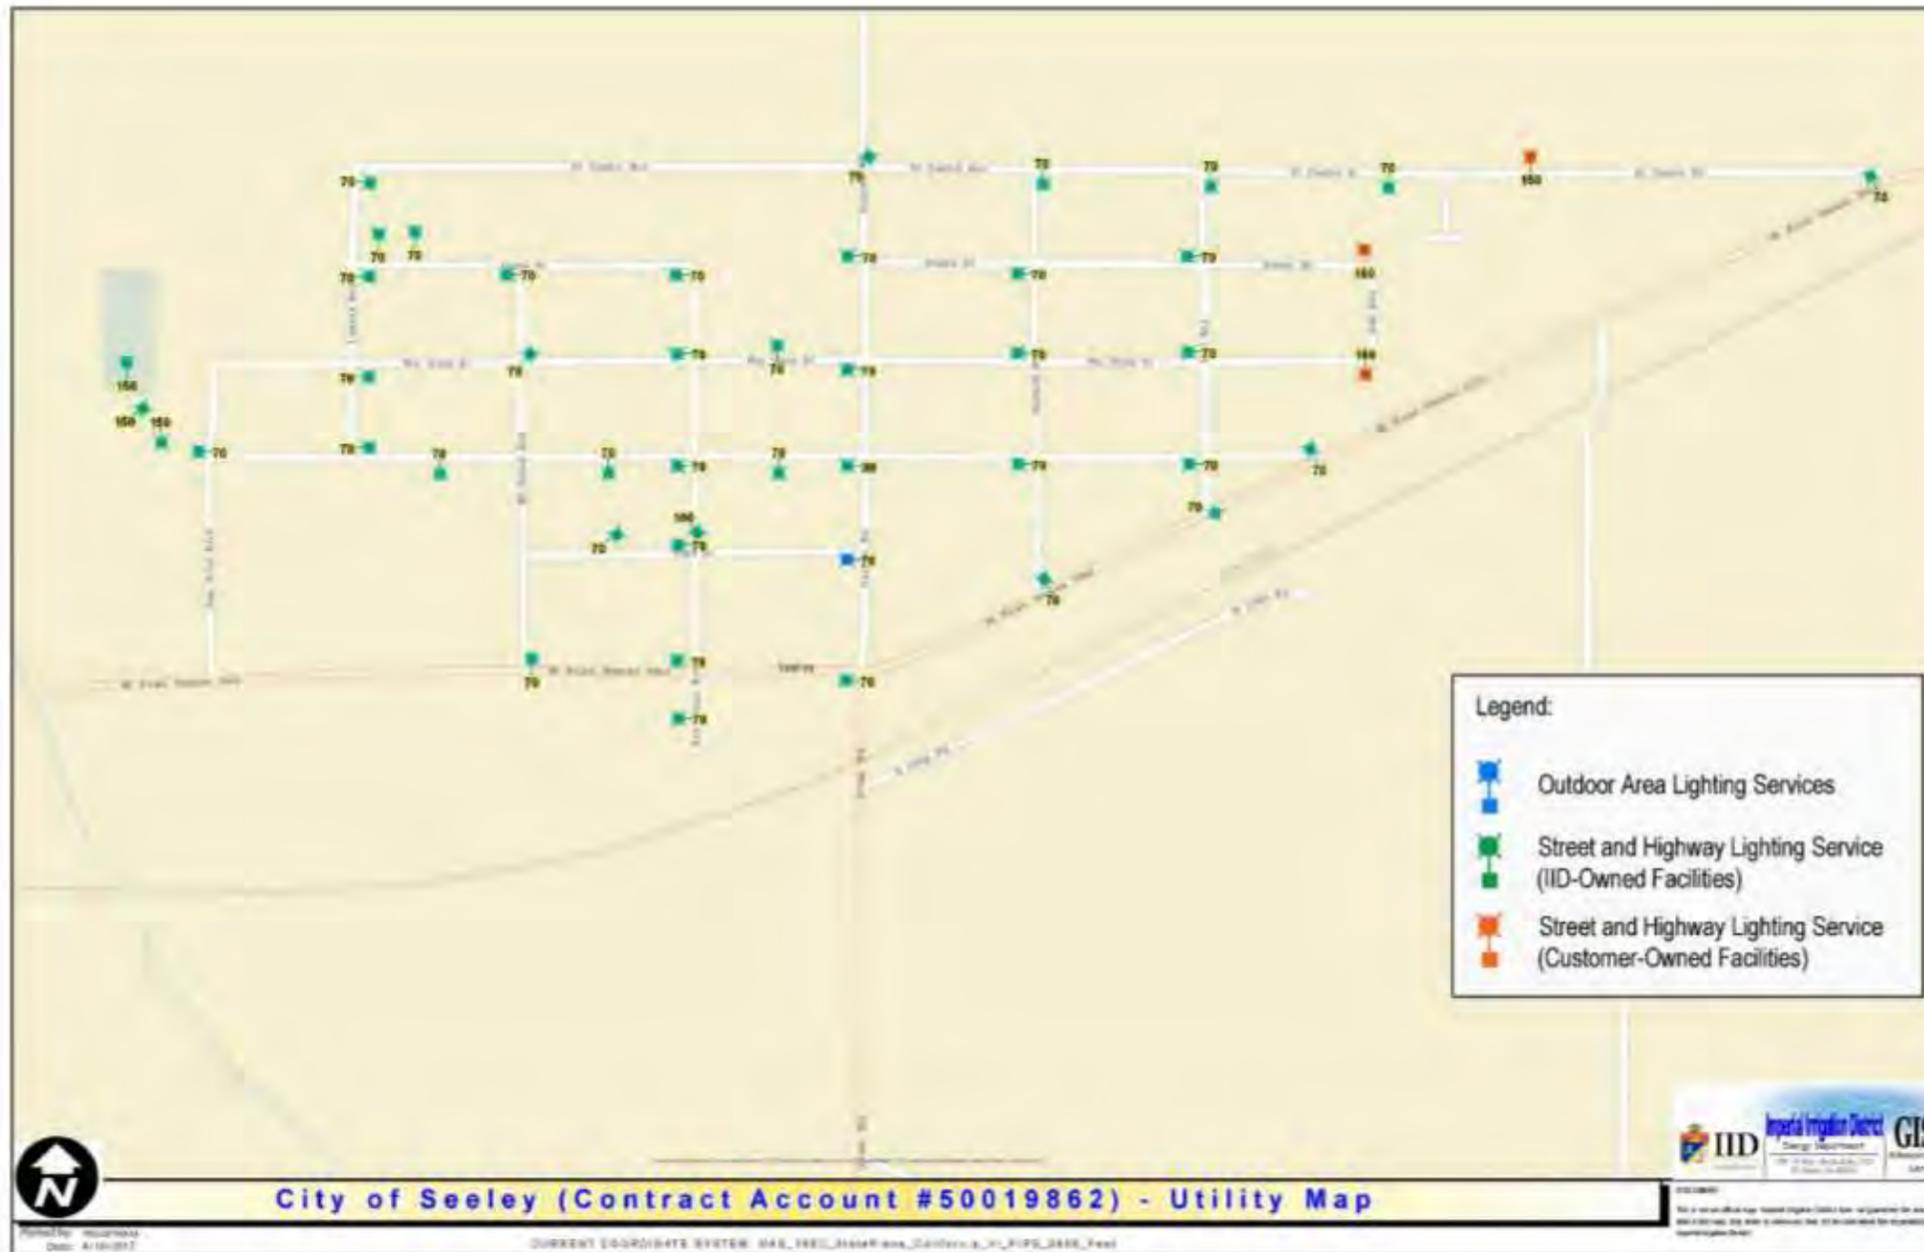

The Holt Group, Inc.
ENGINEERING PLANNING SURVEYING



NOT TO SCALE

**STREET LIGHTING SYSTEM IN
SEELEY COUNTY WATER DISTRICT**

EXHIBIT 5-J

1601 NORTH IMPERIAL AVENUE EL CENTRO, CALIFORNIA 92243

760-337-3883

PROJECT NO:
THG 1186.009

DATE:
July 2017

Buildout Demand for Lighting Facilities

As residential and commercial development occurs, developers work with the Imperial Irrigation District to install lighting facilities. Developers are required to submit various applications to the Imperial Irrigation District and pay applicable fees. The Developer is responsible for providing all project related documentation, inclusive of an approved Street Lighting Plan. After fees are paid, the Imperial Irrigation District's Distribution Engineering Section prepares a job package for construction. Imperial County approves the both the Street Lighting Plan and building permit as the District does not have land use authority. Should a development demand services beyond what can be supported by the existing substation, the costs of providing another substation are borne by the developer.

Opportunity for Shared Lighting Facilities

There are currently no opportunity for shared lighting facilities.

Phasing of Lighting Facilities

Lighting facilities are constructed on an as-needed basis for all new development. Phasing of lighting facilities is typically consistent with the phasing of residential or commercial development. As development occurs, street lights are incorporated to ensure safety.

Mitigation for Lighting Facilities

Public lighting is typically paid through the collection of property tax by the owning jurisdiction. SCWD shall ensure that prior to assuming any lighting service responsibilities that accompanying revenues be agreed to whether it be via tax share agreements or specific community facility districts.

5.3.3 School Facilities

Performance Standard for School Facilities

The schools' capacity is determined according to the methodology specified by Education Code Section 41376 and 41378. These calculations determine that kindergarten shall be at a maximum of 33 students per classroom, first through third grade classrooms at 32 students per classroom and fourth through eighth grade classrooms at 29 students per classroom. The Seeley Union School District has not completed a School Facilities Needs Analysis to determine the need for additional school facilities.

School Facilities Owned by Seeley Union School District

Educational facilities and services are provided within the Seeley County Water District by the Seeley Union School District which covers an area of approximately 22 square miles. The school district provides educational services to the Seeley community for grades kindergarten through eighth and does not provide high-school education. Central Union High School provides high school education services for the area.

Inventory of Existing School Facilities

The Seeley community is serviced by two school districts, Seeley Union School District and the Central Union High School District. (Please refer to **Exhibit 5-K – School Facilities Map**). The School District operates from one building that is located on the Seeley Elementary School campus.

Seeley Union School District was established in 1912 as a single-school elementary school that serves K-8 grade levels. The Seeley Union School District operates one elementary schools and the District office. The Seeley Union Elementary School is located at 1812 West Rio Vista Road in Seeley. There is one special education classroom and 16 classrooms for K-8 grade level. There are currently 337 students enrolled at the school and as of 2017 there is capacity for an additional 163 fourth through eighth grade students.

Central Union High School District is the district of the three high schools in El Centro, California — Central Union High School (CUHS), Southwest High School (SHS), and Desert Oasis High School (DOHS). The CUHSD main office and boardroom are located adjacent to DOHS and provide services to the Seeley Community. All incoming freshman from Seeley Union School District have to attend Southwest High School

Inventory of Approved School Facilities

The Seeley Union School District has an approved plan for the construction of a gymnasium. There are no approved plans for the construction of new classroom facilities as it was operating below capacity as of the date of this SAP. In the future, the Seeley Union School District might consider constructing new classrooms to accommodate any changes in increased demand for services to accommodate new development and population growth.

Adequacy of Existing School Facilities

The existing Seeley Union School District facilities are adequate to meet the educational needs of the current population. The Seeley Union School District, however, will not be able to meet the expected demand from the projected population growth. As new development is proposed, close coordination with the applicable school districts is required to ensure proper development impact fees are assessed and that necessary facilities are constructed to accommodate the new development.

Buildout Demand for School Facilities

The Sunbeam Lake Estates subdivision was approved by the County of Imperial for development along the north side of Ross Road at Drew Road. The project site is outside the current service boundaries of SCWD but within the boundaries of the Seeley Union School District. Buildout of the project, along with infill development, would result in an estimated population of 9,212 residents in the year 2038. Using a generic student generation rate of 0.475 for elementary and middle-school aged children for single family residences and 0.5346 for multi-family dwelling units (based on Calexico Unified School District), ultimate buildout of infill projects and the Sunbeam Lake Estates subdivision would result in 507 new students. The school's current capacity can accommodate 163 students but a new school is needed for the other 344 new students.

The Mitigated Negative Declaration identified potentially significant impacts to School District as a result of the proposed residential development project. To mitigate the impact, Sunbeam Lake Estate is required to pay an additional school impact fee on top of the established impact fee. The fees will help in the expansion of existing school facilities.

Phasing of School Facilities

Seeley School's current capacity can accommodate natural growth and growth from infill development through 2038. Additional classrooms may be needed or reconfigured depending on actual grade demand. Seeley School will be at capacity

within Year 3 of the development of Sunbeam Lake Estates. If Sunbeam Lake Estates were to start developing this year, new students would begin attending in the 2018 school year and capacity would be reached in the 2021 school year. School facility planning, design, funding, and construction could take up to five years.

Mitigation for School Facilities

Seeley Union School District should develop a School Facilities Need Assessment to use as a tool for planning a new school site. The Seeley County Water District should approach the School District regarding the timely development of the Assessment.

6. FINANCING PLAN

6.1 INTRODUCTION

Seeley County Water District's Profit and Loss Statement for July 2015 to June 2017 shows a total of \$734,673.32 in expenses. Approximately 55.1% of those expenses were for wastewater operations, 42.4% for water operations, 1.2% for dumper operations, and the remaining 1.3% were administrative/other expenses. The financial statements for the fiscal year ended June 30, 2016 shows that the net position (the difference between assets and liabilities) was \$8,674,673.00. SCWD has a current loan balance of \$165,134.88 from the USDA with a loan maturation date of June 16, 2046. Loan payments are made on an annual basis for an amount of \$8,040.00. Terms of the loan requires that SCWD maintain an annual fund reserve of \$3,400.00. All other debt obligations were paid off in the fiscal year ended June 30, 2016.

The Financing Plan section of the Service Area Plan lists and describes potential revenue sources and various financing mechanisms available to the Seeley County Water District to meet the projected service and facility demands identified earlier in this document. It also describes how each existing facility and service is currently financed and how future financial demands for these facilities and services can be ensured.

Finance plans and available financing options are also discussed in this section and are largely subject to the guidelines of Proposition 218 which was enacted in 1996. Proposition 218 clearly defines general taxes and special taxes and sets guidelines on the issuance, use, and implementation of taxes, which includes water rates. Proposition 218 states that general taxes must be approved by a majority of voters before they can be imposed, extended or increased and special taxes require approval by a two-thirds vote.

6.2 EXISTING REVENUE SOURCES

This section provides a summary of the revenue sources available to finance the necessary public facilities and services within the District Boundary or as areas within the Sphere of Influence are annexed. The following list presents sources of revenue that are currently utilized by the District in order to accumulate finances necessary to develop and operate the various facilities and services discussed within the SAP. Complete budgetary information for financing mechanisms currently utilized is available for viewing at the District Office.

Property Tax

Property taxes generate revenue that can be used to support various improvements and services including general District expenses. Property taxes in California are governed by Proposition 13 which limits the property tax rate to 1%. Other voter approved bonds and assessment districts may also generate tax revenue. The County of Imperial, collects the property tax, and shares the tax revenue collected from property owners within the District. Property taxes are distributed to various entities including, Imperial County, cities, and special districts according to formulas and procedures established by California law and consistent with the “Teeter Plan” for distribution of delinquent taxes owed. Each eligible tax jurisdiction receives a base amount of property tax that increases or decreases based on the growth of that district. According to Property Tax Information issued by the County Controller’s Office, taxes are allocated as follows: schools receive 59%, Cities receive 22%, County receives 12%, Special Districts share 3%, Fire Protection receives 3%, and Libraries receive 1%.

The District may enter into specific tax sharing agreements for tax revenue over and above the aforementioned proportion. There is however, no official tax share agreement in place for all District areas. The District cannot rely on tax revenue beyond the stipulated by California Law until an official agreement is put in place with the County. The District Finance Department estimates that approximately \$2,500 in property tax revenue may be collected annually depending on assessed values. This tax is utilized by the District to cover non-water or sewer enterprise expenses including park maintenance and power services for street lighting.

Development Impact Fees

Development Impact Fees are charges to private developers to assure that the demand of physical and financial impacts to public services and facilities are adequately addressed. Development Impact Fees can be a significant funding source to finance large scale capital improvements to public facilities. Development impact fees are used exclusively to fund the capital costs of new and improved facilities specifically related to the category for which fees are charged. The District has an established impact fee as capacity fee and collects the fees for both Water Treatment Facilities and Wastewater Treatment Facilities. The level of Development Impact Fees collected on any given year is driven by the level of new development demand. Table 6-A Adopted Impact Fees depicts the fees in place at the time of the development of this Service Area Plan:

**Table 6-A
SCWD Adopted Impact Fees**

| Fee | Residential | Commercial/ Industrial | School | RV Park | Dumpster/ Hauler |
|-------------------|-------------|---------------------------|---------|---------|---------------------|
| Sewer Fees | | | | | |
| Capacity | \$2,450 | \$2,450 | \$2,450 | \$2,450 | n/a |

| Water Fees | | | | | |
|-------------------|---------|---------|---------|---------|-----|
| Capacity | \$3,700 | \$3,700 | \$3,700 | \$3,700 | n/a |

Source: Seeley County Water District

User Fees

Certain public services and facilities operated by the District entail various user fees that are charged to patrons or other users on a fee-for-service basis. User fees are typically applied to a monthly service. Monthly fees may be charged for services such as water, sewer, and trash to residential uses, commercial uses, industrial uses, and/or public agencies. User fees are also charged for reconnections, penalties, and late fees. The fees are typically used as a revenue source to maintain the systems in proper operating condition and for the construction of facilities needed to meet demand. The District's current user fees were adopted in 2016 and are depicted in Table 6-B and 6-C as noted.

**Table 6-B
Water Rates**

| Customer Classification | Flat monthly fee | Water usage /1000 gallons |
|--|------------------|---------------------------|
| Average Single-Family Customer (=1 EDU) | \$32.73 | \$1.29 |
| Average Two-Family Customer, per Household (=7 EDU EA) | \$22.92 | \$1.29 |
| Average Multi-Family, per Household | \$22.92 | \$1.29 |
| Average Commercial Customer, 2 EDU's | \$65.46 | \$1.29 |
| Large Commercial Customer, 29.75 EDU's | \$973.72 | \$1.29 |
| Large Commercial Customer, 34.0 EDU's | \$1,112.82 | \$1.29 |
| Large Commercial Customer, 82.5 EDU's | \$2,700.23 | \$1.29 |

*Rates are effective as of March 1, 2017 and will increase 5% annually for 5 years.

Source: Rate Increases Approved by SCC Board Table, Effective March 1, 2017

**Table 6-C
Sewer Rates**

| Customer Classification | Flat monthly fee |
|--|------------------|
| Average Single-Family Customer (=1 EDU) | \$47.45 |
| Average Two-Family Customer, per Household (=7 EDU EA) | \$33.22 |
| Average Multi-Family, per Household | \$33.22 |
| Average Commercial Customer, 2 EDU's | \$94.90 |
| Large Commercial Customer, 34.0 EDU's | \$1,613.30 |
| Large Commercial Customer, 82.5 EDU's | \$3,914.63 |

*Rates are effective as of March 1, 2017 and will increase 3.3% annually for 5 years.

Source: Rate Increases Approved by SCC Board Table, Effective March 1, 2017

On average, the Seeley County Water District receives an estimated \$360,000 in annual service fee revenue from the Water Enterprise Fund. Additionally, the District receives an estimated \$485,000 in annual service fee revenue from the Sewer Enterprise Fund. These revenues along with the project increase in revenues are projected to cover operation and maintenance costs. There are no outstanding loans thus no need for any loan reserves as of June 2017. Reserves for capital improvements may need to be re-evaluated on a continual basis.

Developer/Builder Contribution

Many of the sewer and water improvements required as a result of new development can be directly funded and constructed by the developer/builder. These required improvements would be in addition to Developer Impact Fees and User Fees. The County of Imperial would respectively request contributions for drainage, parkland and roadway improvements.

Other Local Revenue Sources

The District currently generates revenues from other sources such as interest earned from bank accounts. Although these miscellaneous revenues are useful, they account for negligible impacts to the District's total operational budget.

6.3 POTENTIAL REVENUE SOURCES

Community Facilities Districts

A Community Facilities District (CFD), not to be confused with a Community Services District (CSD), falls under the 1982 Mello-Roos Community Facilities Act. This Act allows a CFD to be established by cities, counties, special districts and school districts to fund a variety of facilities and services. Note that the boundaries of a CFD are not required to be contiguous as they are for a CSD. In order for a CFD to be formed, a public hearing must occur and an election held to authorize the specified tax levy to either provide direct funding or pay off bonds. The Seeley County Water District does not have any CFD within its District boundary as of the date of this 2017 Service Area Plan.

Private Financial Institutions

A financing opportunity may be via revenue bonds through private financial institutions as part of their Community Reinvestment Act (CRA) obligations. The Community Reinvestment Act was enacted by the U.S. Congress in 1977 to encourage depository institutions to help meet the credit needs of the communities in which they operate, including low- and moderate-income neighborhoods,

consistent with safe and sound banking operations. The Community Reinvestment Act requires federal financial supervisory agencies to use their authority when examining financial institutions subject to supervision, to assess the institution's record of meeting the credit needs of its entire community, including low- and moderate-income neighborhoods. Local institutions make keep a good standing in order to continue to grow, thus investment opportunities into small community capital improvements are actively sought be responsible financial institutions. The following lending institutions have local CRA obligations:

- Bank of America- Satisfactory rating as of 2015
- JP Morgan Chase Bank- Outstanding Rating as of 2006
- Rabobank- Satisfactory Rating as of 2007
- Union Bank of California- Outstanding Rating as of 2005
- Wells Fargo- Outstanding Rating as of 2006

Public Financial Institutions

North American Development Bank (NADBank)- The NADBank is a binational financial institution capitalized and governed equally by the United States and Mexico for the purpose of financing environmental projects certified by the Border Environment Cooperation Commission (BECC). The two institutions work together with communities and project sponsors in both countries to develop and finance infrastructure necessary for a clean and healthy environment for border residents. NADB can make loans to public and private borrowers, at market and low-interest rates, for the implementation of environmental infrastructure projects located in the U.S.-Mexico border region. Loans are available for the implementation of projects in all environmental sectors in which the NADBank operates.

California Infrastructure and Economic Development Bank (IBank)- The Infrastructure State Revolving Fund (ISRF) Program provides low-cost financing to public agencies for a wide variety of infrastructure projects. ISRF Program funding is available in amounts ranging from \$50,000 to \$25,000,000, with loan terms for the useful life of the project up to 30 years. Interest rates are set at the time the applicant is approved and are typically pegged at 67% of a generic A rated municipal bond with an equivalent term to the Loan. Preliminary applications are continuously accepted.

Federal Grant Agencies

USDA Rural Utility Service Program- USDA Rural Development provides funding opportunities in the form of payments, grants, loans, and loan guarantees, for the development and commercialization of vital utility services. These programs revitalize rural communities with a variety of infrastructure improvements, and

create sustainable opportunities for wealth, new jobs, and increased economic activity in rural America.

Utilities programs connect rural residents to the global economy by developing rural water and wastewater systems to help address water quality, amongst other infrastructure projects.

U.S. Environmental Protection Agency (EPA)- EPA's mission is to protect human health and the environment. Nearly half of their budget goes is used towards grants to state environmental programs, non-profits, educational institutions, and others. The funds are used for a wide variety of projects, from scientific studies that assist in EPA making decisions to community cleanups. Overall, grants assist EPA in achieving their overall mission: protect human health and the environment. EPA's Border Water Infrastructure Program provides grant assistance to communities along the U.S./Mexico border to develop and construct infrastructure to provide safe drinking water and adequate sanitation, and to improve water quality in shared and trans-boundary waters. EPA funds grant programs through the Border Environmental Cooperation Commission created in 1993 under a side agreement to the North American Free Trade Agreement (NAFTA) for the purpose of enhancing the environmental conditions of the US-Mexico border region. BECC and NADBank work closely with other border stakeholders including federal, state, and local agencies, the private-sector and civil society to identify, develop, finance and implement environmental infrastructure projects on both sides of the US-Mexico border. BECC focuses on the technical, environmental, and social aspects of project development, while NADBank concentrates on project financing and oversight for project implementation. Two Grant Programs available through BECC are the Project Development Assistance Program (PDAP) and Border Environmental Infrastructure Fund (BEIF) as follows:

- **Community Assistance Program (CAP):** The Community Assistance Program is administered through BECC and funds smaller shovel ready projects up to \$500,000. Funded with NADB's retained earnings, this program offers grant financing to support the implementation of projects sponsored by public entities in all environmental sectors eligible for NADB financing. The objective of this program is to support the implementation of critical environmental infrastructure projects for sponsors with limited capacity to incur debt.
- **Project Development Assistance Program (PDAP):** Funding is available for project development activities necessary for certification of projects including, but not limited to planning studies, environmental assessment, final design, financial feasibility, community participation, and development

of sustainability elements. Final design grant assistance is limited to 50% of the final design costs and cannot exceed \$500,000.

- **Border Environmental Infrastructure Fund (BEIF):** Grants are intended to supplement funding from other sources in order to complete a project's financial package. Applicants must seek other sources of funding since BEIF is considered to be the funding of last resort. Actual BEIF participation is considered on a project-by-project basis and determined according to funding availability and based on an affordability analysis to be conducted by NADBank during project development.

State Grant Agencies

State Water Resources Control Board- The Division of Financial Assistance (DFA) administers the implementation of the State Water Resources Control Board's (State Water Board) financial assistance programs that include loan and grant funding for construction of municipal sewage and water recycling facilities, remediation for underground storage tank releases, watershed protection projects, nonpoint source pollution control projects, and other similar projects. The State Water Resource Control Board administers the Clean Water State Revolving Fund (CWSRF), the Drinking Water State Revolving Fund and Small Community Wastewater Grant (SCWG) Programs. More information on each Program is found below.

- **Clean Water State Revolving Fund Program (CWSRF)-** The Clean Water State Revolving Fund Program accepts applications on a continuous basis. The Federal Water Pollution Control Act (Clean Water Act or CWA), as amended in 1987, established the Clean Water State Revolving Fund (CWSRF) program. The CWSRF program offers low interest financing agreements for water quality projects. Annually, the program disburses between \$200 and \$300 million to eligible projects.
- **Drinking Water State Revolving Fund Program (DWSRF)-** The Drinking Water State Revolving Funds Program was established by the 1996 amendments to the Safe Drinking Water Act (SDWA). The DWSRF is a financial assistance program to help water systems and states to achieve the health protection objectives of the SDWA. The state DWSRFs have provided more than \$32.5 billion to water systems through 2016. Small disadvantaged communities can obtain up to 100% grant funding for eligible projects.
- **Small Community Wastewater Grant (SCWG)-** The Small Community Wastewater Grant Program was created to aid small, financially

disadvantaged communities in correcting public health and water quality problems. The SCWG Program originally received funding through the Clean Water Bond Law of 1984, but has relied on several additional funding propositions to continue to assist small communities with water quality needs. Priority is given to small disadvantaged communities which have a significant water quality investment with wastewater rates of at least 1.5% of the communities MHI. Small disadvantaged communities can obtain up to 100% grant funding for eligible projects.

California Department of Housing and Community Development- The State Community Development Block Grant (CDBG) program was established by the federal Housing and Community Development Act of 1974, as amended (42 USC 5301, et seq.). The State CDBG program is implemented by California Health and Safety Code section 50825, et sequentia, and the California Code of Regulations (Title 25, Section 7050, et sequentia). The primary federal objective of the CDBG program is the development of viable urban communities by providing decent housing and a suitable living environment and by expanding economic opportunities, principally for persons of low and moderate income. "Persons of low and moderate income" or the "targeted income group" (TIG) are defined as families, households, and individuals whose incomes do not exceed 80 percent of the county's median income, with adjustments for family or household size.

Each year the program makes funds available to eligible jurisdictions through several allocations. Under the General Allocation, jurisdictions may apply for funding to subsidize public facilities or special assessment districts. Although SCWD would not be able to access the funds directly, it may do so under an agreement with the County of Imperial.

6.4 FACILITY FINANCING

6.4.1 Administrative Facilities

Current Funding

The existing administrative facilities are currently owned by Seeley County Water District. The primary sources of revenue for operation and maintenance of the administrative facilities are water and sewer user fees, as the District's primary function is the provision of wastewater and potable water services.

Cost Avoidance Opportunities

There is currently no opportunity for Cost Avoidance. The operation and costs of the administrative facilities is shared by the two funds. The facility is used for Board meetings and all SCWD related business.

Recommended Funding

Existing funding sources will continue to be used to support administrative services and facilities. The District will continue to use water and user fees to offset the maintenance and operation of the administrative facilities operated by the District. Development Impact fees may become a key source of funding for capital facilities in the future as deemed necessary by the County of Imperial during the development review process.

It is further recommended that SCWD adopt deposit and fees for the cost of engineering review of developer plans. As new development occurs, it will be necessary for the District to review the proposed infrastructure improvement plans for facilities that will be taken over by the District or to ensure the new facilities don't adversely impact the District's systems. The cost for the District engineer to review plans is a recoverable cost for the administrative/professional service.

Administrative costs may be borne to the General Fund, each enterprise fund, and a parks and lighting fund as deemed appropriate by the District.

6.4.2 Wastewater Facilities

Current Funding

The primary sources of revenue for wastewater facilities are user fees. Development impact fees (capacity fees) which have been collected over the years are only a revenue source for capital improvements to wastewater facilities and are limited due to slow growth. The current wastewater user fees were last

updated in 2016 and were made effective on March 1, 2017 and are established at \$42.45 for single family residential as of the date of this document with a capacity fee of \$2,450.

Cost Avoidance Opportunities

The District requires developers to construct wastewater-related infrastructure that will connect the specific development with the existing wastewater treatment system. This requirement helps the District avoid substantial costs associated with infrastructure development.

Recommended Funding

The District will continue to use the financing mechanisms described above. User fees will continue to finance the wastewater operation, maintenance, salaries, and equipment costs. The District will continue to use user fees and capacity fees to finance the City's wastewater service and capital improvement needs as well as ongoing operation and maintenance.

It is recommended that the Impact Fees (Capacity Fees) for all new wastewater services be reviewed and evaluated. The Sewer Impact Fees would be applicable for all new proposed development to offset their respective new demand such as WWTP expansion or new collection main lines with increased capacities.

System rehabilitation costs or pipeline replacement costs associated with system deficiencies that involve major capital investments and or improvements that are tied to Regional Water Quality Board demands should be addressed via grant funding programs. The SCWD qualifies for a number of subsidized funding sources, up to 100% grant funding under programs such as the Clean Water State Revolving Fund through the State Water Resources Control Board; Rural Assistance Community Facilities Program through the USDA; Community Assistance Program through the Border Environmental Evaluation Commission; Border Environmental Infrastructure Fund through NADBank and a possible indirect source accessing Community Development Block Grant HUD funds through the County of Imperial.

The SCWD should consider designating the wastewater fund as an independent fund from the water enterprise since these independent facilities have diverse capital needs and costs.

6.4.3 Water Facilities

Current Funding

The primary sources of revenue for water treatment and distribution facilities are the water service charges and water connection fees collected and deposited into

the Water Fund. Development impact fees (capacity fees) which have been collected over the years are the only current revenue source for capital improvements to water facilities and are also limited due to slow growth. User fees are collected for the continued operation and maintenance. The current user fees for water were last updated in 2016 and were made effective on March 1, 2017. The current user fee established at \$32.73 for single family residential and \$3,700 in capacity fees for residential connections as of the date of this document. However the current user fees will increase five percent (5%) annually for a total of five years.

Cost Avoidance Opportunities

The District requires developers to construct water-related infrastructure that will connect the specific development to District services. This requirement helps the District avoid substantial costs associated with new infrastructure development.

Recommended Funding

The District will continue to use the financing mechanisms described above. User fees will continue to finance the wastewater operation, maintenance, salaries, and equipment costs. The District will continue to use user fees and capacity fees to finance the City's water service and capital improvement needs as well as ongoing operation and maintenance. The current potable water user fees and capacity fees adopted in 2016 will continue to be in effect throughout the planning period unless modified by the District.

It is recommended that the Impact Fees (Capacity Fees) for all new water services be reviewed and evaluated. The Water Impact Fees would be applicable for all new proposed development to offset their respective new demand such as WTP expansion or new storage facilities, distribution lines or pump station with increased capacities.

System rehabilitation costs or pipeline replacement costs associated with system deficiencies that involve major capital investments and or improvements that are tied to Public Health Department notices of violations should be addressed via grant funding programs. The SCWD qualifies for a number of subsidized funding sources, up to 100% grant funding under programs such as the Drinking Water State Revolving Fund through the State Water Resources Control Board; Rural Assistance Community Facilities Program through the USDA; Community Assistance Program through the Border Environmental Evaluation Commission; Border Environmental Infrastructure Fund through NADBank and a possible indirect source accessing Community Development Block Grant HUD funds through the County of Imperial.

The SCWD should consider designating the water fund as an independent fund from the wastewater enterprise since these independent facilities have diverse capital needs and costs.

6.4.4 Park & Lighting Facilities

Current Funding

The primary sources of revenue for park facilities are property taxes for County parks followed by grant funds for improvements. SCWD does not set aside any funds for park operation and maintenance of the Robert Bates Memorial Park, however, it warrants to note that the District was successful in securing a one-time \$150,000 grant through the Imperial Irrigation District Local Entity Program anticipated to be expended during the 17/18 Fiscal Year. Street Light costs are also paid from property tax, however the cost of power services for street lights exceed the property tax revenue.

Cost Avoidance Opportunities

Parks-Currently, all new development must incorporate park facilities as a County established development standard. This County driven development standard should eliminate the need for the District to provide recreational facilities. Under these development standards, the District is not responsible for the purchase or dedication of land or for park improvements. Continued operation and maintenance costs for parks should be planned for and collected through the establishment of Community Facilities Districts. The SCWD and the County of Imperial should jointly seek these cost avoidance measures.

Street Lights-Currently, all new development must incorporate street lighting facilities as a County established development standard. This County driven development standard should be borne to the County of Imperial and not the SCWD.

Recommended Funding

Parks The District will continue to use the existing financing mechanisms described above to finance the District's continued improvement, operation and maintenance of parkland. As new development occurs, the formation of a Landscaping and Lighting District or similar mechanism should be considered and coordinated with Imperial County. The collected property tax contribution from Imperial County is not significant enough for the capital improvement needs or continued maintenance costs of the aging park infrastructure at the Robert Bates Memorial Park. The District in partnership with Imperial County should seek grant

funding opportunities through the Department of Parks and Recreation and other State agencies or local entities to improve the Robert Bates Memorial Park and/or the Sunbeam Lake Park.

Street Lights- Continued operation and maintenance costs for street lights should be planned for and collected through the establishment of Community Facilities Districts. The SCWD should attempt to negotiate a separate tax share agreement to cover street light expenses in the established Seeley Townsite.

The SCWD should consider establishing a parks and lighting fund to ensure park costs are not borne to the water or enterprise fund and for proper management of revenue.

6.4.5 Drainage Facilities

Current Funding

Within the District Boundary and the Heber sphere of influence, drainage facilities are generally installed and funded by developers as projects are developed. Routine maintenance, operation, and personnel costs are not currently tied to any District Fund nor accounted for through any maintenance agreements.

Cost Avoidance Opportunities

The District, in concert with the County of Imperial is able to avoid some costs for the development of new drainage facilities by requiring developers to construct adequate facilities and retention basins for their projects. As the County of Imperial seeks street funds it should address storm drain facilities within the right-of-way as eligible costs under FHWA grant funded projects.

Recommended Funding

Funding responsibilities for project related facilities should continue to be the responsibility of developers and secured prior to issuance of any “will serve” letters for water and/or sewer services that may be requested by developer. The District shall make clear that the ongoing operation and maintenance of any drainage facilities including retention basins shall be the responsibility of Imperial County and or privately owned and operated. If for any reason a detention basin is proposed to be dedicated to the SCWD, it shall be necessary to establish a financing mechanism such as a Community Facilities District.